

YKK AP AMERICA RESIDENTIAL
STYLEVIEW TWIN / TRIPLE SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED IN ORDER TO ACHIEVE A SQUARE AND PLUMB INSTALLATION WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **FIN INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE #8 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **FIN INSTALLATION:** FOR INSTALLATION THROUGH STEEL STUD USE #8 SELF-DRILLING OR SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND STEEL STRUCTURE.
7. FOR MASONRY OR CONCRETE OPENINGS, 1X WOOD BUCK MAY BE USED (OPTIONAL AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
8. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
9. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
10. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 33 MILS. (20 GUAGE)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

AAMA/WDMA/CSA 101/I.S.2/A440-11/17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X & 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PVC
7. DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:

X: OPERABLE SASH

O: FIXED SASH
8. GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 1 FOR GLAZING DETAIL.


TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION, GENERAL NOTES & GLAZING DETAIL
2	ELEVATIONS & ANCHOR LAYOUTS
3	VERTICAL SECTIONS, REINFORCEMENT TABLES, & ANCHOR SCHEDULE
4	HORIZONTAL SECTIONS

DESIGN PRESSURE TABLE								
UNIT	TYP. FRAME SIZE		MAX. D.L.O.		DESIGN PRESSURE	CONFIGURATION	INSTALLATION METHOD	IMPACT RATING
	WIDTH	HEIGHT	WIDTH	HEIGHT				
1	72"	80"	29 11/32"	36 1/16"	+35/-35 PSF	O/X-O/X FACTORY MULLION	NAIL FIN	NOT RATED
2	107 1/2"	71 1/2"	29 13/16"	32 1/16"	+50/-50 PSF	O/X-O/X-O/X	NAIL FIN	NOT RATED
3	119 1/2"	73 1/2"	29 11/32"	33 1/16"	+35/-35 PSF	O/X-O/X-O/X	NAIL FIN	NOT RATED

NOTE: TWIN CONFIGURATIONS CAN ALSO BE QUALIFIED FROM TRIPLE CONFIGURATIONS, SUCH THAT MAX. D.L.O. VALUES FROM TABLE ABOVE ARE NOT EXCEEDED.

GLAZING NOTES:

1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
4. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

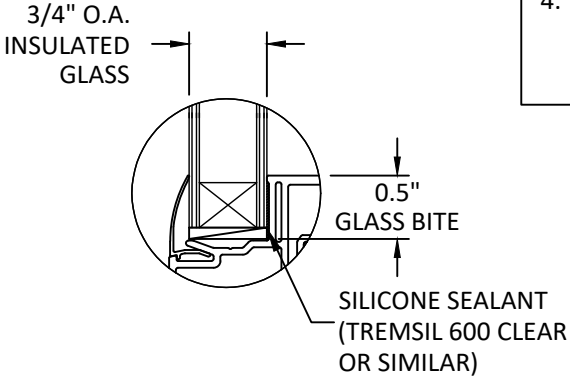

GLAZING DETAIL

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)

SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEVIEW TWIN / TRIPLE
SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
INSTALLATION, GENERAL NOTES &
GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.03.19 15:07:66 -0400'

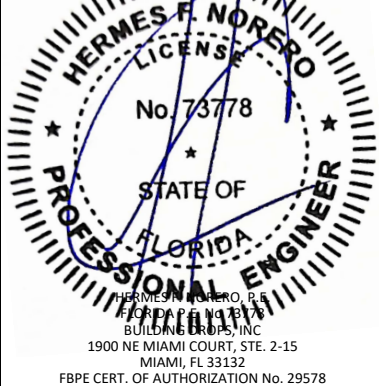

FL #:
FL8114

DATE:
01.31.18

DWG. BY:
RV

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK143

SHEET:
1

OF 4



TITLE: STYLEVIEW TWIN / TRIPLE
SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)

ELEVATION & ANCHOR LAYOUTS - TWIN


BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

PREPARED BY:


BUILDING DROPS

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

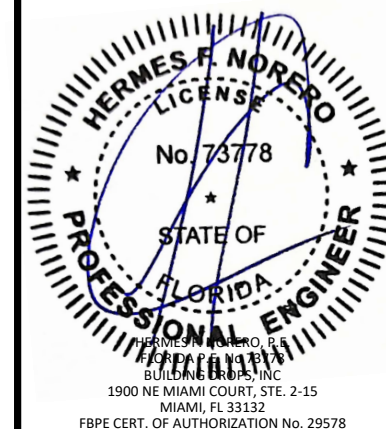

FL #: **FL8114**

DATE: 01.31.18

DWG. BY: RV	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: YKK143

SHEET:

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAILING FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.50"

REINFORCEMENT SCHEDULE		
UNIT	LOCATION	REINFORCEMENT PART#
1	STILE (BOTTOM VENT)	E9-5502D
2	MEETING RAIL (TOP VENT)	E9-5571D
	STILE (BOTTOM VENT)	E9-5502D
3	MEETING RAIL (TOP VENT)	E9-5571D
	MEETING RAIL (BOTTOM VENT)	E9-5502D
	STILE (BOTTOM VENT)	E9-5502D

MULLION REINFORCEMENT SCHEDULE			
CONFIGURATION	UNIT SIZE	DESIGN PRESSURE	REINFORCEMENT PART#
TRIPLE	108" X 72"	+/- 50 PSF	E9-5551D
			E9-5552D
TRIPLE	119 1/2" X 73 1/2"	+/- 35 PSF	E9-5551D

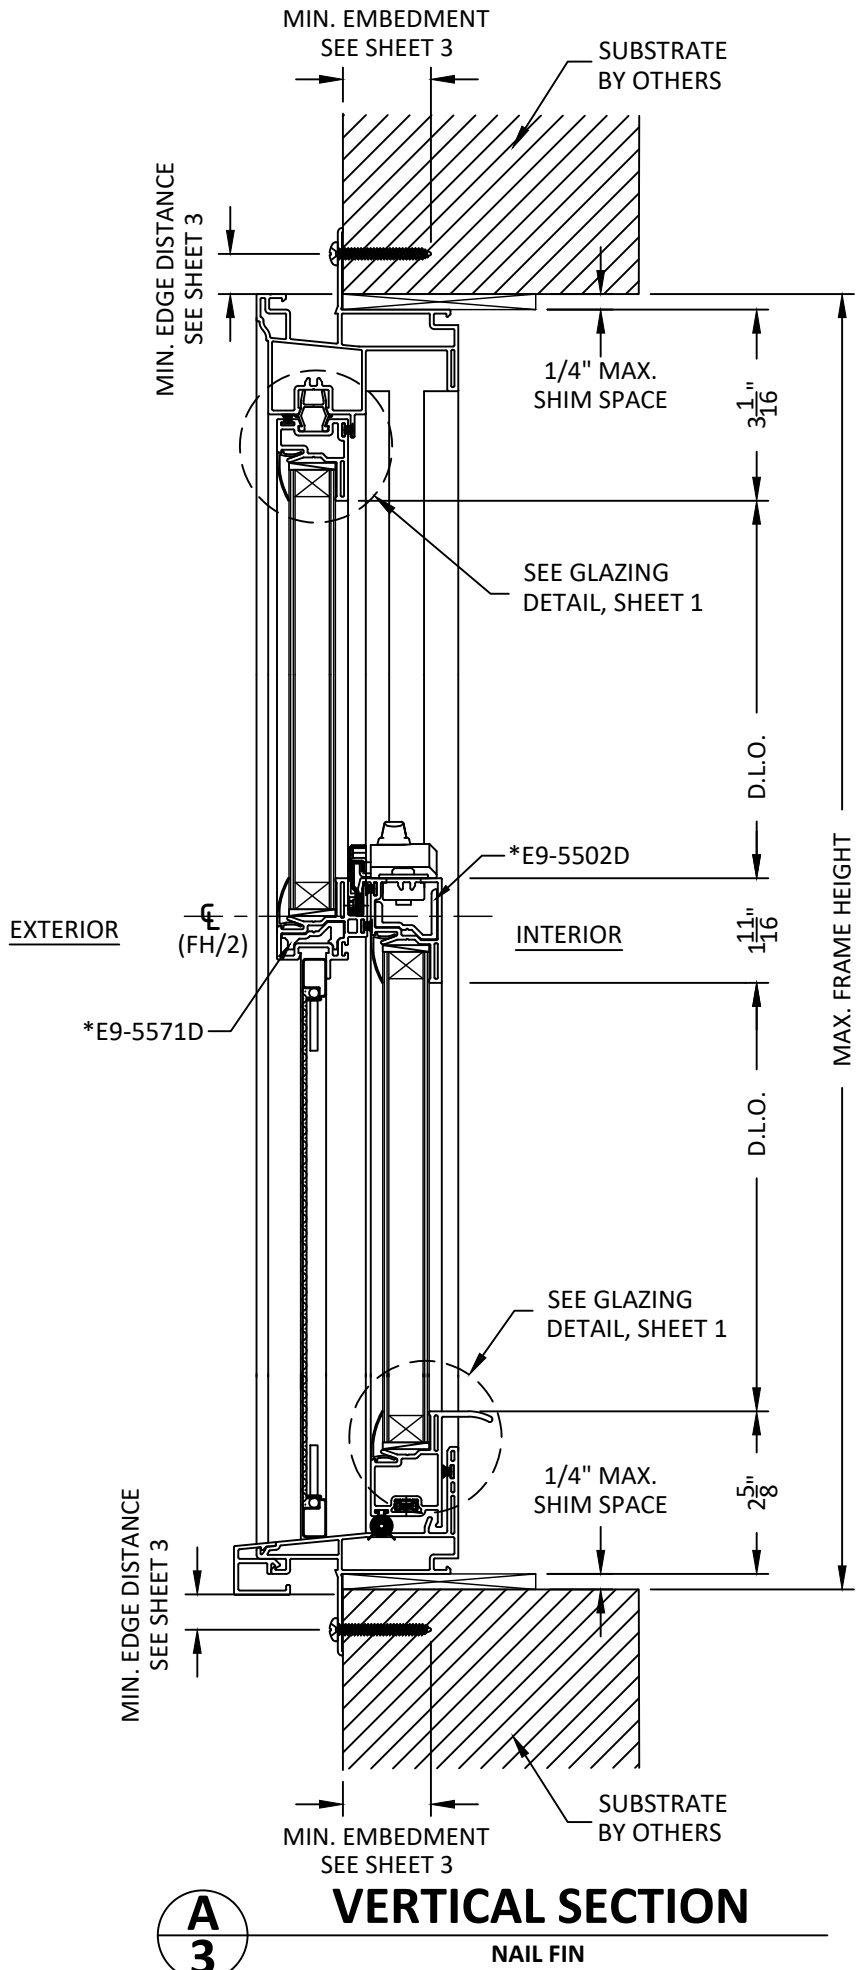



Quality
inspires™

YKK AP AMERICA RESIDENTIAL

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:

STYLEVIEW TWIN / TRIPLE
SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS, REINFORCEMENT
TABLES, & ANCHOR SCHEDULE


PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

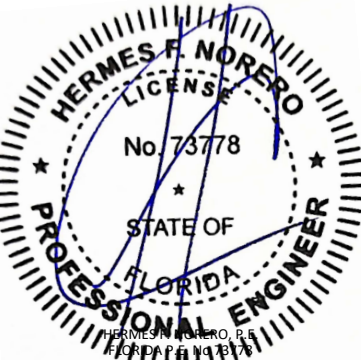

HERMES F. NORERO, P.E.

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL8114

DATE:

01.31.18

DWG. BY:

RV

CHK. BY:

HFN

SCALE:

NTS


DWG. #:

YKK143

SHEET:


3

OF 4

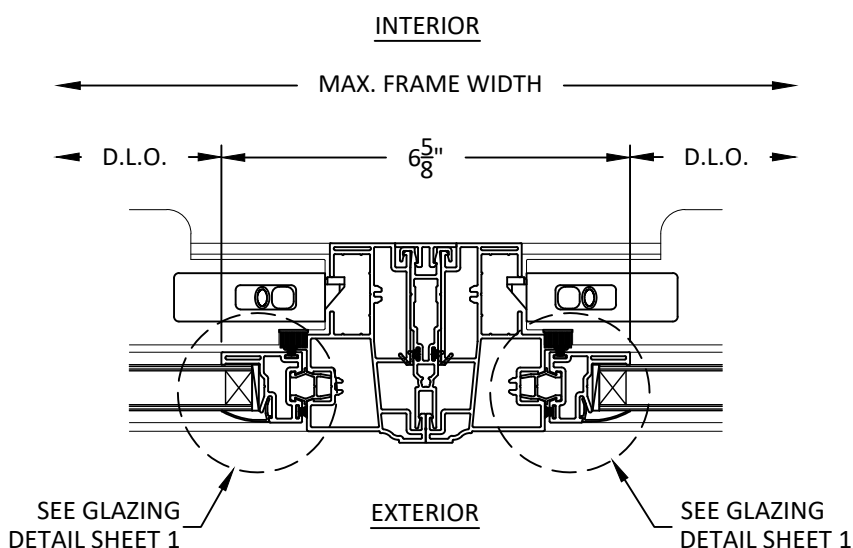

A **4** **HORIZONTAL SECTION**


FACTORY MULLION

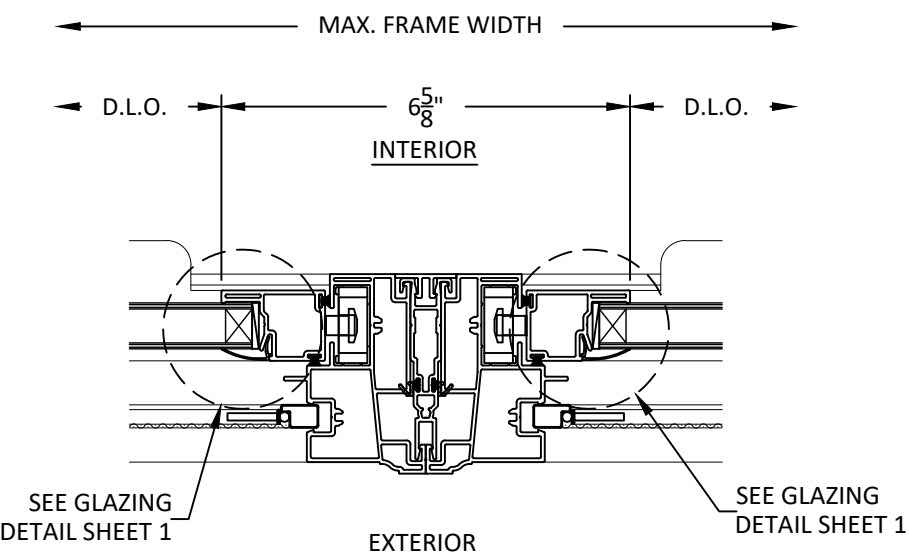

F
4

HORIZONTAL SECTION


FACTORY MULLION

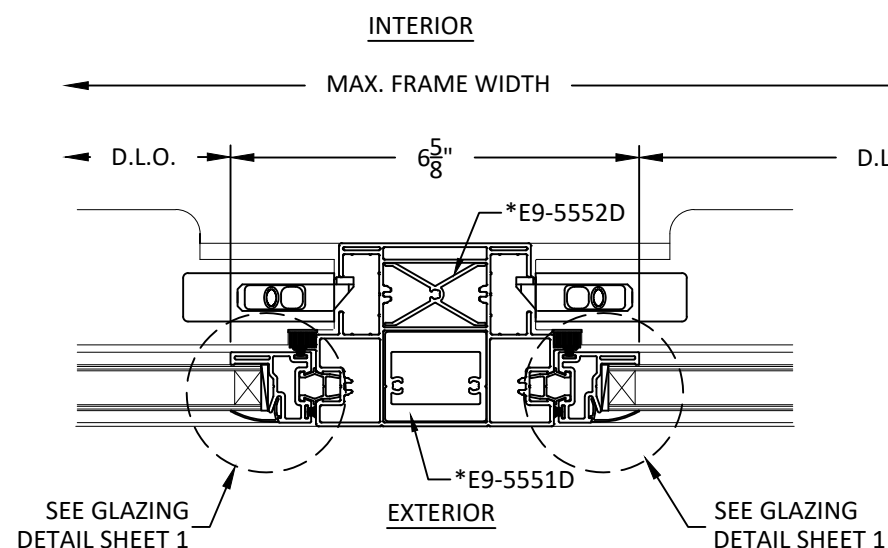


B 4 HORIZONTAL SECTION

FIXED MULLION

* NOTE: SEE REINFORCEMENT TABLES ON SHEET 3.

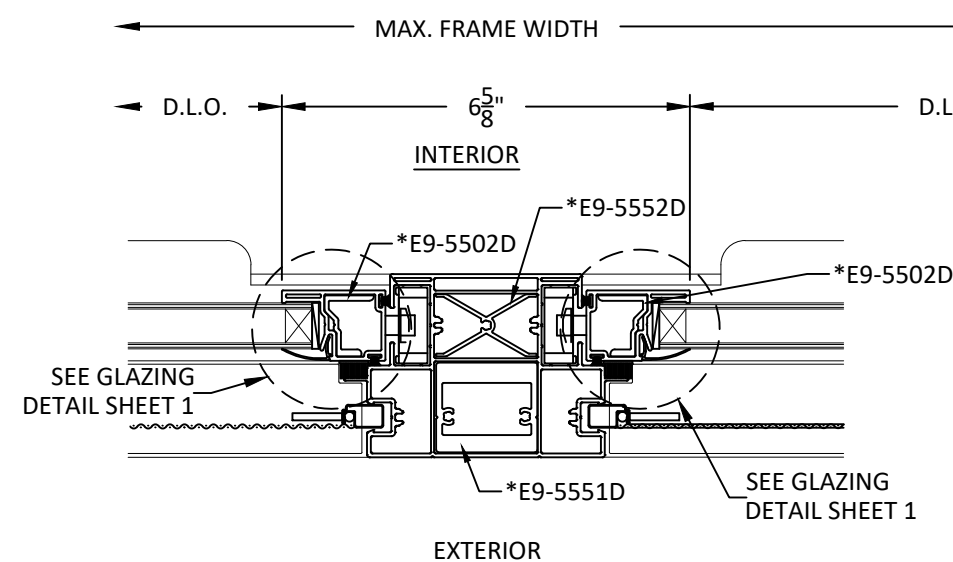


D 4 HORIZONTAL SECTION VENT MULLION

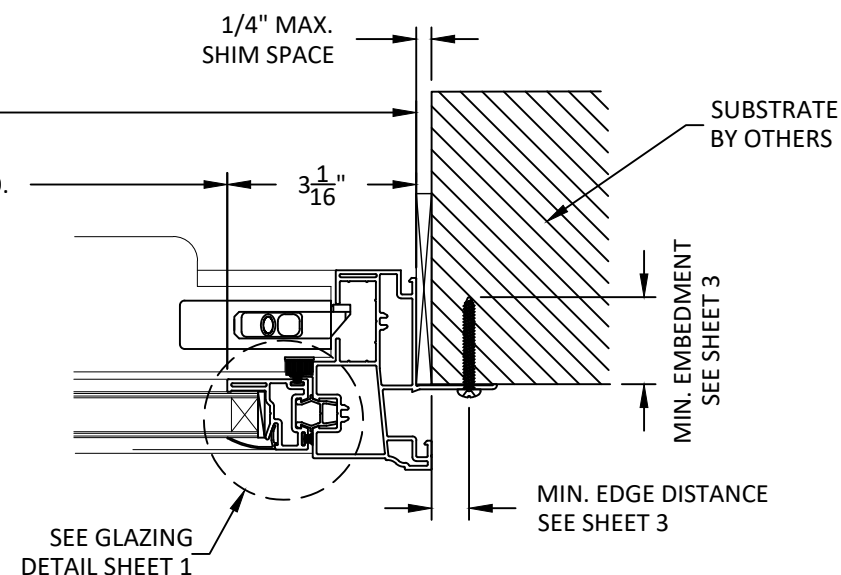

C 4

HORIZONTAL SECTION

FIXED JAMB-NAIL FIN

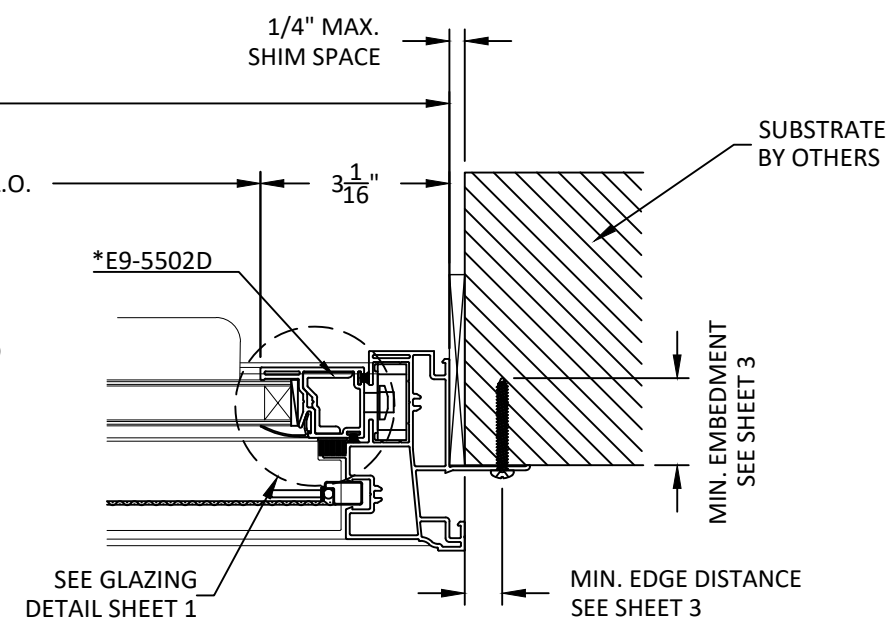

E
4 **HORIZONTAL SECTION**
VENT JAMB-NAIL FIN

YKK AP AMERICA RESIDENTIAL

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEVIEW TWIN / TRIPLE
SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)359-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

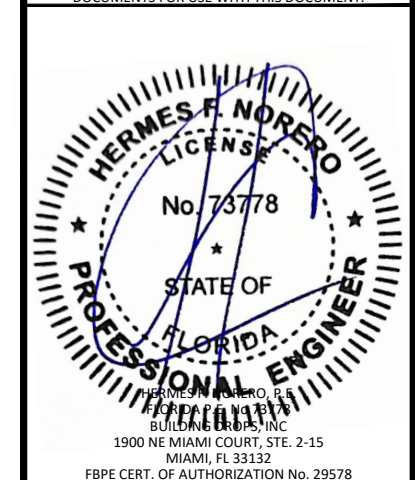

FL #:

FL8114

DATE: 01.31.18

DWG. BY:
RV

CHK. BY:
HFN

SCALE: NTS

DWG. #: YKK143

SHEET:

4

OF 4