

YKK AP AMERICA RESIDENTIAL

STYLEVIEW SINGLE HUNG WINDOW

(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED IN ORDER TO ACHIEVE A SQUARE AND PLUMB INSTALLATION WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **FIN INSTALLATION:** FOR INSTALLATION INTO WOOD FRAMING USE #8 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **FIN INSTALLATION:** FOR INSTALLATION INTO METAL STUD USE #8 SELF-DRILLING SCREWS THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

• FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

• CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
10. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

• AAMA/WDMA/CSA 101/I.S.2/A440-22
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: PVC
7. DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:

X: OPERABLE SASH

O: FIXED SASH
8. GLAZING SHALL MEET ASTM E1300 REQUIREMENTS, SEE SHEET 3 FOR GLAZING DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR SCHEDULE
3	VERTICAL SECTIONS & GLAZING DETAIL
4	HORIZONTAL SECTIONS

CONFIGURATION	DESIGN PRESSURE	MAX. FRAME SIZE	MAX. D.L.O.	MISSILE IMPACT RATING	INSTALLATION METHOD
O/X	+50 / -50 PSF	47.5" X 71.5"	41.38 " X 32.06"	NOT RATED	NAIL FIN
O/X	+50 / -50 PSF	35.5" X 75.5"	32.71" X 36.43"	NOT RATED	NAIL FIN
O/X	+35 / -35 PSF	47.5" X 71.5"	41.38 " X 32.06"	NOT RATED	NAIL FIN
O/X	+35 / -35 PSF	35.5" X 75.5"	29.34" X 34.06"	NOT RATED	NAIL FIN



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
INSTALLATION & GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26
9TH FBC CODE CHANGE	SH	08.04.26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.09 11:57 AM -0400'

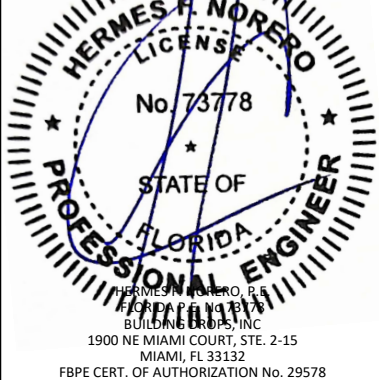

FL #:
FL8114

DATE:
06.17.20

DWG. BY:
NUS

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK123


SHEET:
1

REV.
D


OF 4

8/4/2026 6:38 PM

c:\users\sebastianherrerros\desktop\ykk res 2026 cc\fl8114\ykk123.dwg

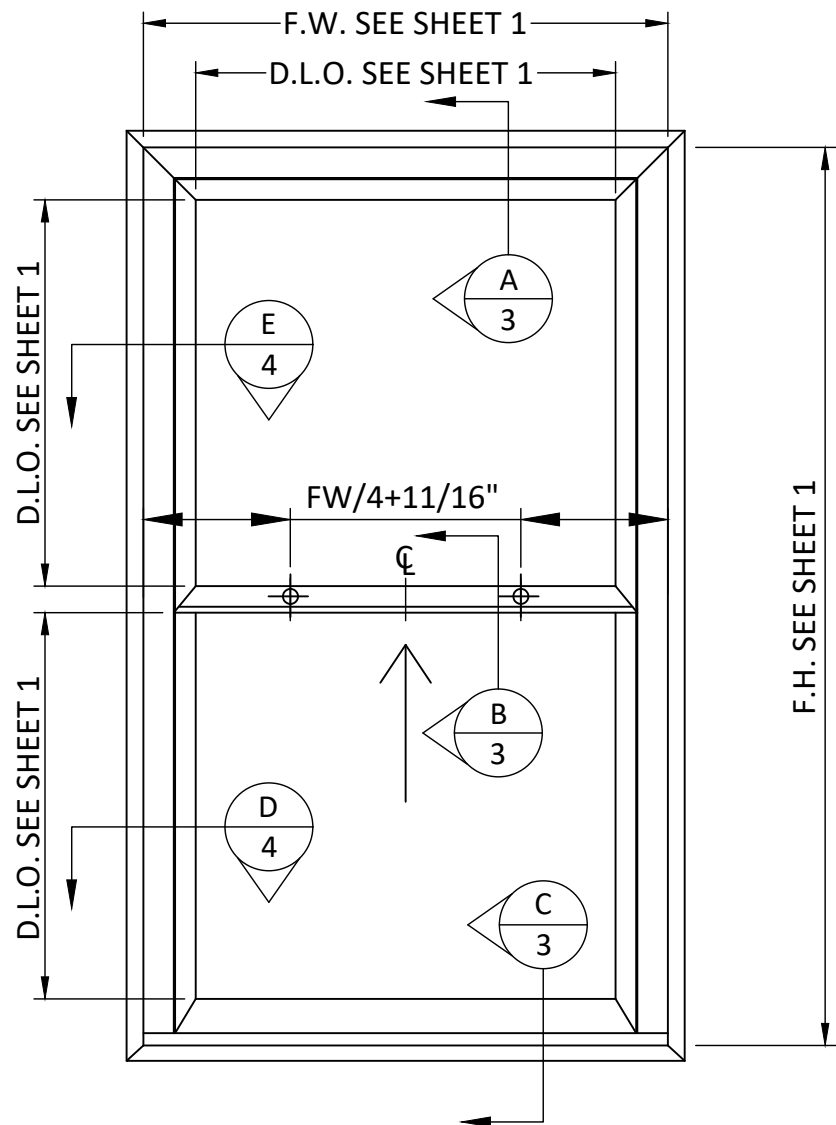

ELEVATION
NAIL FIN

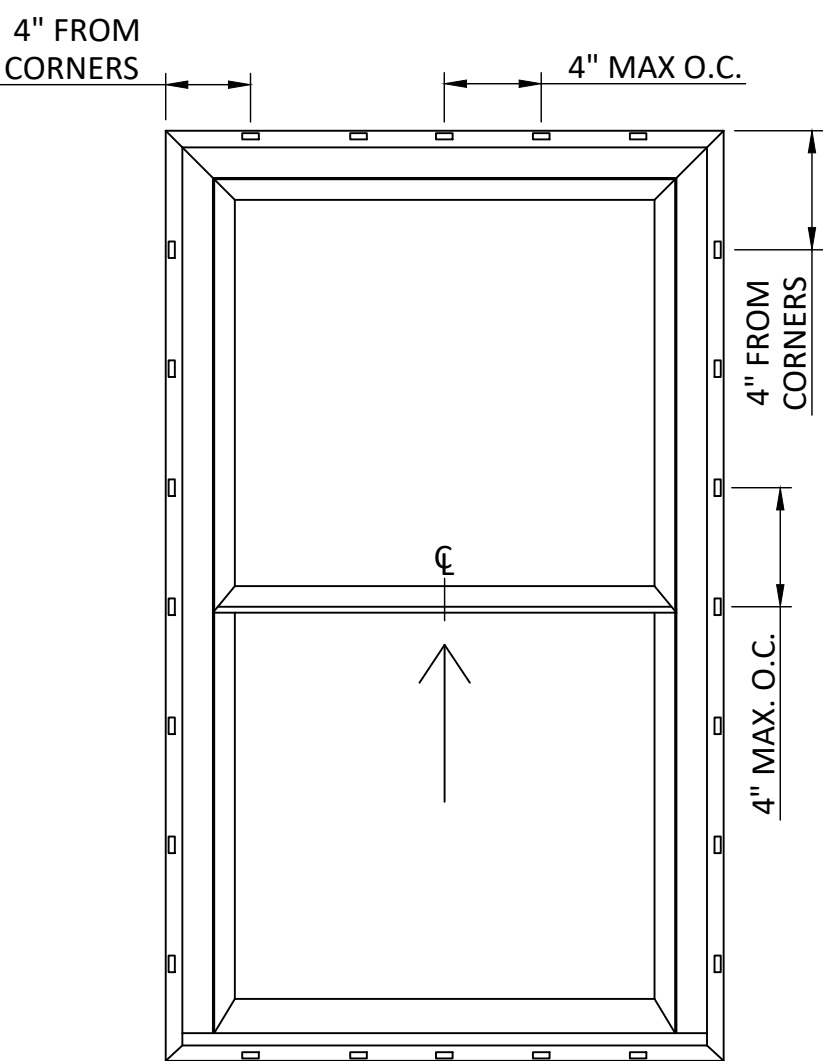

ANCHOR LAYOUT
NAIL FIN

⊕ -INDICATES LOCK LOCATION
FW<36" ONE LOCK (CENTER)
FW≥36" TWO LOCK (FW/4+11/16")

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	MIN. S.G. = 0.55 WOOD	#8 WOOD SCREW	1.50"	0.75"
	18 GAUGE STEEL, MIN f _y = 33 ksi	#8 SELF-DRILLING SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"

YKK

ap

Quality
inspires™

YKK AP AMERICA RESIDENTIAL

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:

STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
ELEVATION & ANCHOR SCHEDULE

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26
9TH FBC CODE CHANGE	SH	08.04.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL8114

DATE:

06.17.20

DWG. BY:

NUS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

YKK123

SHEET:

2


REV.

D

OF 4

c:\users\sebastianhereros\desktop\ykk_res 2026 cc\18114\ykk123.dwg 8/4/2026 6:38 PM


NAIL FIN

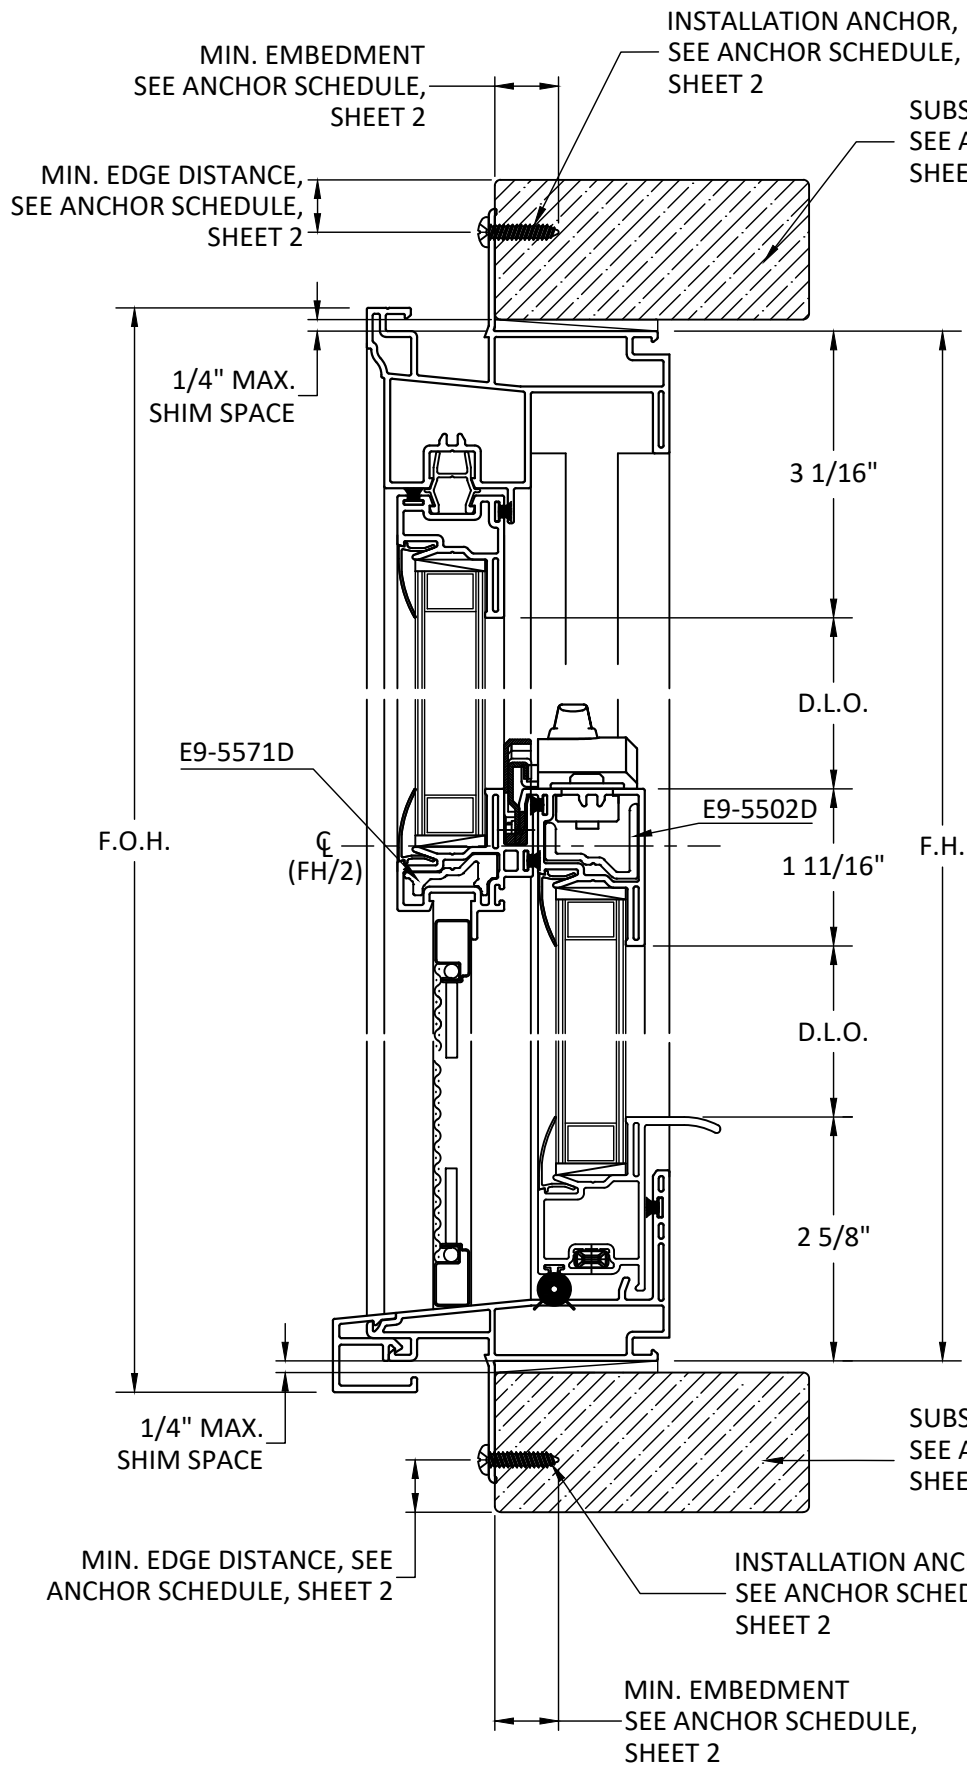

A
3 **VERTICAL SECTION**
FIXED HEAD
NAIL FIN

B
3 **VERTICAL SECTION**
INTERLOCK RAIL

C
3 **VERTICAL SECTION**
SASH SILL
NAIL FIN

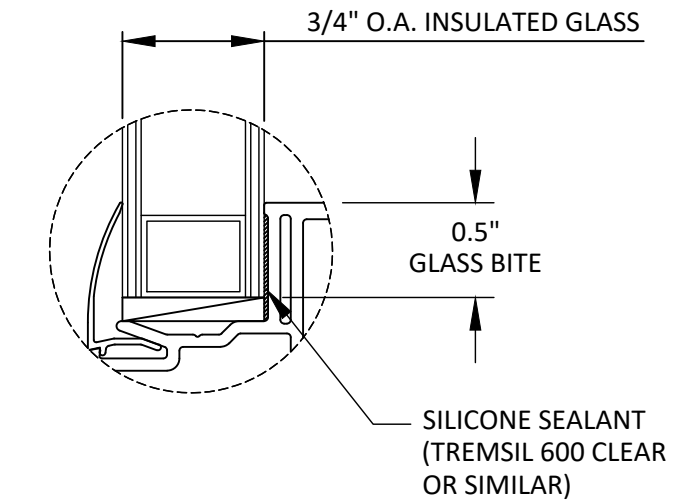

GLAZING DETAIL

GLAZING NOTES:

1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS STRENGTH REQUIREMENTS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCK TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" PER FBC CHAPTER 24.
4. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.

INTERCEPT STAINLESS STEEL OR TIN PLATED SPACER:
AROUND THE PERIMETER OF THE GLASS

PRIMARY SEALANT:
POLYISOBUTYLENE (PIB)

SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000


TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
NAIL FIN VERTICAL SECTIONS
& GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26
9TH FBC CODE CHANGE	SH	08.04.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

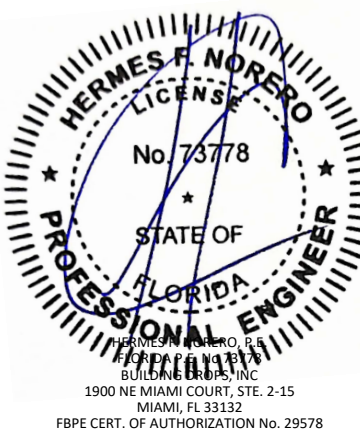


FL #:	FL8114
DATE:	06.17.20
DWG. BY:	NUS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK123
SHEET:	3
REV.	D
OF 4	

c:\users\sebastianherrerros\desktop\ykk res 2026 cc\8114\ykk123.dwg 8/4/2026 6:38 PM

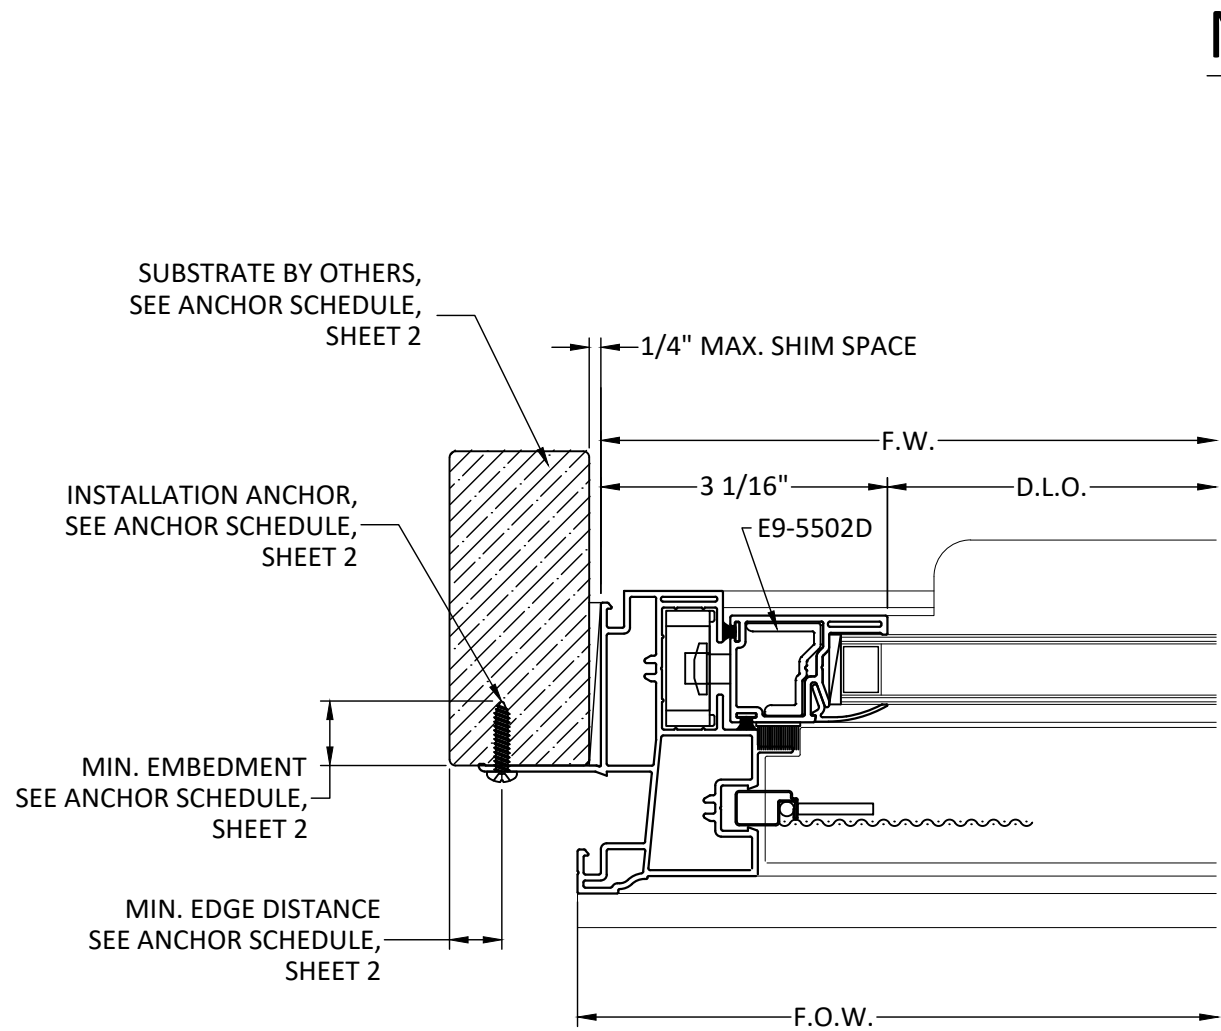

D
4 **HORIZONTAL SECTION**
SASH JAMB
NAIL FIN

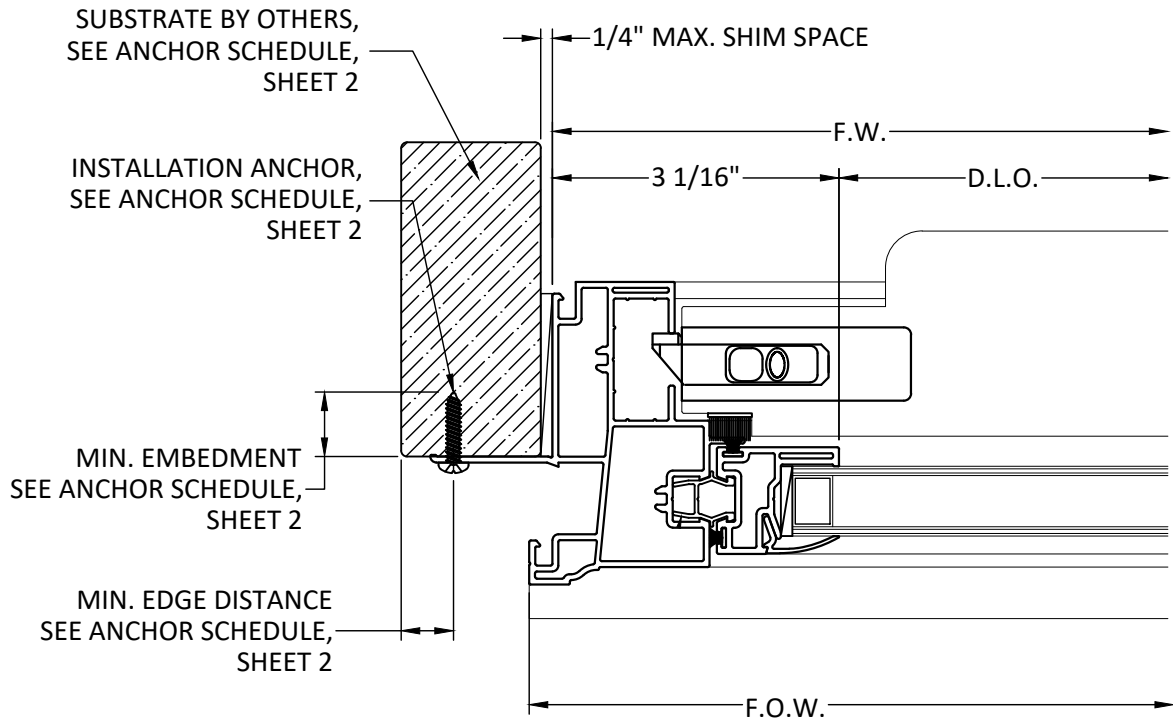

E
4 **HORIZONTAL SECTION**
FIXED JAMB
NAIL FIN

YKK
ap

Quality
inspires™

YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEVIEW SINGLE HUNG WINDOW
(NON-HVHZ) (NON-IMPACT)
NAIL FIN
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
FBC CODE CHANGE	FB	09.07.23
SASH CHANGE	SH	10.03.24
REINFORCEMENT REV.	LS	05.27.26
9TH FBC CODE CHANGE	SH	08.04.26
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		

HERMES F. NORERO

LICENSE

No. 73778

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.

YKK AP AMERICA, INC.

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

FBPE CERT. OF AUTHORIZATION No. 29578

FL #:		FL8114	
DATE:		06.17.20	
DWG. BY:	CHK. BY:	NUS	HFN
SCALE:		NTS	
DWG. #:		YKK123	
SHEET:		4	REV. D
OF 4			