


MODEL DESIGNATION: Simonton Fixed Panel Series 15–16 Vinyl Window

MAXIMUM OVERALL NOMINAL SIZE: See Size Chart

DESIGN PRESSURE RATING: See Size Chart


USABLE CONFIGURATIONS: 0

GENERAL DESCRIPTION: The head, sill, and side jambs are extruded PVC. The wall thickness through which the anchor screw penetrates is a minimum of 0.070".

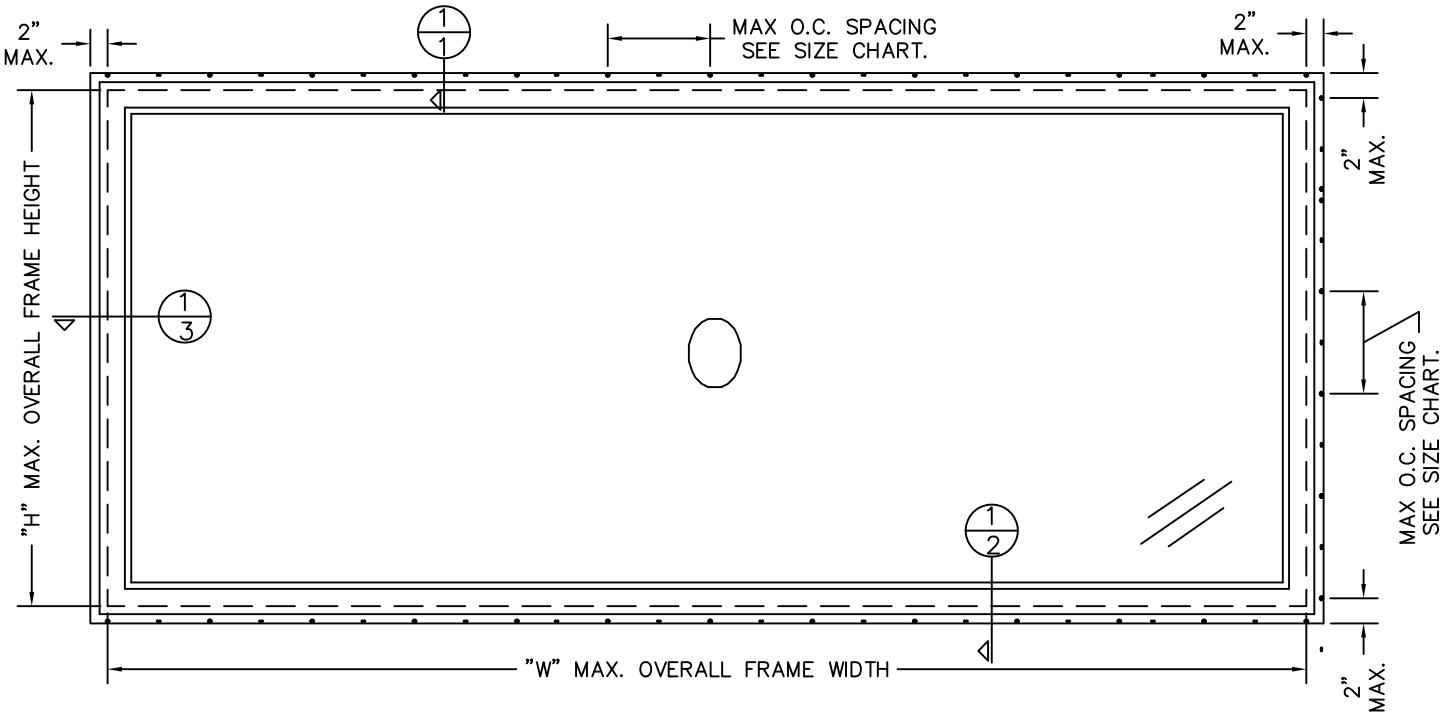

SIZE CHART			
OVERALL SIZE		O.C. SPACING	DP RATING
WIDTH "W"	HEIGHT "H"		
107"	47"	9"	±50 PSF

NO P.E. SEAL REQUIRED
INSTALLATION SUPPORTED
BY AAMA TEST REPORTS

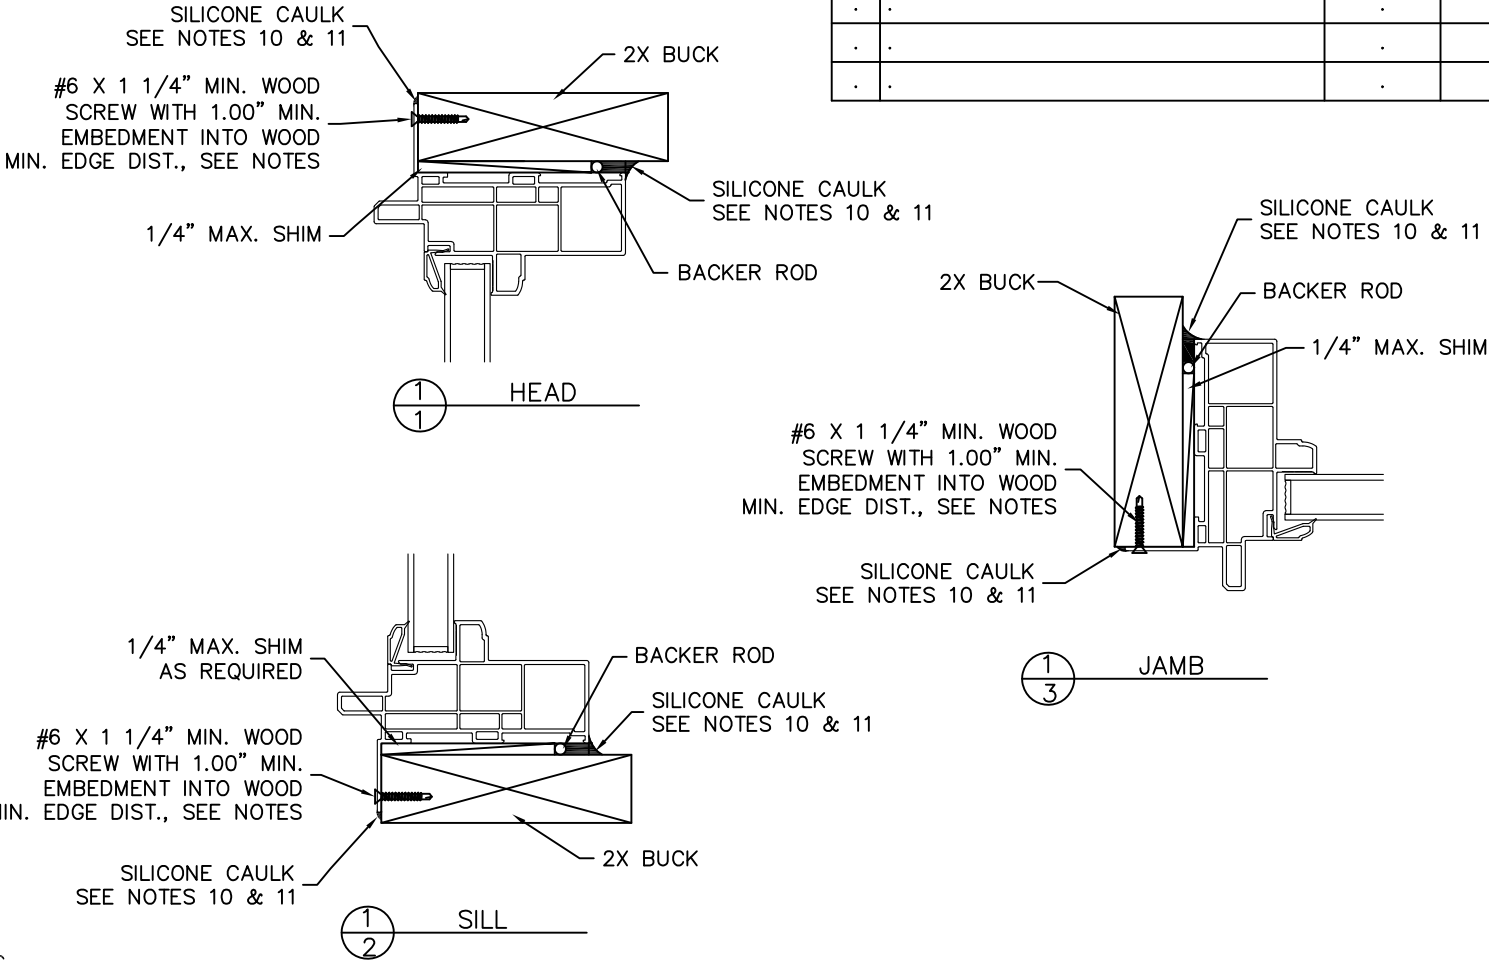

- NOTES:**
- THIS INSTALLATION HAS BEEN EVALUATED FOR USE IN LOCATIONS ADHERING TO THE TEXAS & FLORIDA BUILDING CODES AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7 MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES DO NOT EXCEED THE DESIGN PRESSURE RATINGS HEREIN, FOR USE OUTSIDE THE H.V.H.Z.
 - ALL EXTERIOR PERIMETER SURFACES OF THE WINDOW MUST BE CAULKED. INTERIOR CAULKING IS OPTIONAL UNLESS NOTED OTHERWISE.
 - ANCHORS SHALL BE AS SPECIFIED AND SPACED AS SHOWN. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO AND INTO WOOD.
 - THE RESPONSIBILITY FOR SELECTION OF SIMONTON PRODUCTS TO MEET ANY APPLICABLE LOCAL LAWS, BUILDING CODES, ORDINANCES, OR OTHER SAFETY REQUIREMENTS RESTS SOLELY WITH THE ARCHITECT, BUILDING OWNER, OR CONTRACTOR.
 - SHIMS ARE OPTIONAL. MAX. SHIM STACK IS 1/4".
 - WOOD BUCKS (BY OTHERS) MUST BE ENGINEERED AND ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
 - WHEN USED IN AREAS REQUIRING IMPACT PROTECTION THIS PRODUCT REQUIRES THE USE OF APPROVED IMPACT RESISTANT SHUTTERS OR OTHER EXTERNAL PROTECTION.
 - FLASHING SHOULD BE APPLIED USING THE ASTM E 2112 METHODOLOGY APPROPRIATE FOR THE OPENING INTO WHICH THE WINDOW IS BEING INSTALLED.
 - INSTALLATION SCREWS MUST BE AT LEAST 1/2" FROM THE EDGE OF THE WOOD.
 - DESIGNATION "X" IS FOR OPERABLE PANEL AND "O" IS FOR FIXED PANEL
 - CAULK APPLICATION: RECOMMENDED AIR AND SURFACE TEMPERATURES AT THE TIME OF APPLICATION ARE TO BE BETWEEN 40 AND 90 DEGREES F. INSURE ALL CONTACT SURFACES ARE CLEAN AND DRY INCLUDING THE NEW WINDOW(S). USE A BACKER ROD ON ALL JOINTS >3/4" DEEP AND/OR WIDER THAN 1/4". FINISHED CAULK JOINT SHOULD BE A MINIMUM OF 3/8" DEEP AND MAKE FULL CONTACT WITH BOTH THE NEW WINDOW AND STRUCTURAL OPENING SURFACES. SILICONE CAULK SHOULD BE FORCED INTO JOINT OR COMPRESSED TO ASSURE FULL CONTACT ON BOTH SURFACES AND TO EXPEL ANY AIR POCKETS.

REV. #:	REVISIONS:	REVISED BY:	DATE:
1	ADDED NOTES 10 AND 11.	LMH	11/20/15
2	UPDATED TO CURRENT FBC.	KKB	06/27/24
.	.	.	.
.	.	.	.
.	.	.	.

DISCLOSURE STATEMENT This document is the property of Simonton Windows, which retains all proprietary and other rights to its subject matter. This document is provided to the recipient on the expressed condition that it is not to be disclosed, reproduced in whole or part, nor used in conjunction with the design, manufacture or repair of goods for anyone other than Simonton Windows without its consent. This restriction does not limit the recipient's rights to utilize information contained in this document which is properly obtained from another source. FILE: FL 8500		MATERIAL: RMS FINISH: EXCEPT AS NOTED ALLOY & TEMPER: WEIGHT: VOLUME: SURFACE AREA: PERIMETER: FINISH TREATMENT:		Dimensional Tolerances Unless Otherwise Specified Decimals Angles .X ± .03 .XX ± .01 .XXX ± .005 0° 30 min.		SIMONTON® W I N D O W S 1 Cochrane Avenue Pennsboro, WV 26415 SIZE: DRAWING NO.: B IN0574 REV.: 2 DRAWN BY: LMH DATE: 07/29/15 CHECKED BY: DATE: SCALE: FIT SHEET: 1 of 1 APPR'VD BY: DATE: SERIES: 15–16 FIXED PANEL TITLE: 2X BUCK INSTALLATION	
--	--	---	--	---	--	---	--