

7/24/2026 9:00 AM
c:\users\sebastianherrerros\desktop\Ykk 2026 ca\18753\Ykk232.dwg

YKK AP America Inc.

YSD 400 SLIDING GLASS DOOR

(HVHZ) (NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-22
 - TAS 202-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT. DOCUMENTS SHALL BE APPROVED BY AUTHORITY HAVING JURISDICTION (AHJ)
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: ALUMINUM 6063-T5
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

	TABLE OF CONTENTS
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & TABLE OF CONTENTS
2	ELEVATION & GLAZING DETAIL
3	ELEVATION
4	VERTICAL SECTIONS & ANCHOR SCHEDULE
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS & BILL OF MATERIALS
7	COMPONENTS

DESIGN PRESSURE TABLE	
MAX. DP	IMPACT RATING
SEE SHEET 2	NON-IMPACT



Quality
inspires™

YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)
GENERAL NOTES &
TABLE OF CONTENTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.06.01 14:40:21 -0400

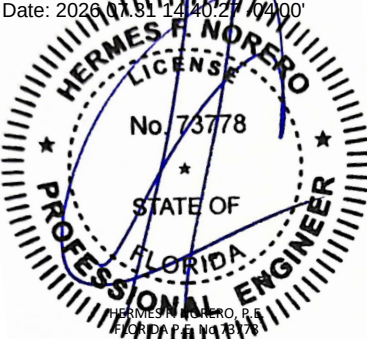

HERMES F. NORERO, P.E.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL8753

DATE: **06.06.16**

DWG. BY:
MSS

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **YKK232**


SHEET:
1

REV.
A

OF 7

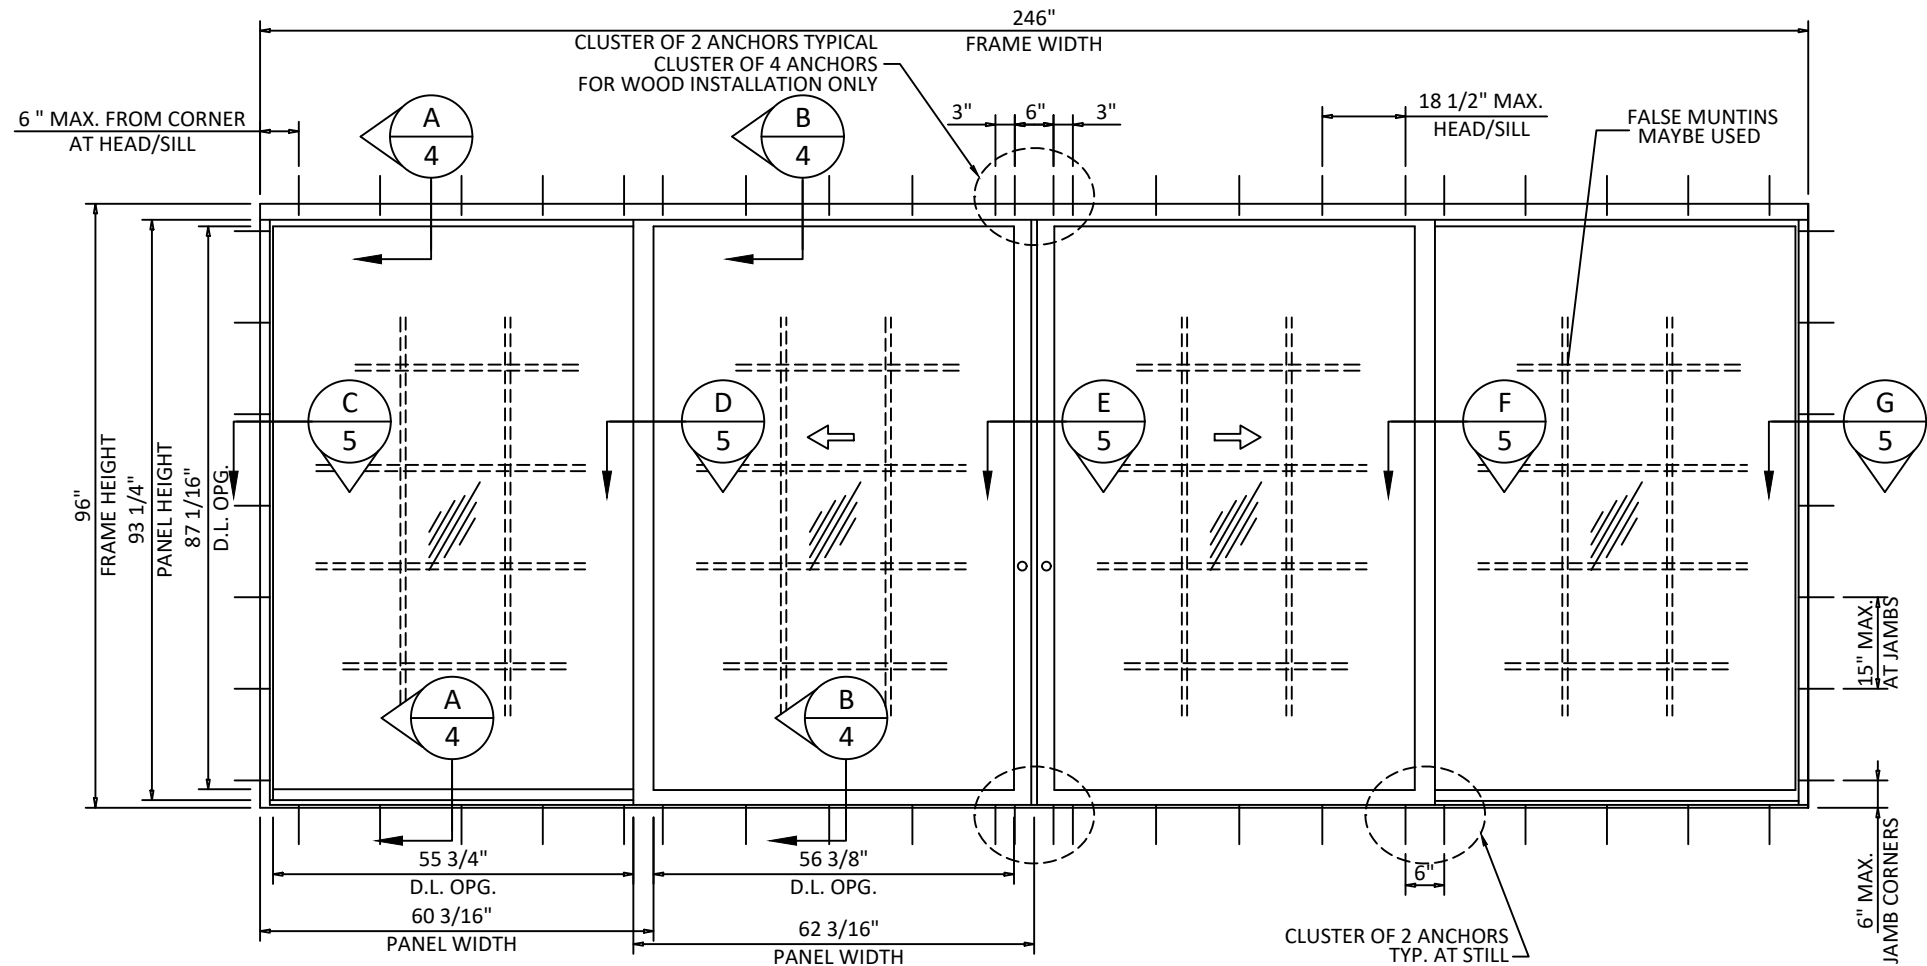

TYPICAL ELEVATION
FOR OXXO

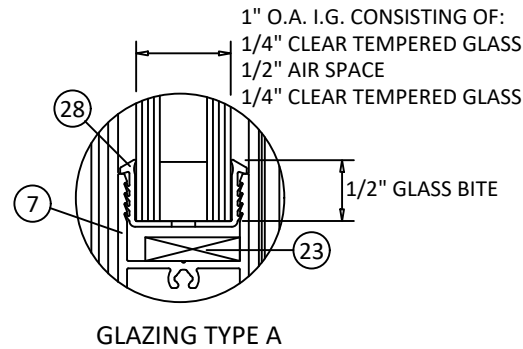

- NOTES:
- GLASS COMPLIES WITH ASTM E 1300 GLASS CHART REQUIREMENTS.
 - ALL GLAZING CONFIGURATIONS COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN THE FBC.
 - ALL LITES GREATER THAN 36" IN WIDTH SHALL UTILIZE SETTING BLOCKS IN ACCORDANCE WITH THE FBC.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.

- 1/2" AIR SPACE CONSISTING OF:
- SPACER: ALUMINUM BOX SPACER
 - PRIMARY SEALANT: POLYISOBUTYLENE (PIB)
 - SECONDARY SEALANT: STRUCTURAL SILICONE INTENDED FOR FABRICATION ON INSULATED GLASS UNITS.

DESIGN PRESSURE TABLE			
Door Panel Widths are Average (O.A. Width/# of Panels)			
Width (in.)	Height (in.)	Positive Design Pressure (PSF)	Negative Design Pressure
28	80	100.0	108.6
32		98.0	98.0
36		89.9	89.9
40		83.6	83.6
44		78.6	78.6
48		74.6	74.6
52		71.5	71.5
56		68.9	68.9
60		66.9	66.9
61.5		66.2	66.2
28	84	100.0	107.5
32		96.8	96.8
36		88.7	88.7
40		82.3	82.3
44		77.2	77.2
48		73.2	73.2
52		69.9	69.9
56		67.2	67.2
60		65.0	65.0
61.5		64.3	64.3
28	90	100.0	106.1
32		95.3	95.3
36		87.1	87.1
40		80.6	80.6
44		75.4	75.4
48		71.3	71.3
52		67.8	67.8
56		65.0	65.0
60		62.7	62.7
61.5		61.9	61.9
28	96	100.0	104.9
32		94.1	94.1
36		85.7	85.7
40		79.2	79.2
44		73.9	73.9
48		69.7	69.7
52		66.1	66.1
56		63.2	63.2
60		60.8	60.8
61.5		60.0	60.0

YKK

ap

Quality
inspires™

YKK AP America Inc

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303

PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)
ELEVATION & GLAZING DETAIL

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL8753

DATE:
06.06.16

DWG. BY:
MSS

CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK232

SHEET:
2

REV.
A

OF 7

7/24/2026 9:00 AM

c:\users\sebastianherrerros\desktop\ykk 2026 ca\18753\ykk232.dwg



YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)


ELEVATION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

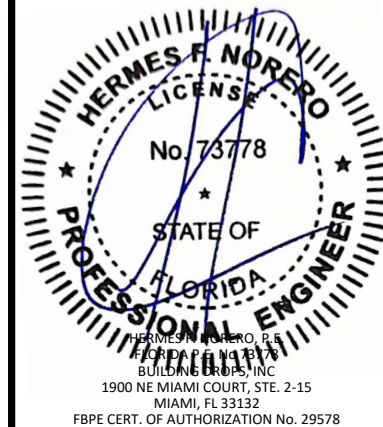

FL #:

FL8753

DATE: 06.06.16

DWG. BY:
MSS

CHK. BY:
HFN

SCALE: NTS

DWG. #: YKK232


SHEET:

3


REV.

A

OF 7

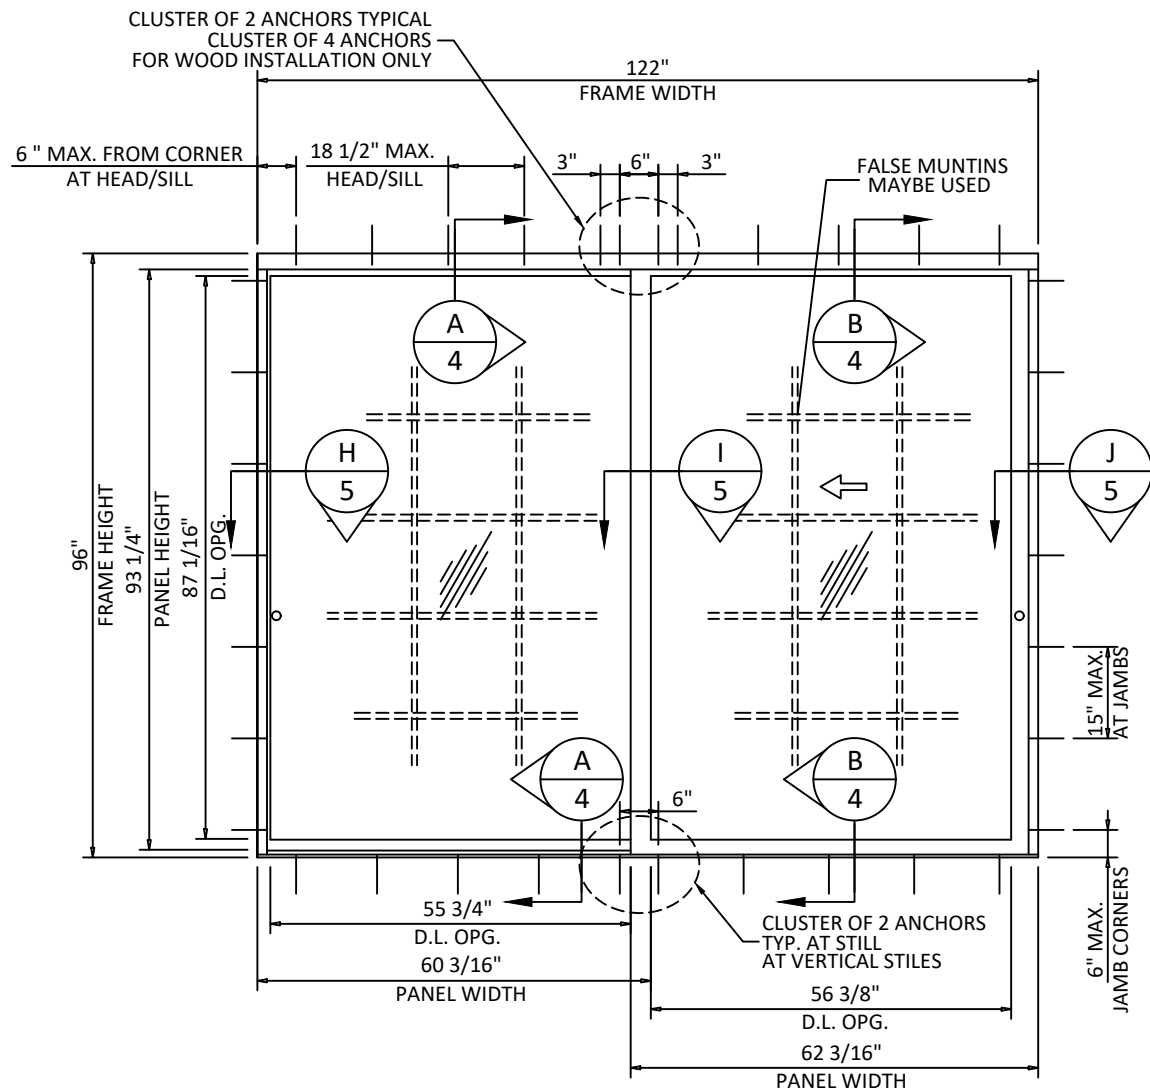


TYPICAL ELEVATION
FOR OX/XO

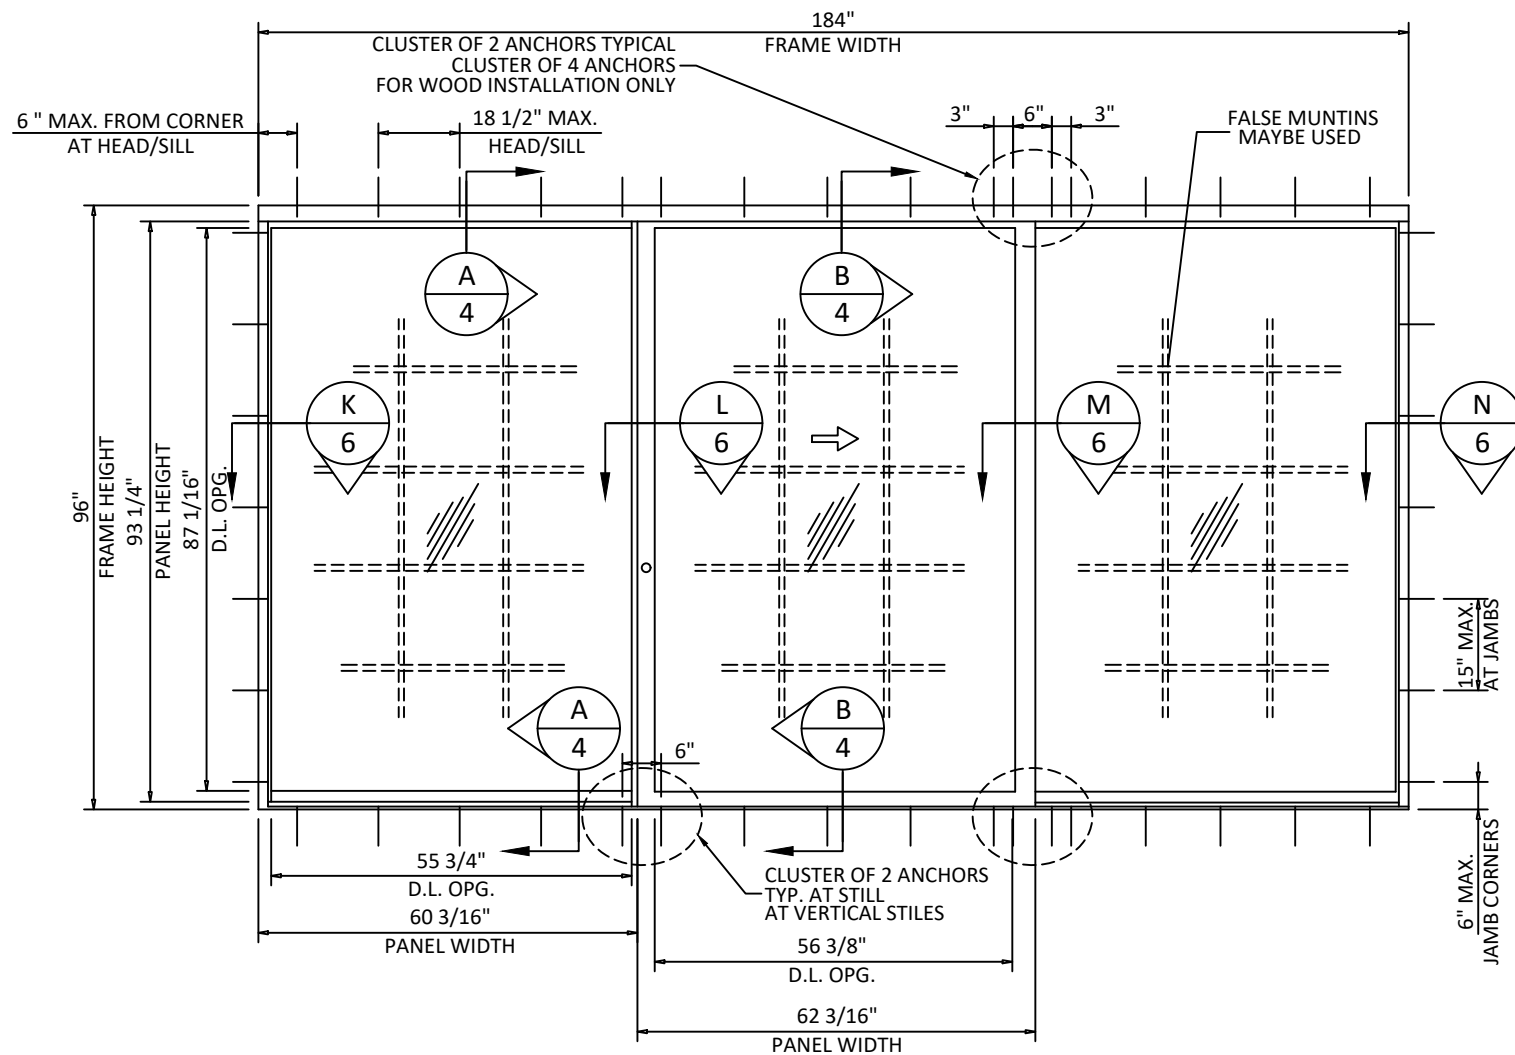

TYPICAL ELEVATION
FOR OXO

7/24/2026 9:00 AM

c:\users\sebastianhereros\desktop\ykk 2026 cc\18753\ykk232.dwg

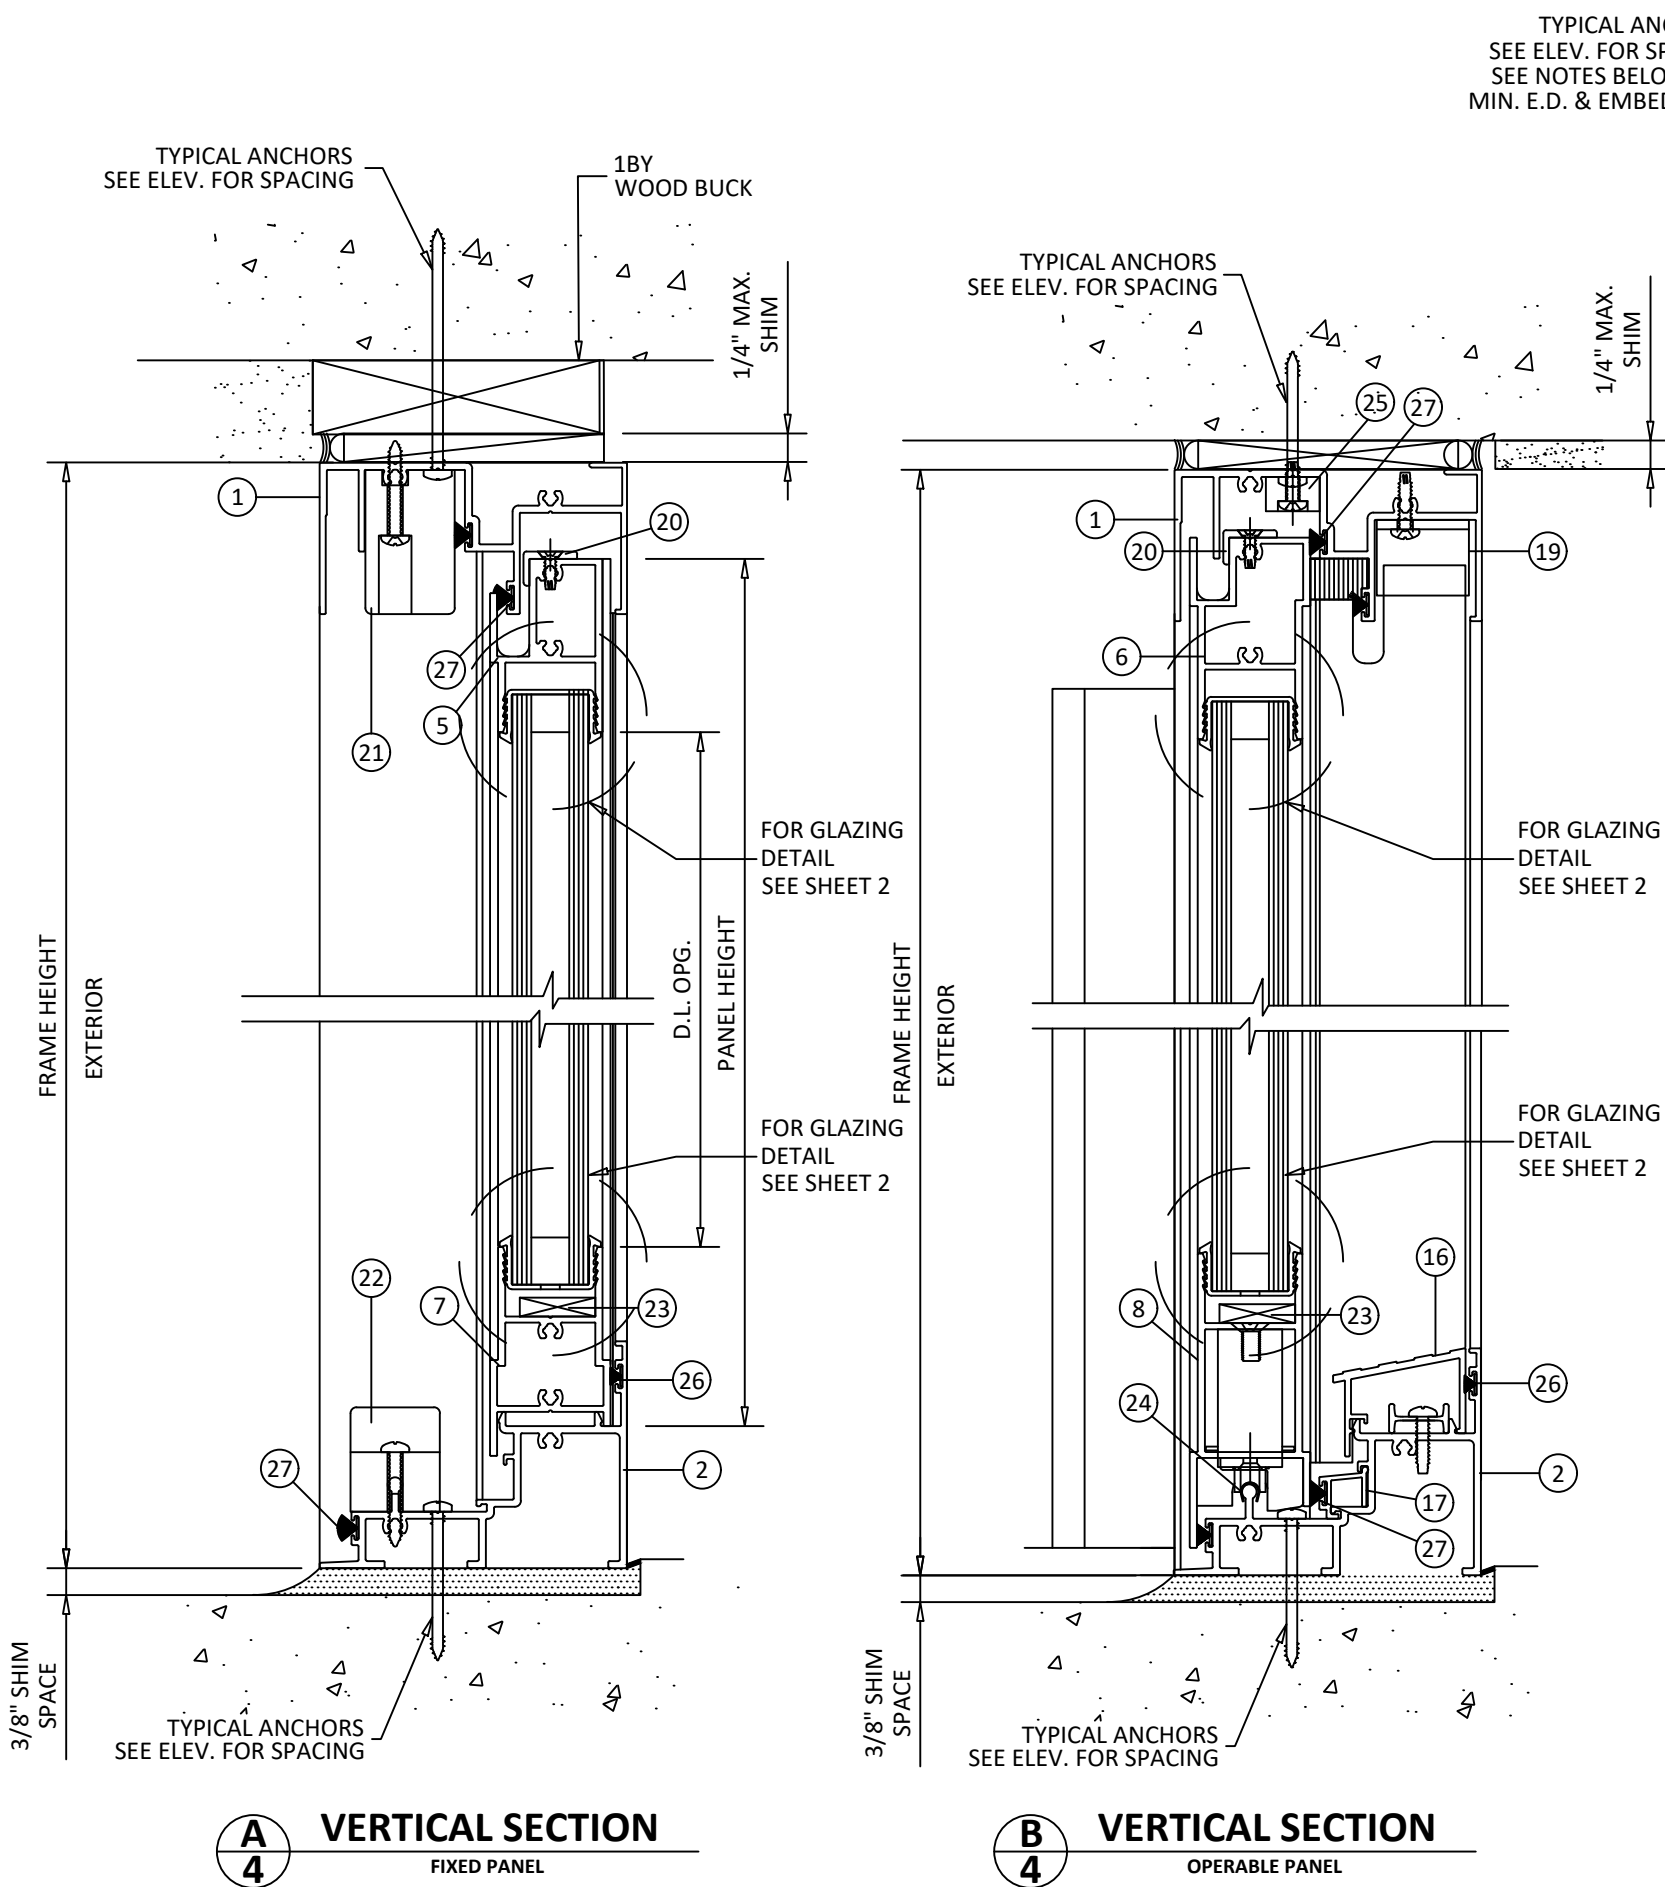

TYPICAL ANCHORS
SEE ELEV. FOR SPACING
SEE NOTES BELOW FOR
MIN. E.D. & EMBEDMENT.

TYPICAL ANCHORS
SEE ELEV. FOR SPACING
SEE NOTES BELOW FOR
MIN. E.D. & EMBEDMENT.

F.B.C. APPR'D MULLION
SEE SEPARATE APPROVAL

METAL
STRUCTURE

TYPICAL ANCHORS
SEE ELEV. FOR SPACING
SEE NOTES BELOW FOR
MIN. E.D. & EMBEDMENT.

2BY WOOD BUCK
OR
WOOD STRUCTURE

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

#14 WOOD SCREW

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES (MIN. S.G. = 0.55)
1-1/2" MIN. PENETRATION INTO WOOD

1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy= 92 KSI)
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-3/4" MIN. EMBED INTO CONC. OR MASONRY

1/4" DIA. SMS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS (MIN. THK. = .090")
(NO SHIM SPACE)
INTO METAL STRUCTURES
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-5/8" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE f'c = 3000 PSI MIN.
C-90 FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANTS:

FRAME AND PANEL CORNERS SEALED WITH
TREMCO SPECTREM 2 OR G.E. SILGLAZE OR
TREMCO TREMSIL 600 SEALANT.



YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001


TITLE: YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)
VERTICAL SECTIONS
AND ANCHOR SCHEDULE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

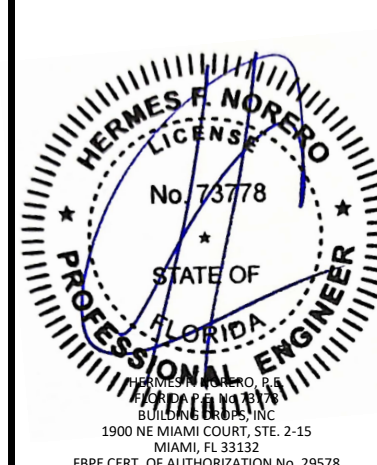

FL #:	FL8753
DATE:	06.06.16
DWG. BY:	MSS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK232
SHEET:	4
REV.	A

7/24/2026 9:00 AM


c:\users\sebastianherrerros\desktop\ykk 2026 cc\18753\ykk232.dwg

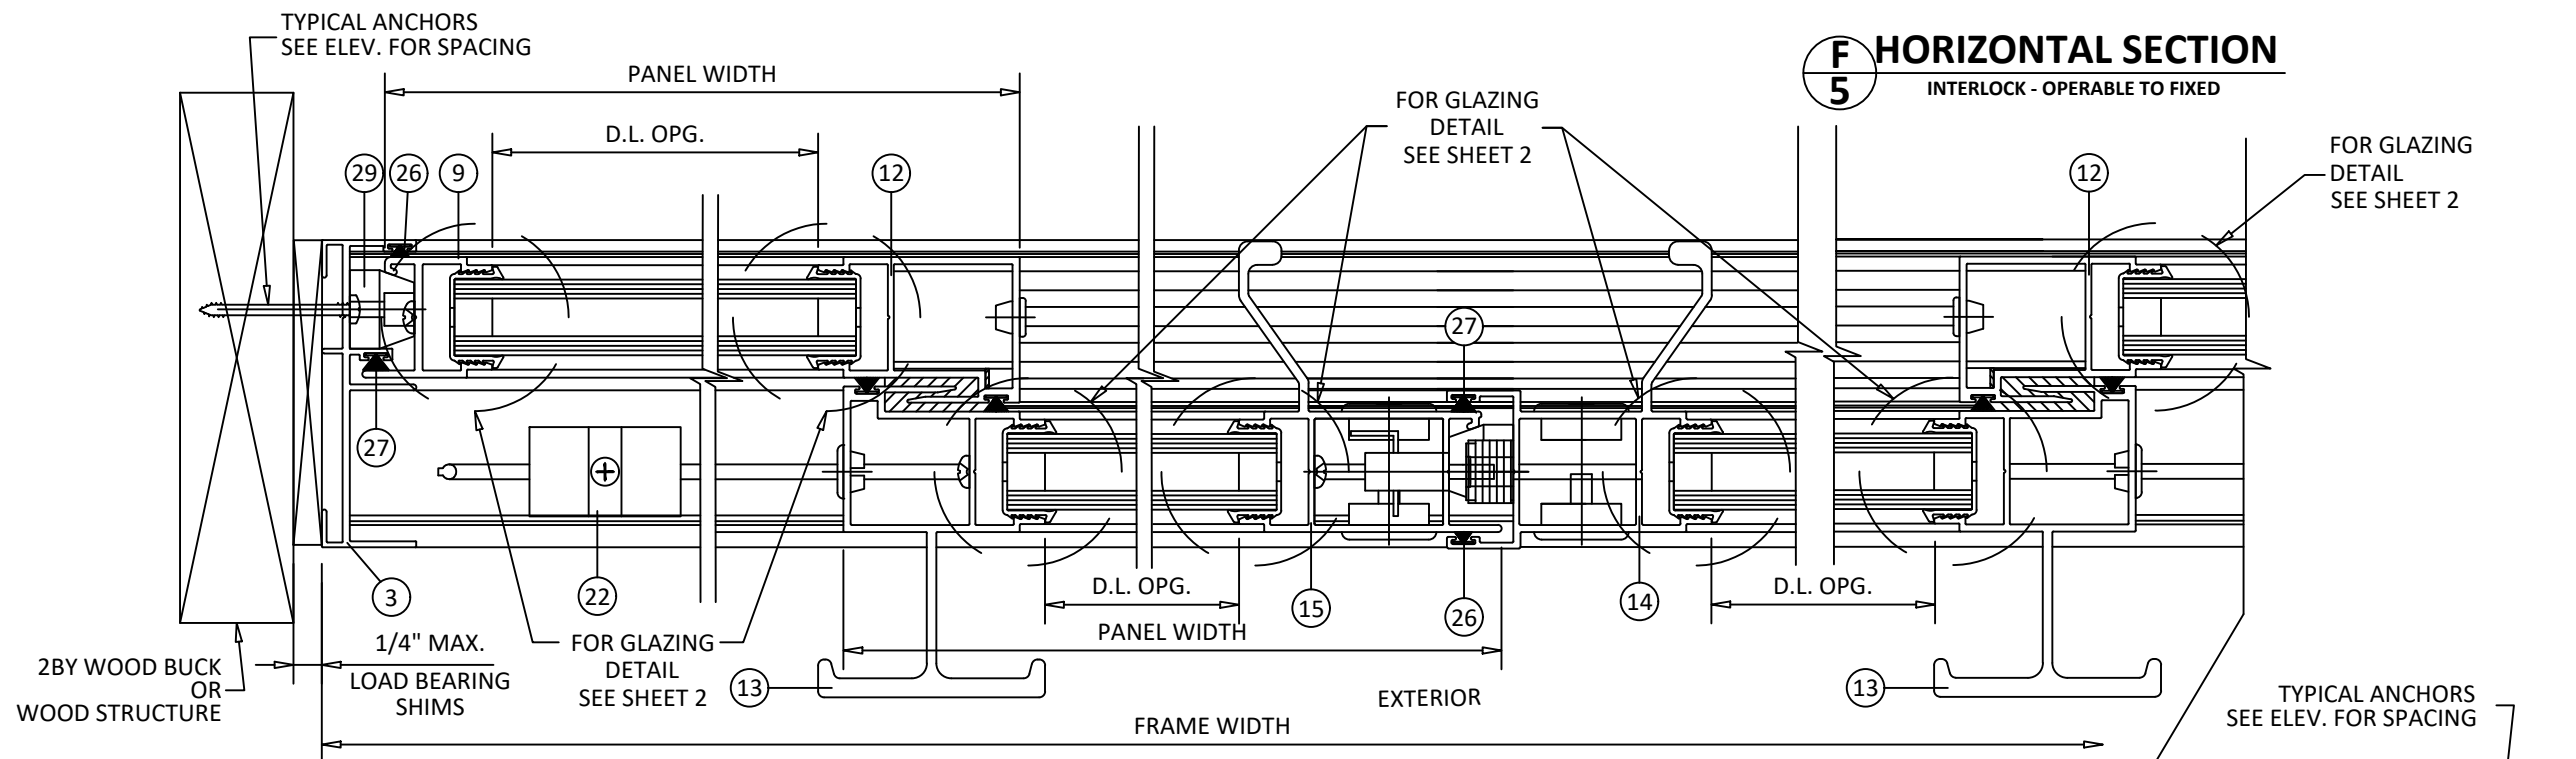

C **HORIZONTAL SECTION**
5 JAMB - THROUGH FRAME
FIXED PANEL

D **HORIZONTAL SECTION**
5 INTERLOCK - FIXED TO OPERABLE


E **HORIZONTAL SECTION**
5 MEETING STILE

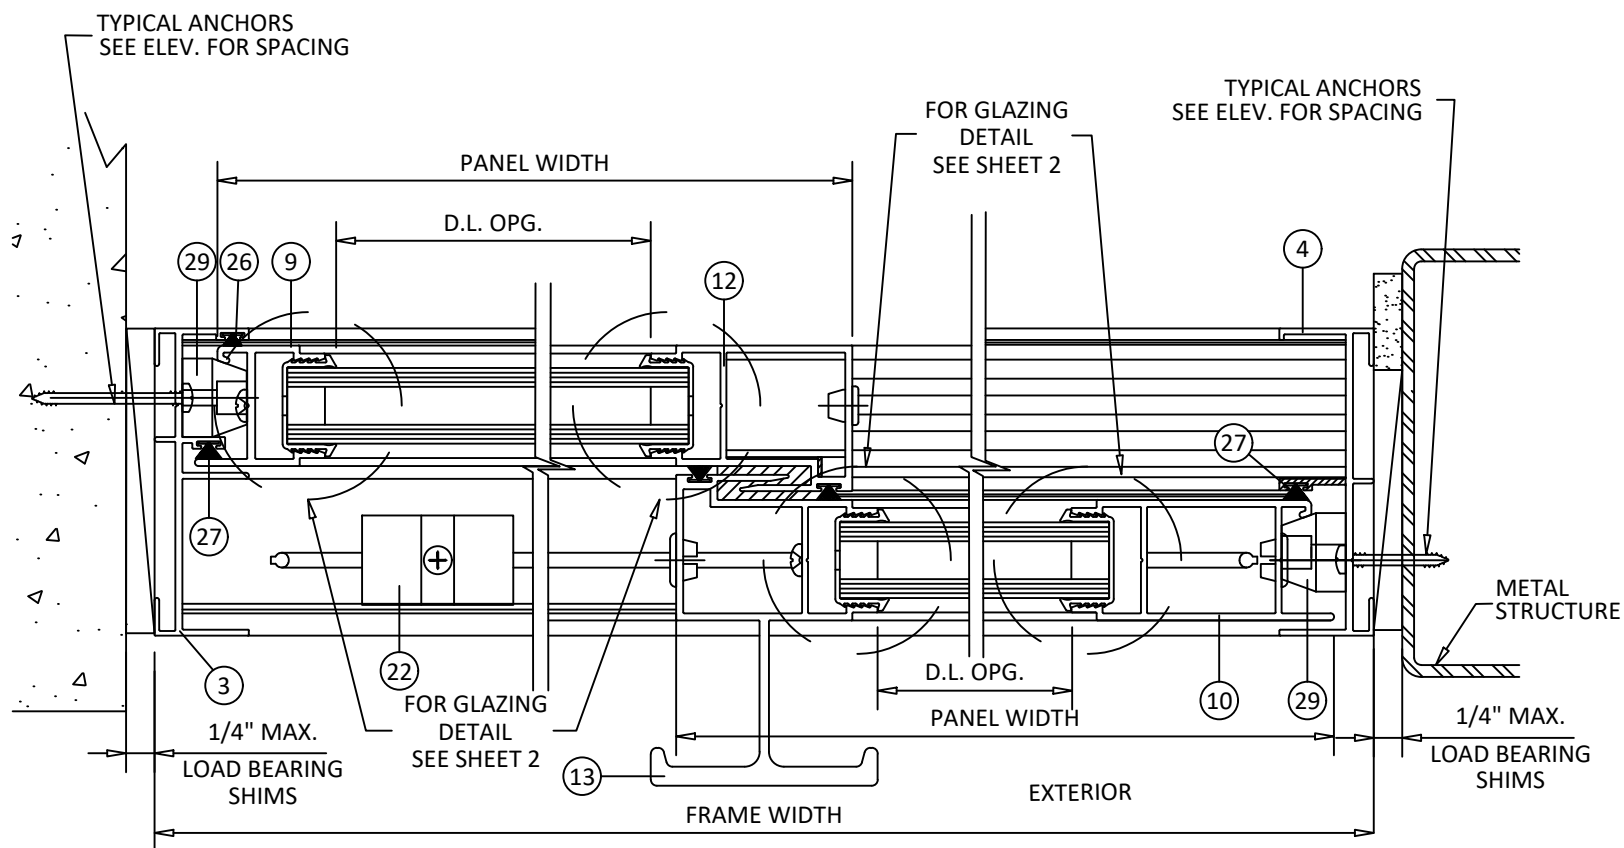

H **HORIZONTAL SECTION**
5 JAMB - THROUGH FRAME
FIXED FRAME

I **HORIZONTAL SECTION**
5 INNERLOCK - FIXED TO OPERABLE

J **HORIZONTAL SECTION**
5 JAMB - THROUGH FRAME
OPERABLE PANEL

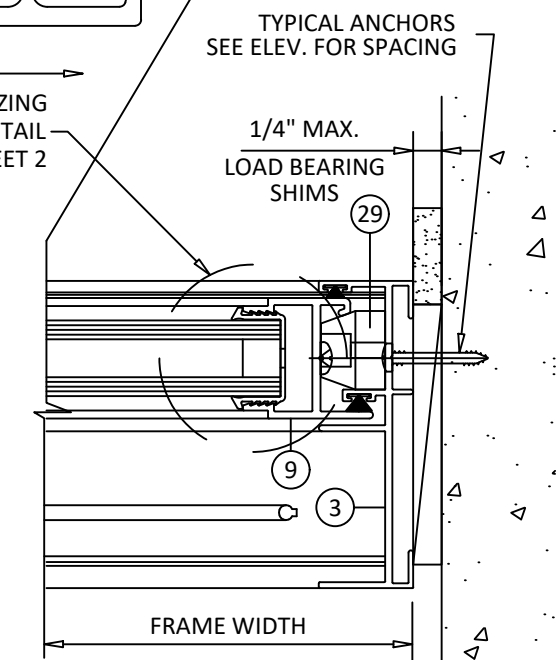

G **HORIZONTAL SECTION**
5 JAMB - THROUGH FRAME
FIXED PANEL



YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

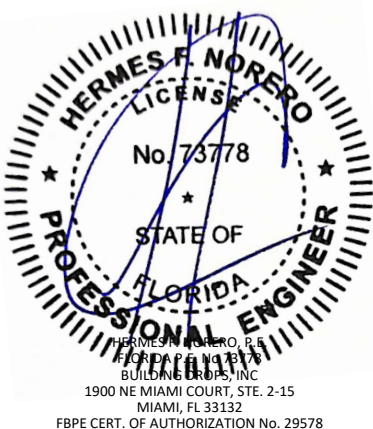

FL #:

FL8753

DATE: 06.06.16

DWG. BY: MSS
CHK. BY: HFN

SCALE: NTS

DWG. #: YKK232


SHEET: 5

REV. A

7/24/2026 9:00 AM

c:\users\sebastianherrerros\desktop\Ykk 2026 ca\18753\Ykk232.dwg

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E9-6001	1	FRAME HEAD	6063-T5	YKK AP AMERICA
2	E9-6002	1	FRAME SILL	6063-T5	YKK AP AMERICA
3	E9-6004	1	FRAME JAMB (FIXED)	6063-T5	YKK AP AMERICA
4	E9-6005	1	FRAME JAMB (OPERABLE)	6063-T5	YKK AP AMERICA
5	E9-6009	1/ PANEL	TOP RAIL(FIXED)	6063-T5	YKK AP AMERICA
6	E9-6008	1/ PANEL	TOP RAIL(OPERABLE)	6063-T5	YKK AP AMERICA
7	E9-6011	1/ PANEL	BOTTOM RAIL (FIXED)	6063-T5	YKK AP AMERICA
8	E9-6010	1/ PANEL	BOTTOM RAIL (OPERABLE)	6063-T5	YKK AP AMERICA
9	E9-6014	1	JAMB STILE (FIXED)	6063-T5	YKK AP AMERICA
10	E9-6013	1	JAMB STILE (OPERABLE)	6063-T5	YKK AP AMERICA
11	E9-6021	1	ASTRAGAL STILE	6063-T5	YKK AP AMERICA
12	E9-6015	1	INTERLOCK (FIXED)	6063-T5	YKK AP AMERICA
13	E9-6016	AS REQD.	INTERLOCK (OPERABLE)	6063-T5	YKK AP AMERICA
14	E9-6020	1	FEMALE LOCK STILE	6063-T5	YKK AP AMERICA
15	E9-6019	1	MALE LOCK STILE	6063-T5	YKK AP AMERICA
16	E9-6007	1	THRESHOLD	6063-T5	YKK AP AMERICA
17	E9-6006	1	WEATHERSEAL SILL ATTACHMENT	6063-T5	YKK AP AMERICA
18	-	-	-	-	-
19	E1-1604	2/ MOV. PANEL	MOV. PANEL BLOCK	6063-T5	SECURED W/ (2) #8 X 1/2" PH TS
20	E3-1161	1/ MOV. PANEL	PANEL GUIDE	POLYAMIDE 6	SECURED W/ #8 X 1/2" PH TS
21	E2-0708	1/ MOV. PANEL	HEAD BUMPER	EPDM	SECURED W/ #10 X 1/4" PH TS
22	E2-0709	1/ MOV. PANEL	SILL BUMPER	EPDM	SECURED W/ #10 X 1/4" PH TS
23	E2-0704	AS REQD.	SETTING BLOCK	EPDM	-
24	E1-1601	1	SILL TRACK COVER	ST.STEEL	-
25	E3-1162	2/ MOV. PANEL	FIX. PANEL STOP	POLYAMIDE 6	SECURED W/ (2) #8 X 1/2" PH TS
26	E2-0711	AS REQD.	PILE W' STRIPPING WITH FIN	-	-
27	E2-0723	AS REQD.	PILE W' STRIPPING WITH FIN	-	-
28	E2-0703	AS REQD.	GLAZING GASKET	-	-
29	E2-0705	AS REQD.	AT BLOCK	EPDM	-

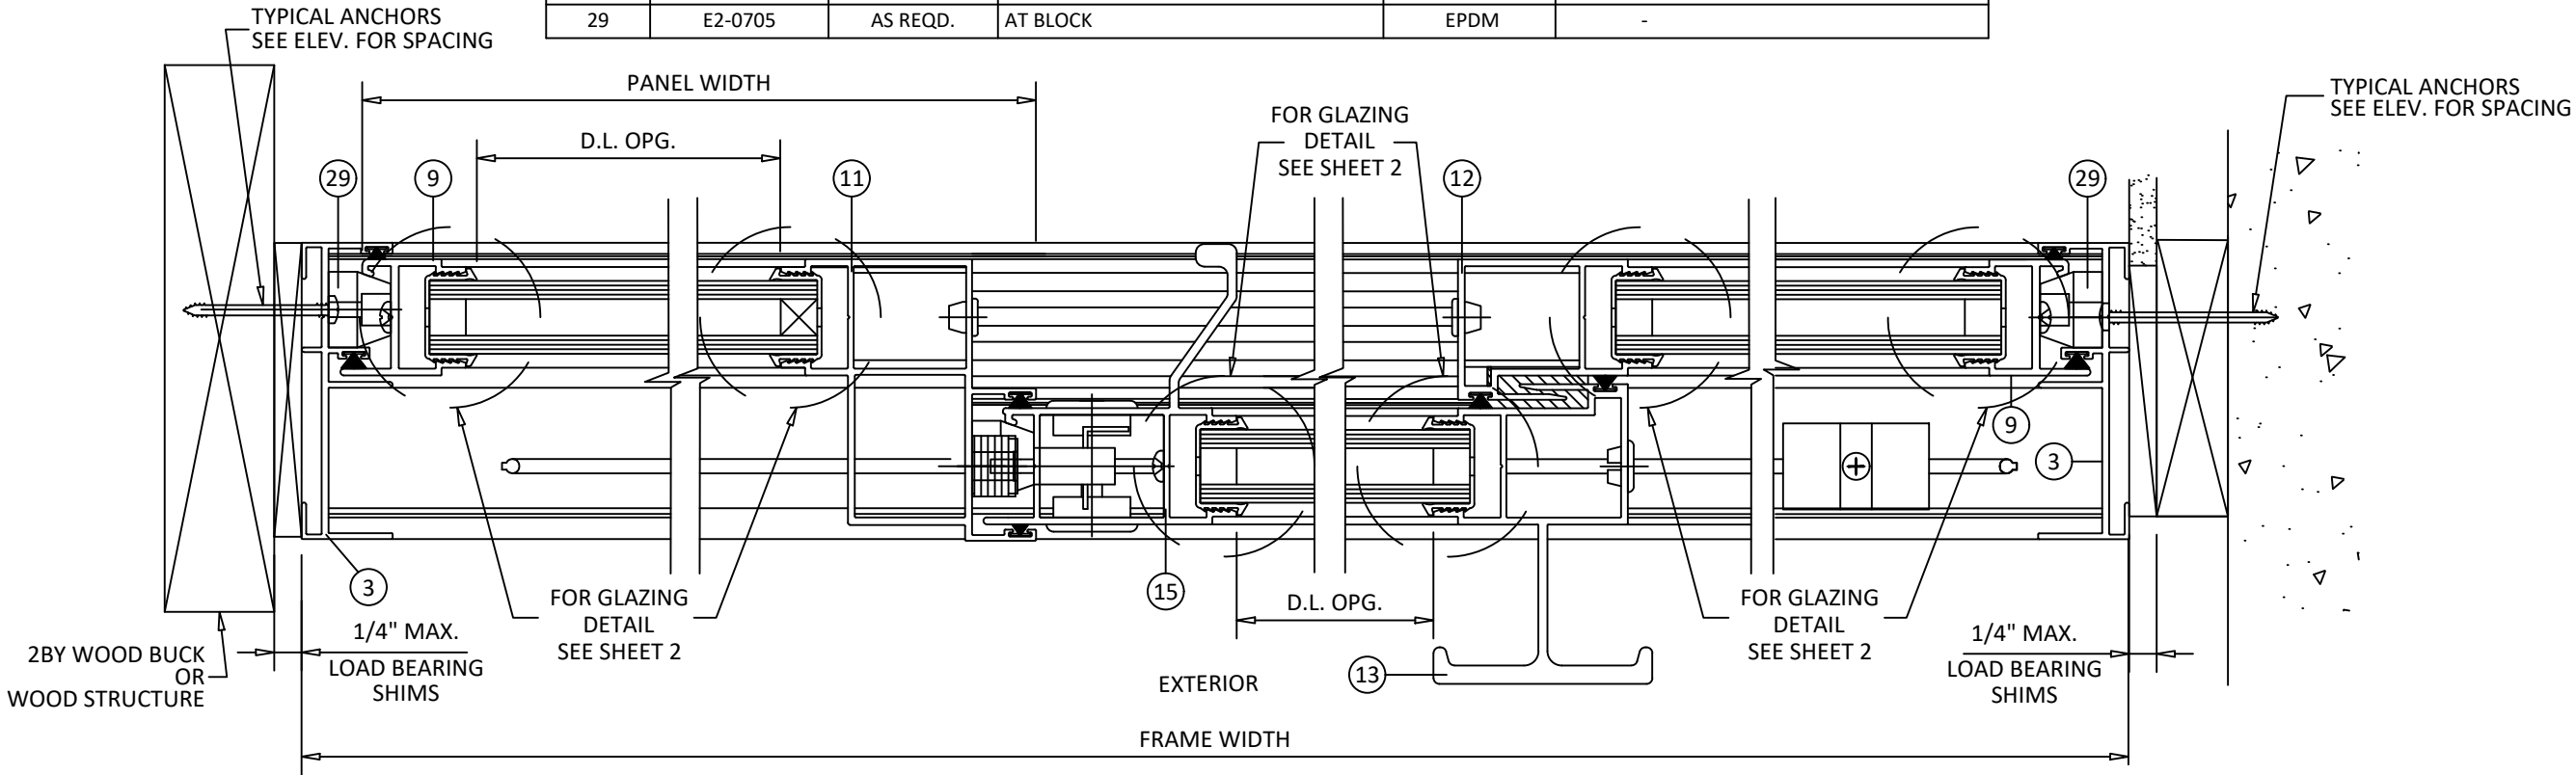

K
6 HORIZONTAL SECTION
JAMB - THROUGH FRAME
FIXED PANEL

L
6 HORIZONTAL SECTION
INTERLOCK - FIXED TO OPERABLE

M
6 HORIZONTAL SECTION
INTERLOCK - OPERABLE TO FIXED

N
6 HORIZONTAL SECTION
JAMB - THROUGH FRAME
FIXED PANEL



YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YSD 400
SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS &
BILL OF MATERIALS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL8753
DATE:	06.06.16
DWG. BY:	MSS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK232
SHEET:	6
REV.	A
OF 7	

7/24/2026 9:00 AM


c:\users\sebastianherrerros\desktop\Ykk 2026 cc\18753\Ykk232.dwg

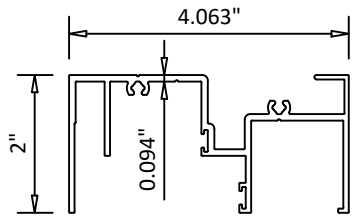


① FRAME HEAD

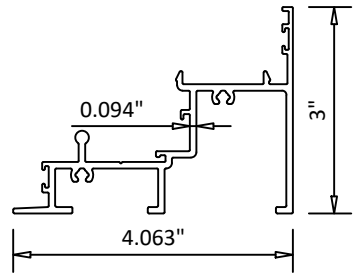


② FRAME SILL

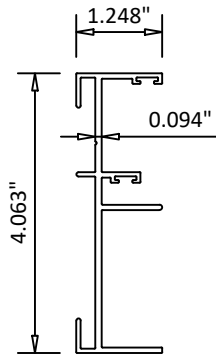


③ FRAME JAMB (FIXED)

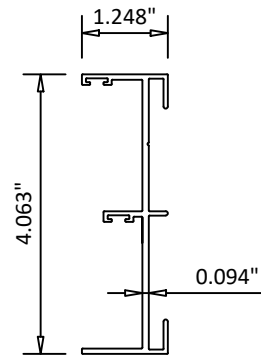


④ FRAME JAMB (OPERABLE)




⑤ TOP RAIL (FIXED)




⑥ TOP RAIL (OPERABLE)




⑦ BOTTOM RAIL (FIXED)

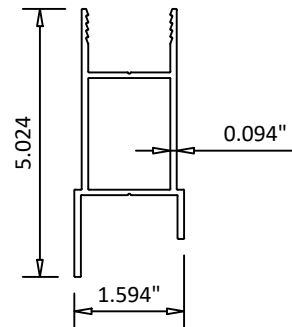


⑧ BOTTOM RAIL (OPERABLE)




⑨ JAMB STILE (FIXED)

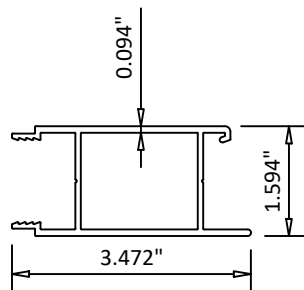


⑩ JAMB STILE (OPERABLE)

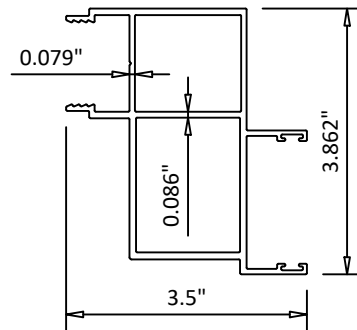


⑪ ASTRAGAL STILE

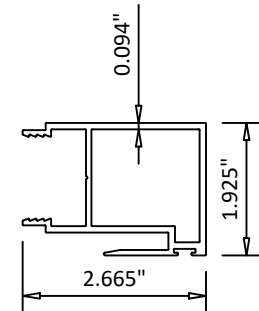


⑫ INTERLOCK (FIXED)

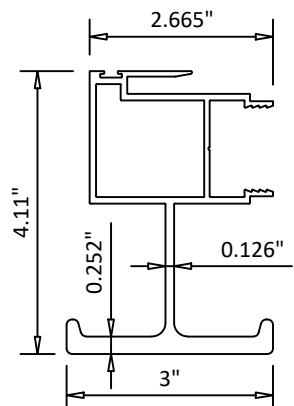


⑬ INTERLOCK (OPERABLE)

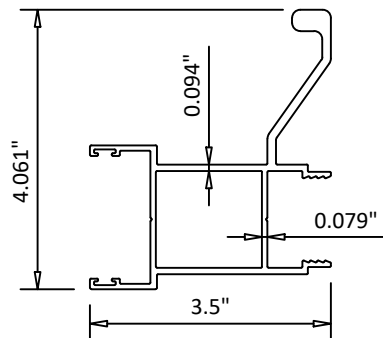


⑭ FEMALE LOCK STILE

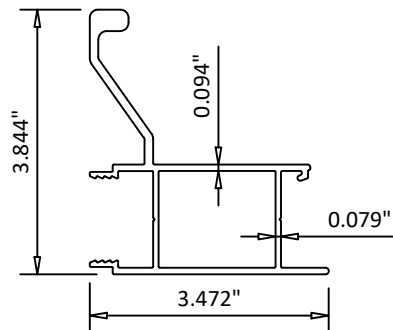

⑮ MALE LOCK STILE



⑯ THRESHOLD



⑰ WEATHERSEAL SILL ATTACHMENT



YKK AP America Inc
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YSD 400

SLIDING GLASS DOOR
(HVHZ) (NON-IMPACT)

COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	SH	06.29.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

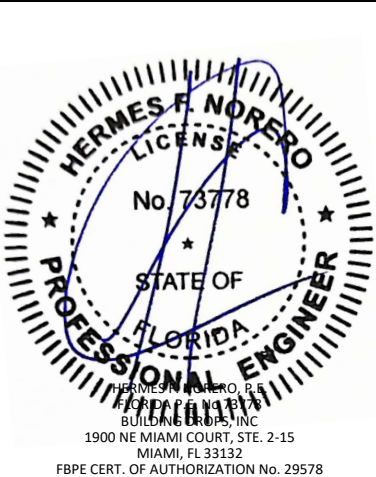

FL #:	FL8753
DATE:	06.06.16
DWG. BY:	MSS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK232
SHEET:	7
REV.	A
OF 7	