

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300–04, SEE SHEET 2 FOR GLASS DETAILS.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH f’m=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI 1/8” THICK MINIMUM
20. GEOMETRIC SHAPES ARE ALSO APPROVED. APPROVED GEOMETRIC SHAPES DIMENSIONS SHALL NOT EXCEED INSCRIBED DIMENSIONS OF APPROVED RECTANGULAR ASSEMBLY SHOWN IN SHEET 2.

SIGNED: 07/21/2015

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 – 9	INSTALLATION DETAILS

VINYL WINDOW TECHNOLOGIES, INC
2400 IRVIN COBB DRIVE
PADUCAH, KY 42002

SHORELINE SL 3100 PW 7272
72” X 72” NON IMPACT
NOTES

DRAWN:
R.L.

DWG NO.
08–00320

REV
C


SCALE NTS

DATE 7/25/07

SHEET 1 OF 9




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

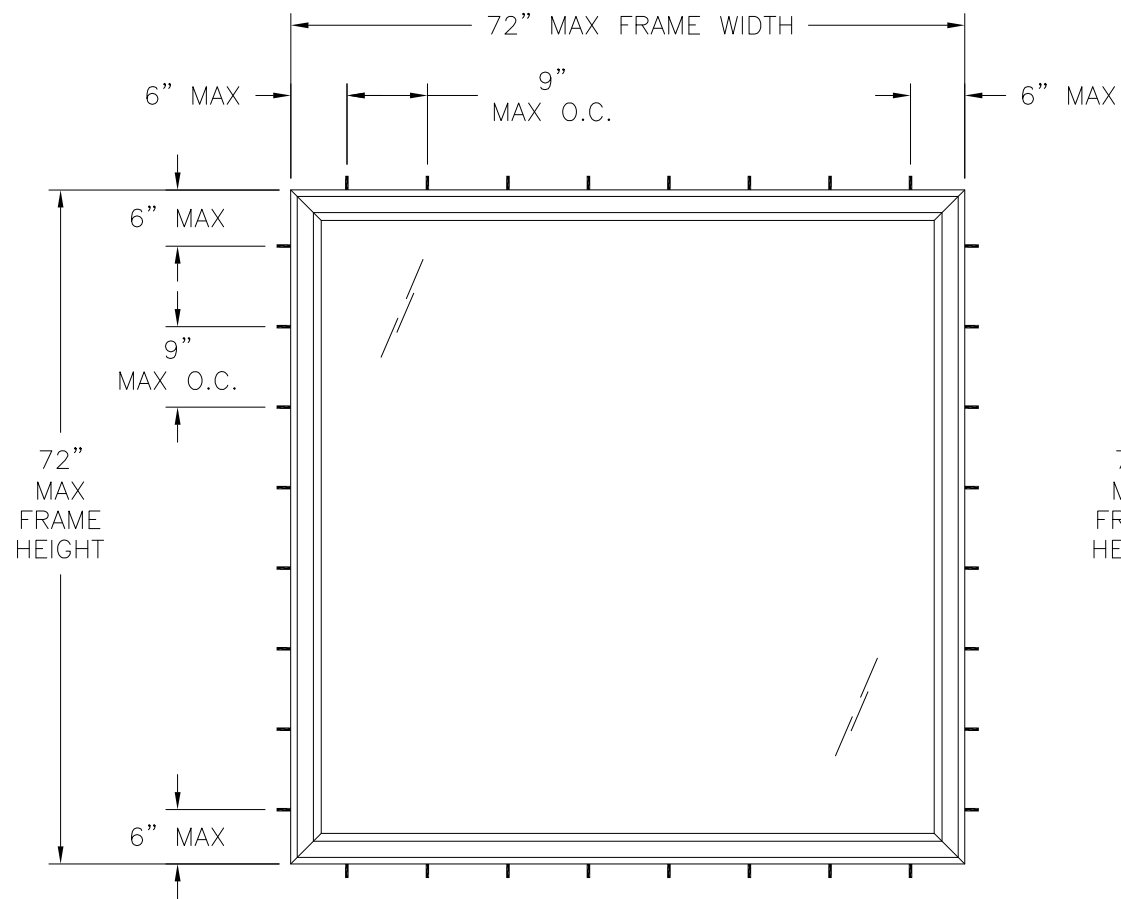

SHORELINE SL 3100 PW 7272
EXTERIOR VIEW
FRAME FLUSH INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
<i>±95.0PSF</i>	<i>NONE</i>

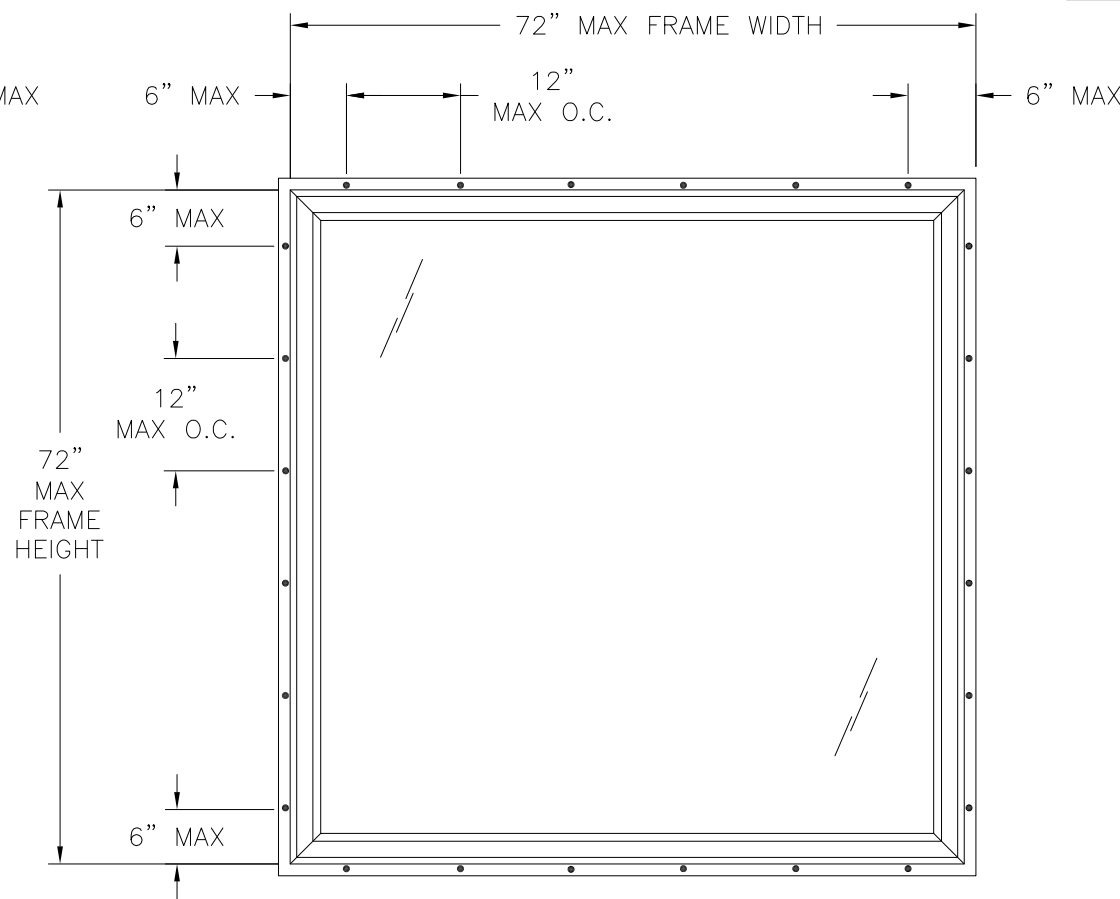

SHORELINE SL 3100 PW 7272
EXTERIOR VIEW
FIN INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
<i>±70.0PSF</i>	<i>NONE</i>

NOTES:
1. MAXIMUM D.L.O.: 72 1/4" X 66 1/2"

SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC
2400 IRVIN COBB DRIVE
PADUCAH, KY 42002

SHORELINE SL 3100 PW 7272
72" X 72" NON IMPACT
ELEVATIONS

DRAWN:
R.L.


DWG NO.
08-00320

REV
C

SCALE NTS


DATE 7/25/07

SHEET 2 OF 9

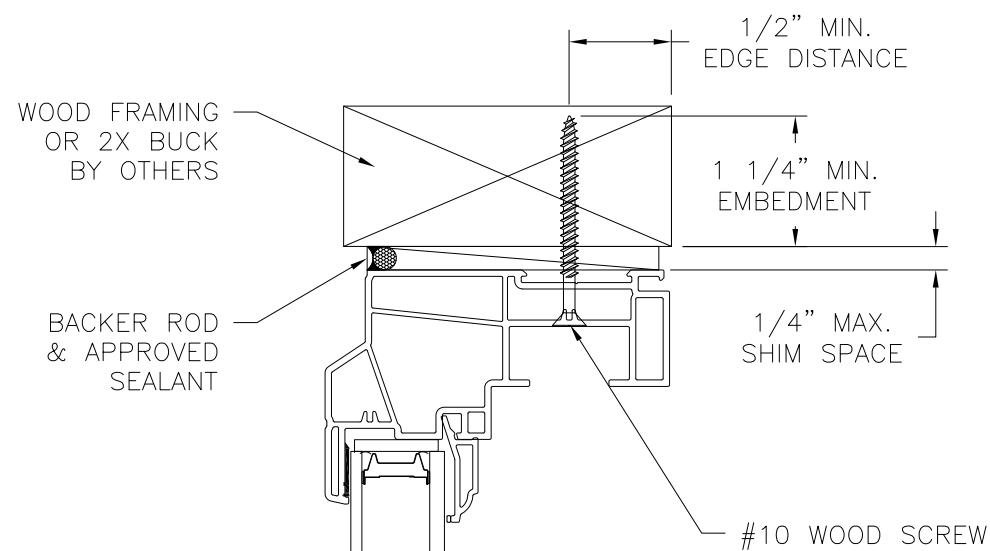


EXTERIOR

INTERIOR

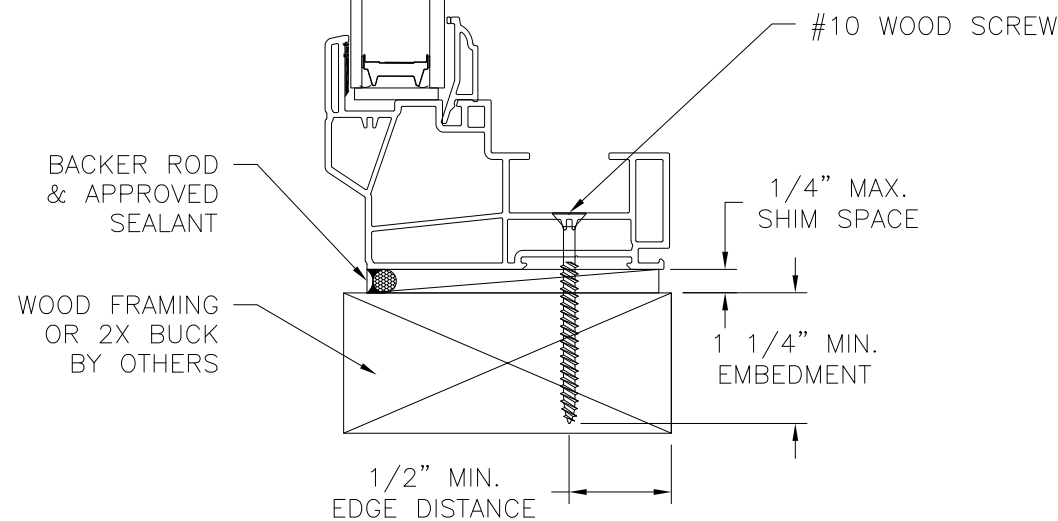


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

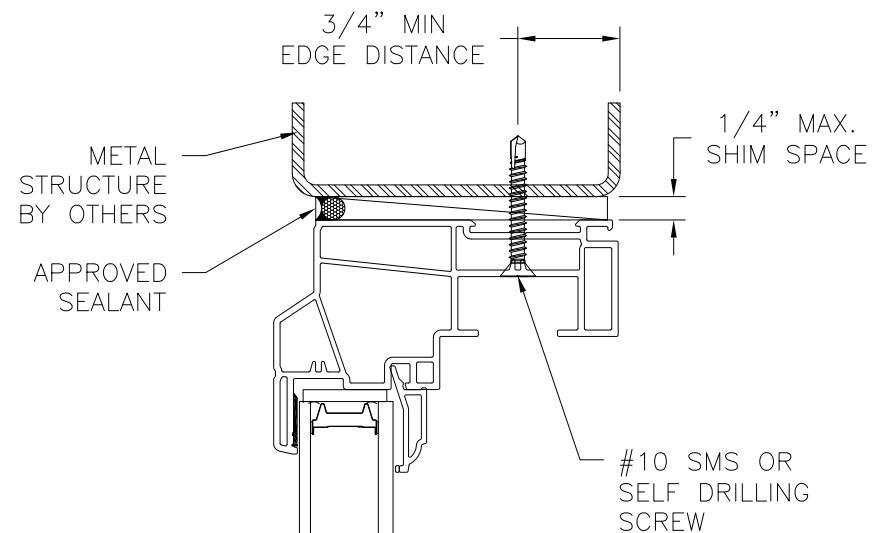

EXTERIOR

INTERIOR

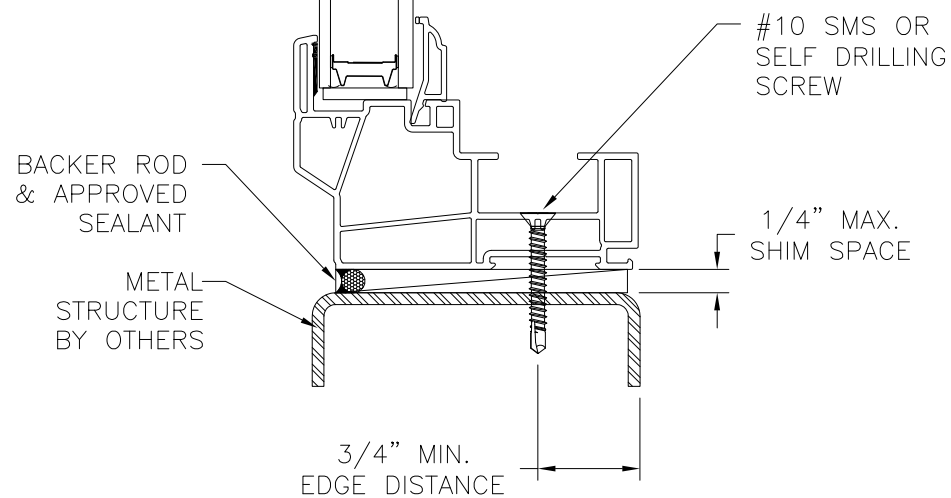

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC

2400 IRVIN COBB DRIVE
PADUCAH, KY 42002

SHORELINE SL 3100 PW 7272
72" X 72" NON IMPACT
FLUSH INSTALLATION DETAILS

DRAWN:

R.L.

DWG NO.

08-00320


REV

C


SCALE NTS

DATE 7/25/07

SHEET 3 OF 9

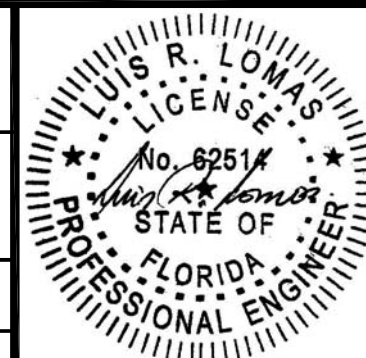

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

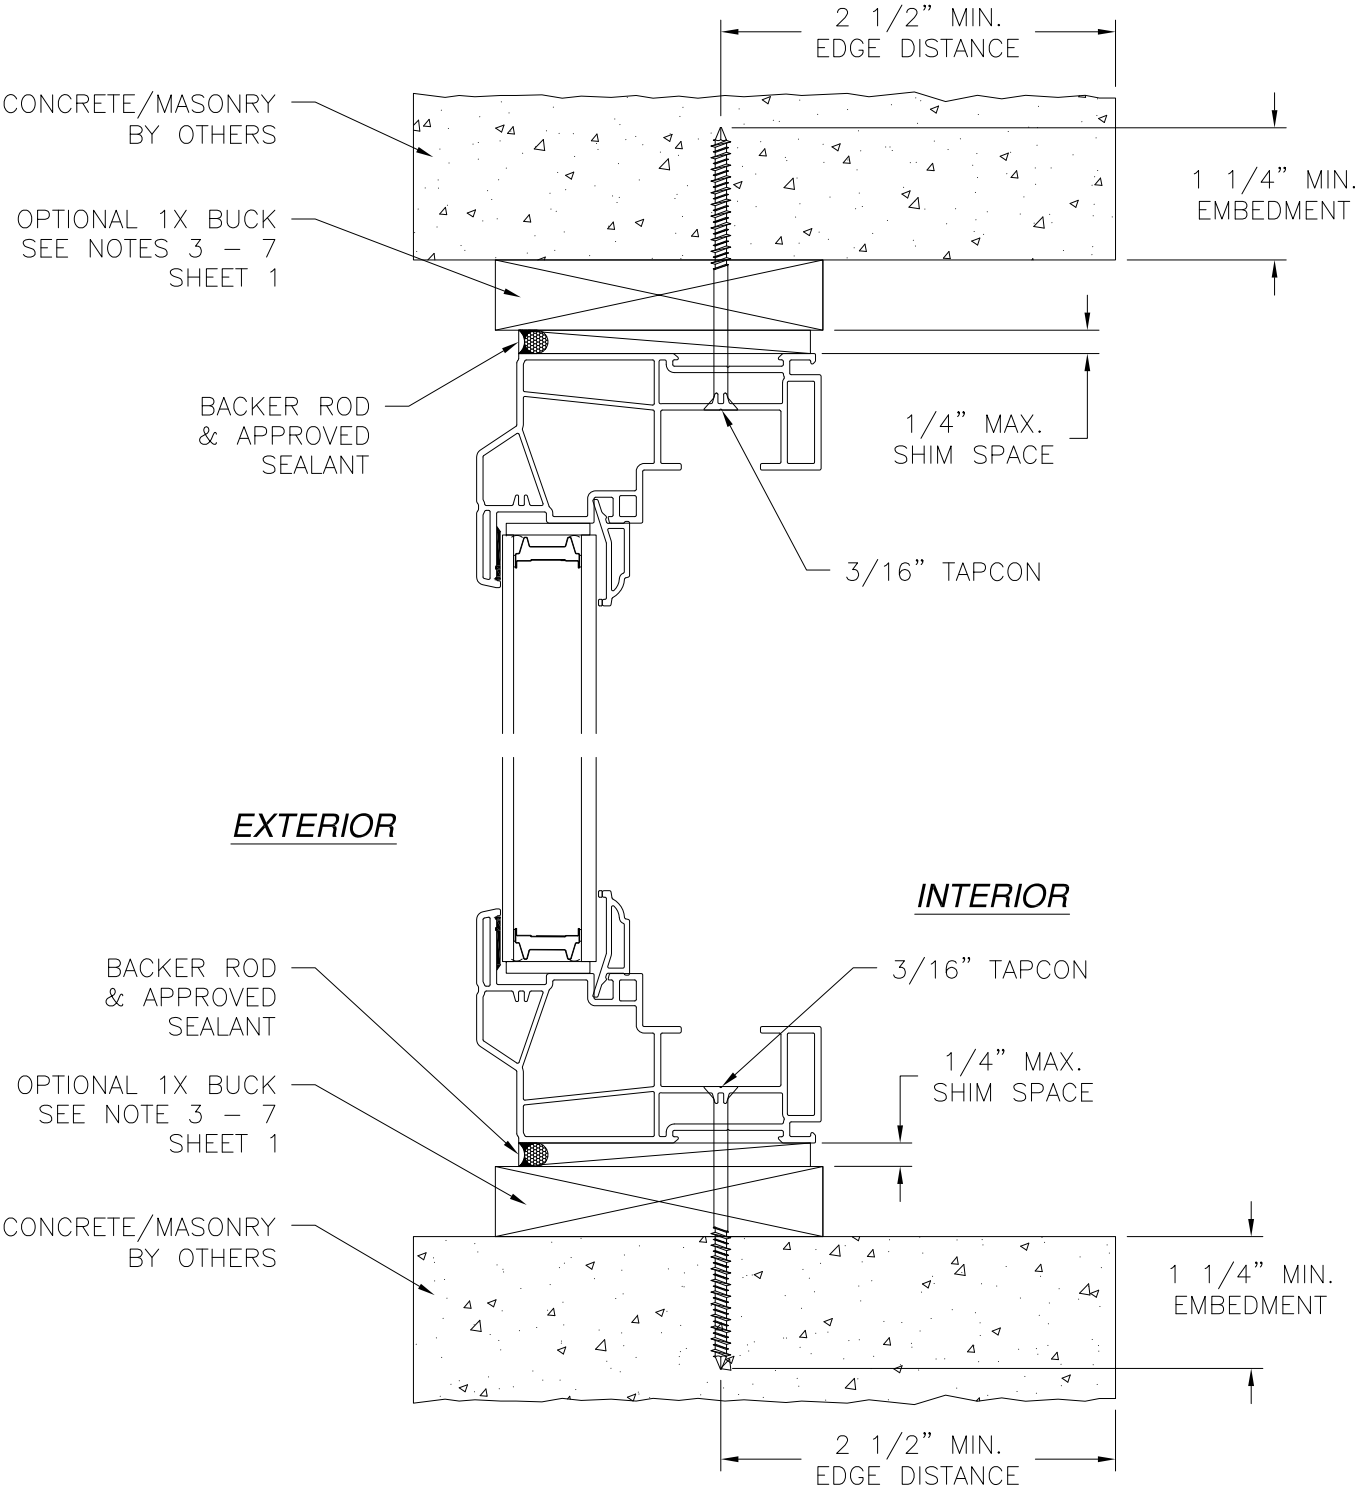


VERTICAL CROSS SECTION
 CONCRETE/MASONRY INSTALLATION
 HEAD AND SILL SHOWN, JAMBS SIMILAR

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/21/2015


VINYL WINDOW TECHNOLOGIES, INC 2400 IRVIN COBB DRIVE PADUCAH, KY 42002		
SHORELINE SL 3100 PW 7272 72" X 72" NON IMPACT FLUSH INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-00320	REV C
SCALE NTS	DATE 7/25/07	SHEET 4 OF 9



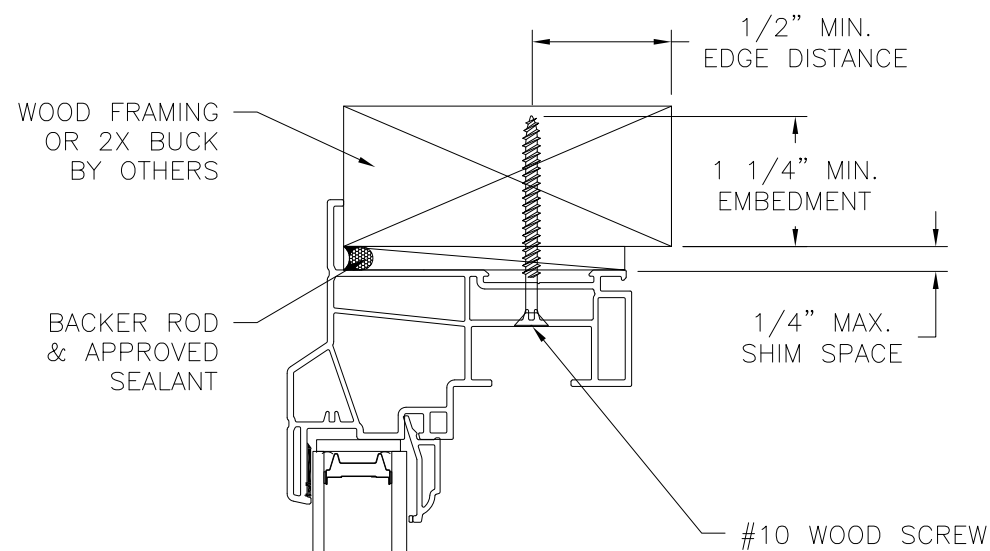


EXTERIOR

INTERIOR

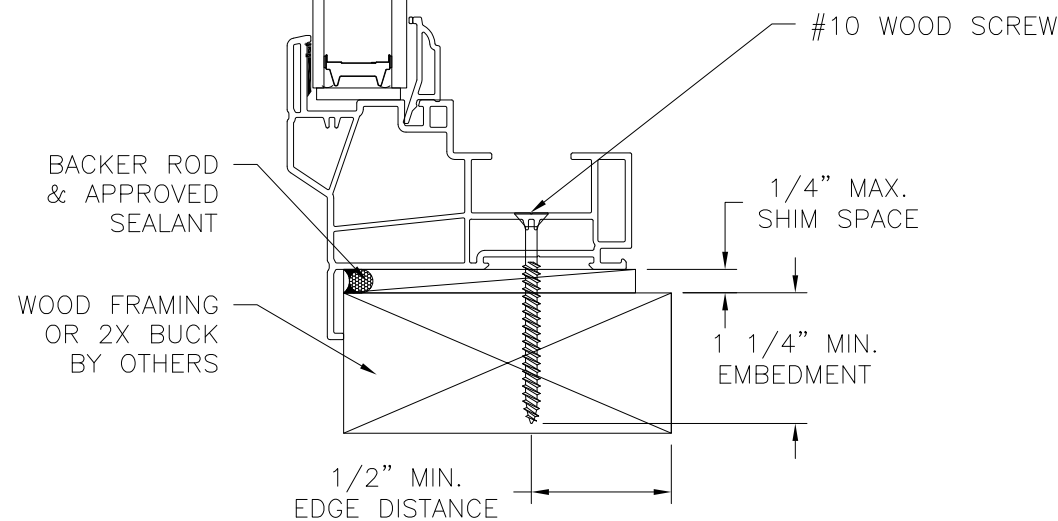


VERTICAL CROSS SECTION

WOOD FRAMING OR 2X BUCK INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

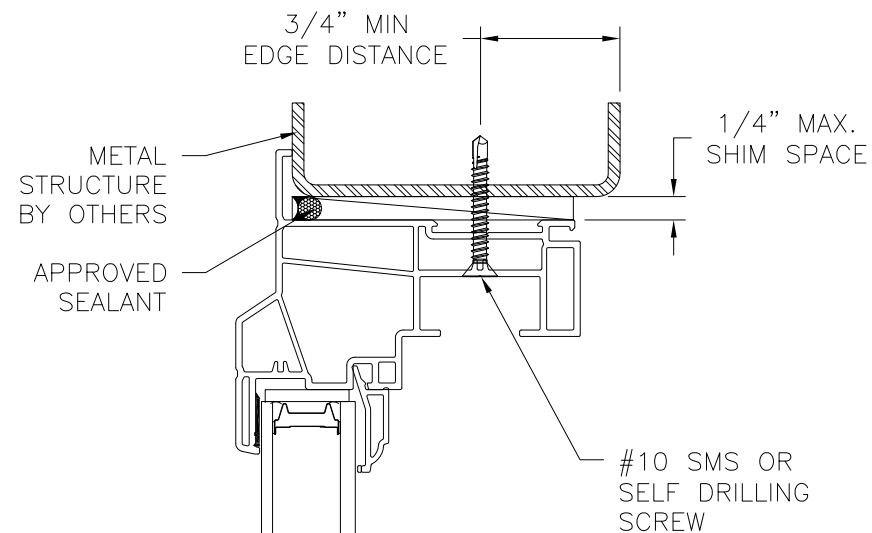

EXTERIOR

INTERIOR

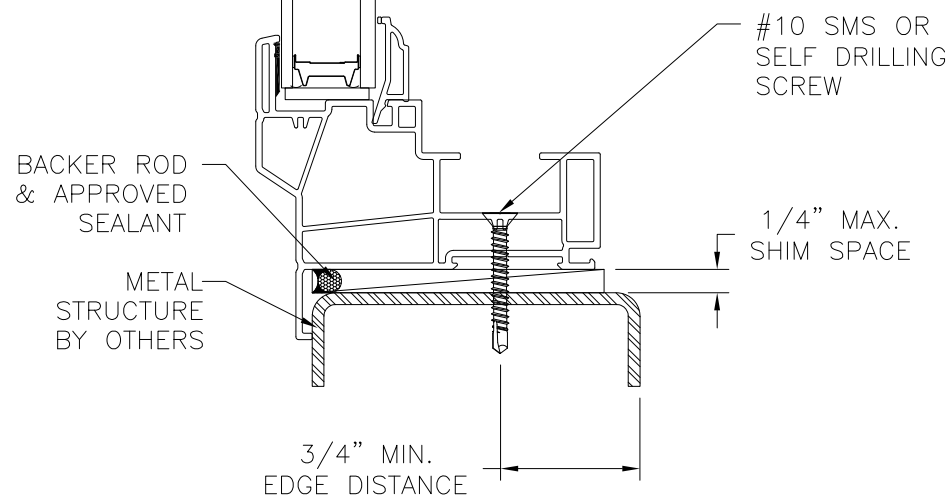

VERTICAL CROSS SECTION

METAL STRUCTURE INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC

2400 IRVIN COBB DRIVE
PADUCAH, KY 42002

SHORELINE SL 3100 PW 7272
72" X 72" NON IMPACT
FLANGE INSTALLATION DETAILS

DRAWN:

R.L.

DWG NO.

08-00320

REV

C


SCALE NTS

DATE


7/25/07

SHEET

5 OF 9

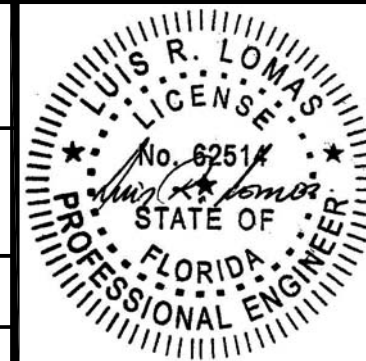

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

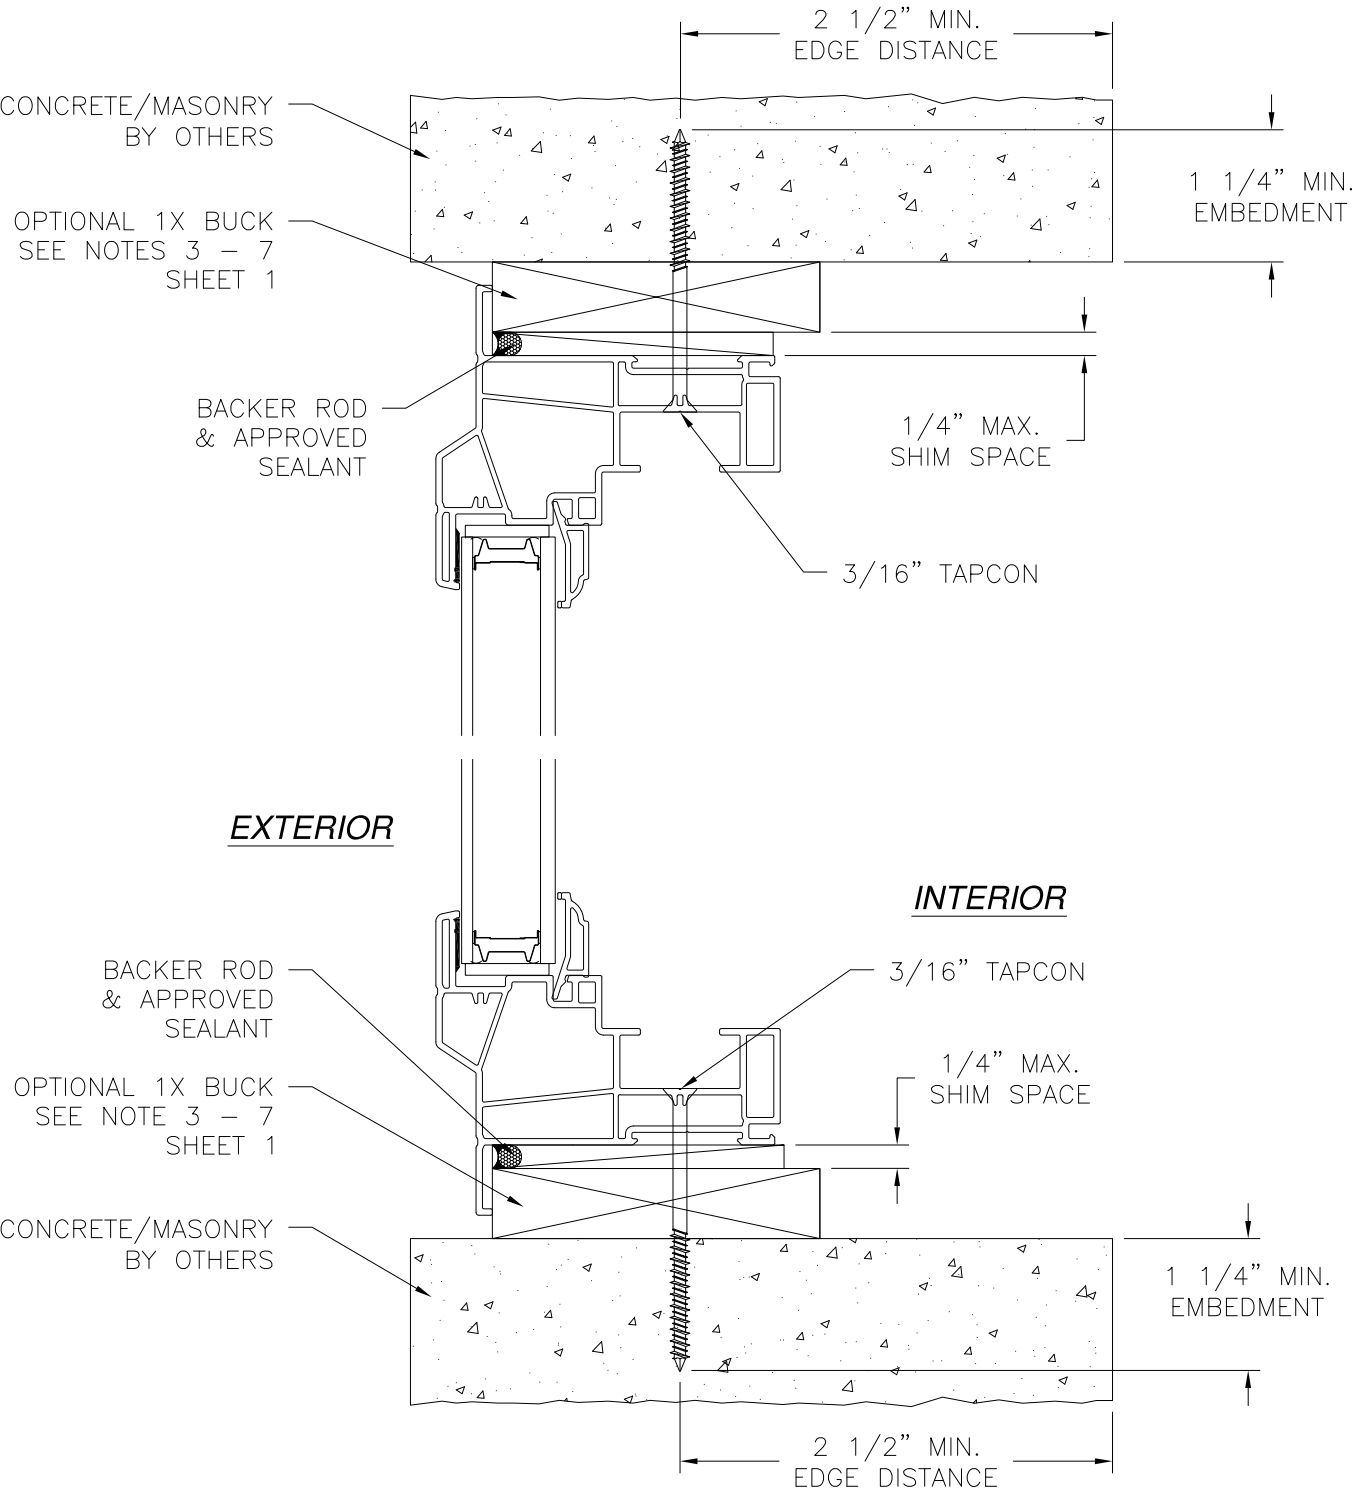


VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC 2400 IRVIN COBB DRIVE PADUCAH, KY 42002		
SHORELINE SL 3100 PW 7272 72" X 72" NON IMPACT FLANGE INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-00320	REV C
SCALE NTS	DATE 7/25/07	SHEET 6 OF 9

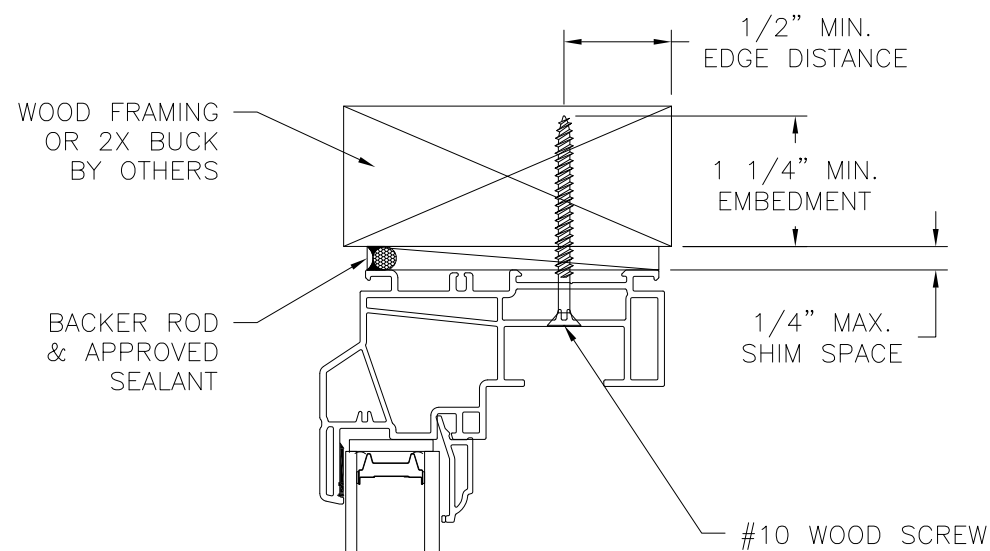


EXTERIOR

INTERIOR

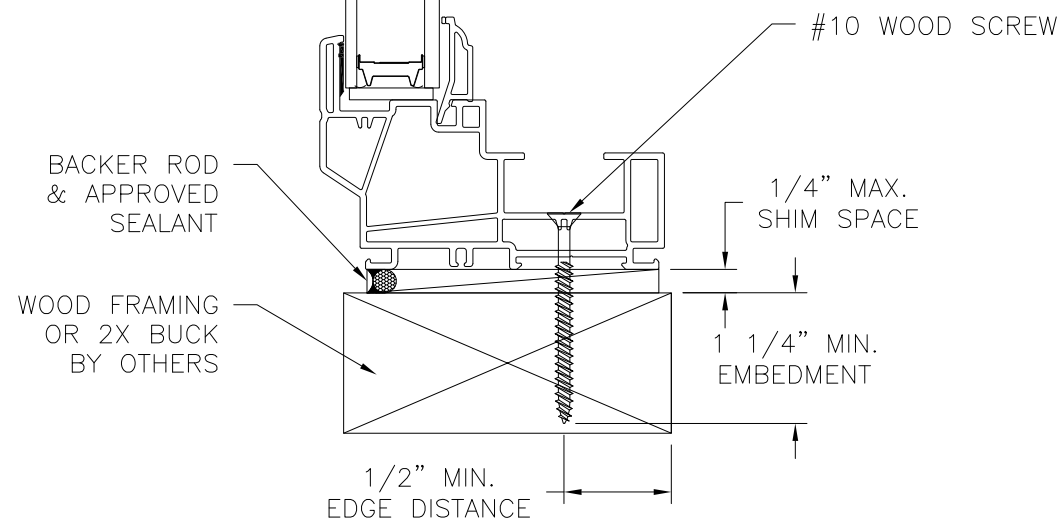


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

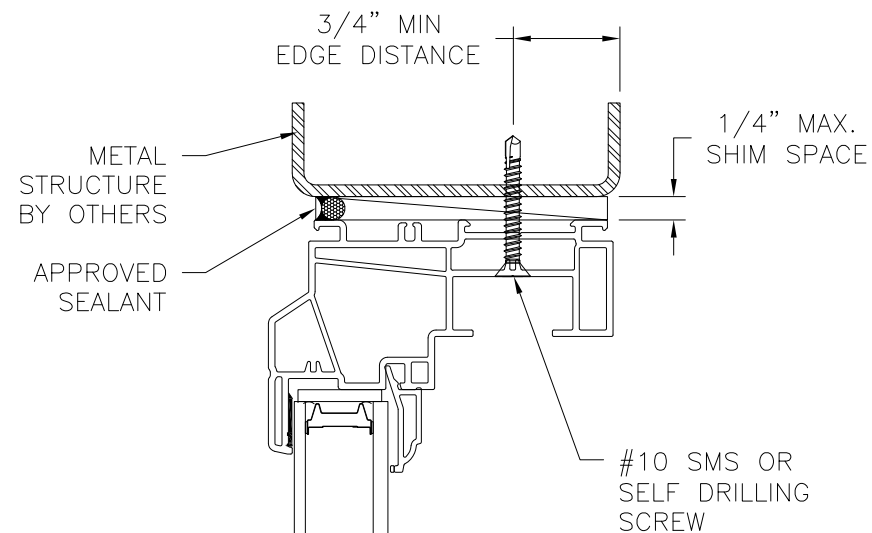

EXTERIOR

INTERIOR

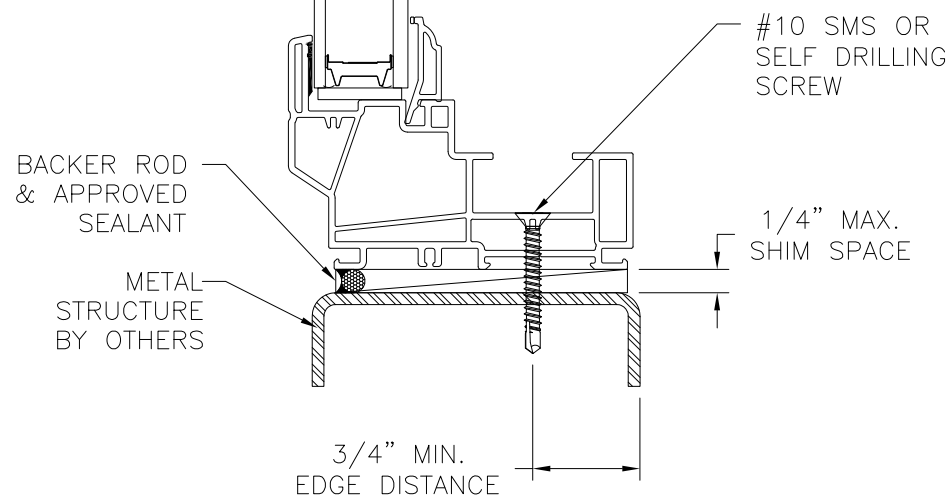

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION
HEAD AND SILL SHOWN, JAMBS SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC

2400 IRVIN COBB DRIVE
PADUCAH, KY 42002

SHORELINE SL 3100 PW 7272
72" X 72" NON IMPACT
FRAME INSTALLATION DETAILS

DRAWN:

R.L.

DWG NO.

08-00320


REV


C

SCALE NTS

DATE 7/25/07

SHEET 7 OF 9

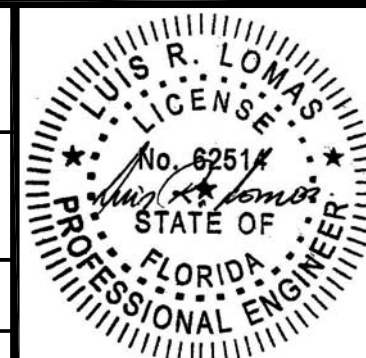

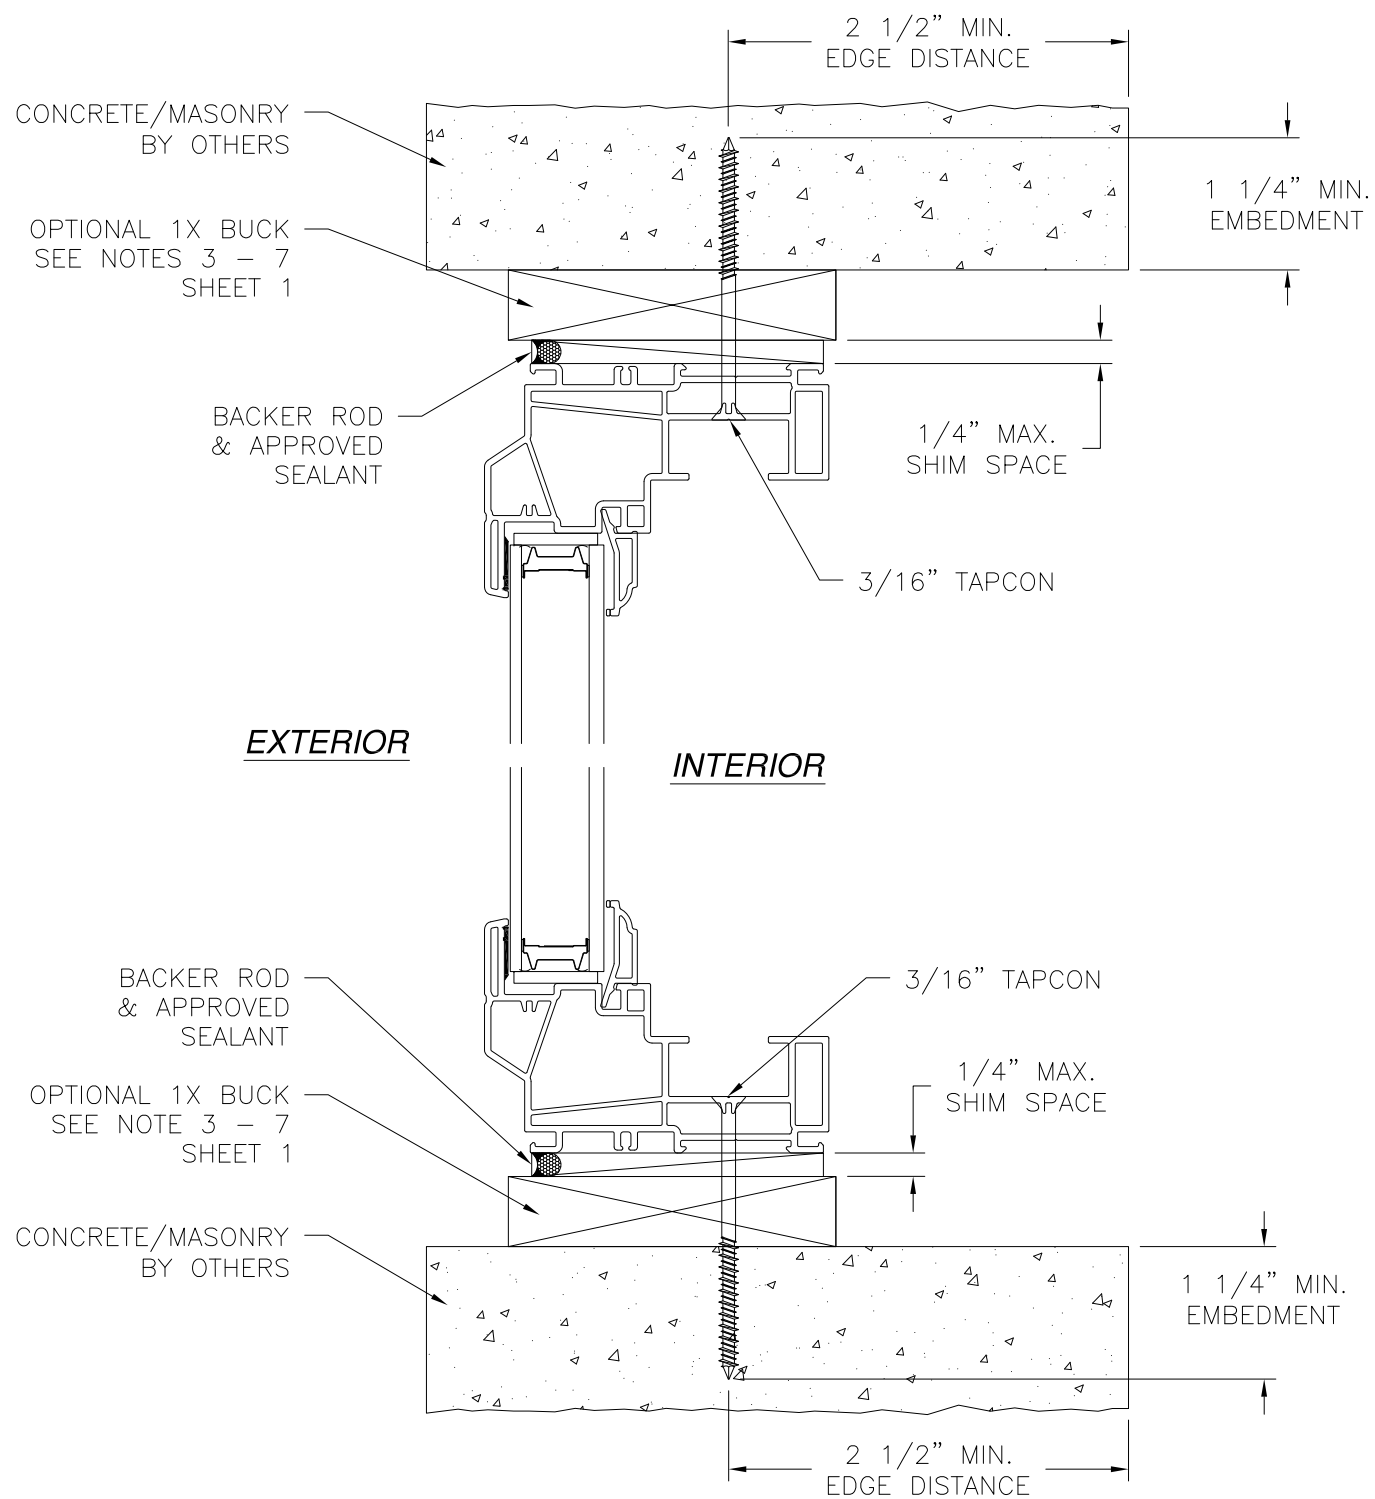

VERTICAL CROSS SECTION
 CONCRETE/MASONRY INSTALLATION
 HEAD AND SILL SHOWN, JAMBS SIMILAR

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE TO 2007 FBC	1/17/09	R.L.
B	REVISED NOTES	3/09/12	R.L.
C	REVISED INSTALLATION DETAILS	07/20/15	R.L.

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/21/2015

VINYL WINDOW TECHNOLOGIES, INC 2400 IRVIN COBB DRIVE PADUCAH, KY 42002		
SHORELINE SL 3100 PW 7272 72" X 72" NON IMPACT FRAME INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-00320	REV C
SCALE NTS	DATE 7/25/07	SHEET 8 OF 9

