






AMERICA'S DOORMAKER
631 N. FIRST ST. WEST BRANCH, MI 48661

STEEL EDGE GLAZED SINGLE DOOR
with SIDELITE(S)
INSWING / OUTSWING
"NON-IMPACT"

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
- 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- 5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Elevations
4	Horizontal cross sections
5	Vertical cross sections
6	Buck anchoring
7	Frame anchoring
8	Bill of materials and components

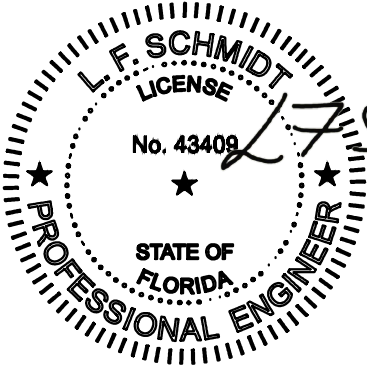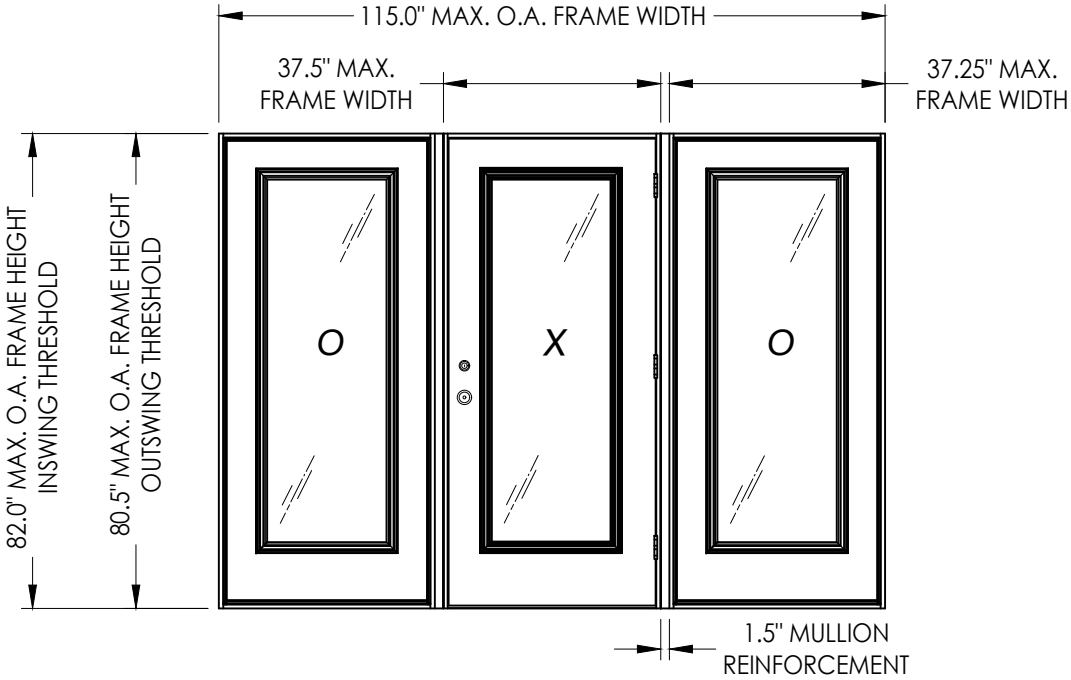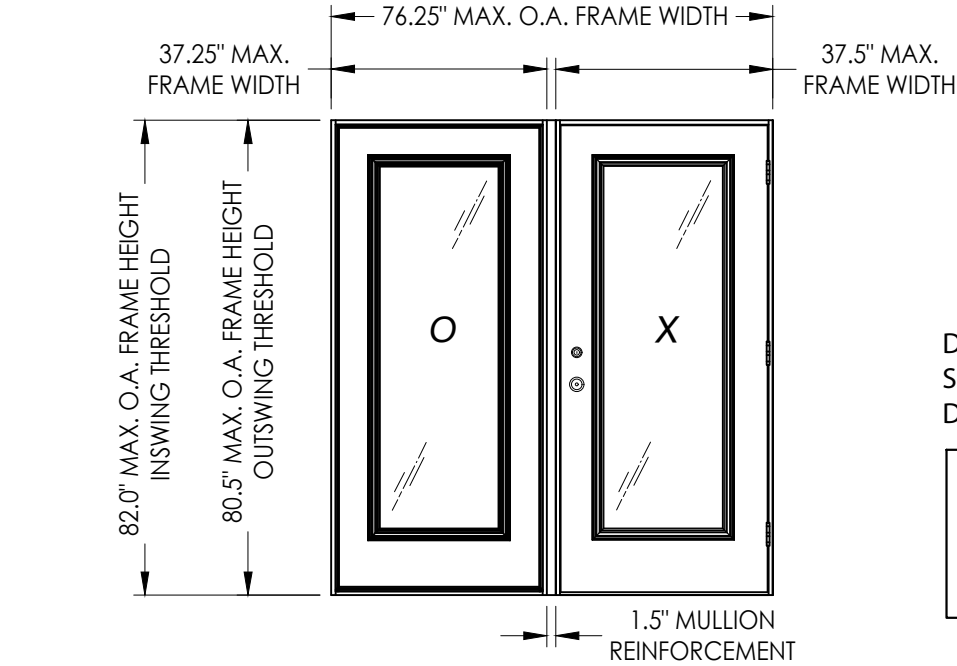

Digitally signed by Lyndon F Schmidt
Date: 2026.07.05 07:55:24 -04'00'


This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA


MAX. FRAME DIMENSION	MAX. D.L.O. DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
76.25" x 82.0"	21.0" x 63.0"	+40.0	-40.0	+40.0	-40.0
115.0" x 82.0"	21.0" x 63.0"	+40.0	-40.0	+40.0	-40.0

PRODUCT: TAYLOR DOORS		LFS	FBC	(2026)	9TH ED.	7/03/26	6
		LFS	FBC	(2023)	8TH ED.	7/06/23	5
		LFS	FBC	(2020)	7TH ED.	7/20/20	4
		JK	FBC	(2017)	6TH ED.	7/20/17	3
PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES		LFS	FBC	(2014)	5TH ED.	3/03/15	2
		JK				1/17/12	1
		BY				DATE	NO.
REVISIONS							
DATE: 6/17/08							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-9542.2							
SHEET 1 OF 8							

Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg


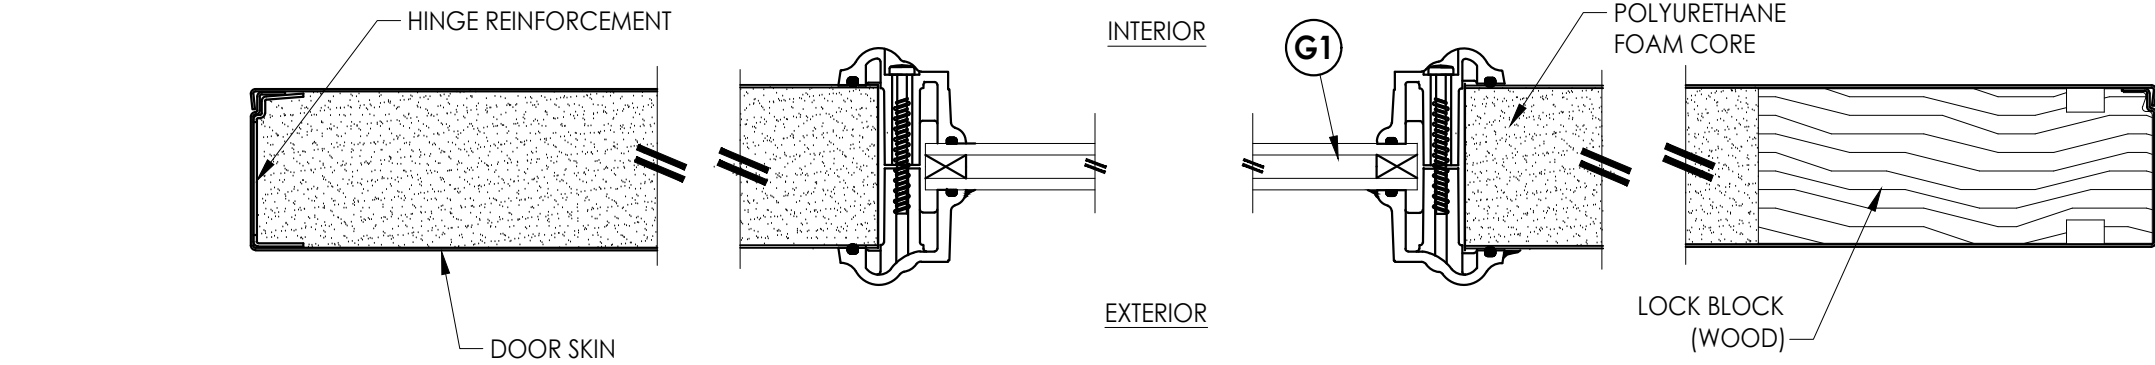


1
2 HORIZONTAL CROSS SECTION

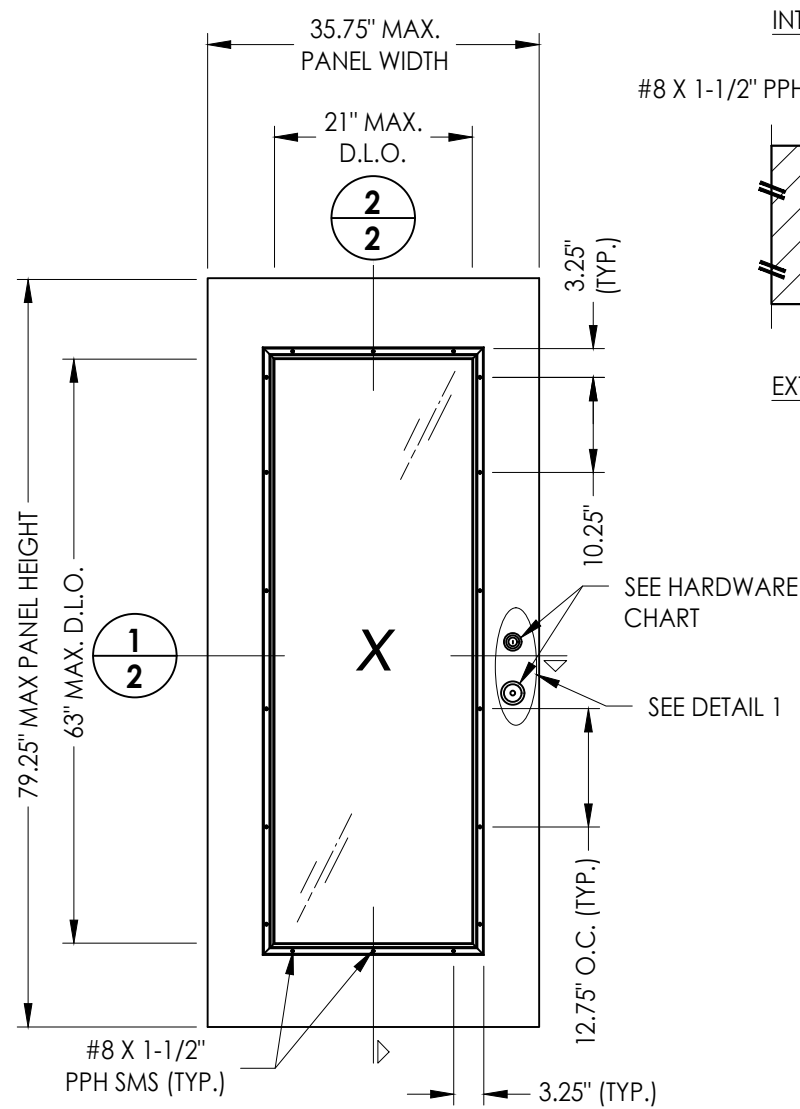


40 41 DOOR AND SIDELITE PANEL
#40 - Steel Edge Steel Door
#41 - Steel Edge Sidelite

DOOR SKIN: 0.019" MIN. THK. STEEL
CORE MATERIAL: POLYURETHANE FOAM

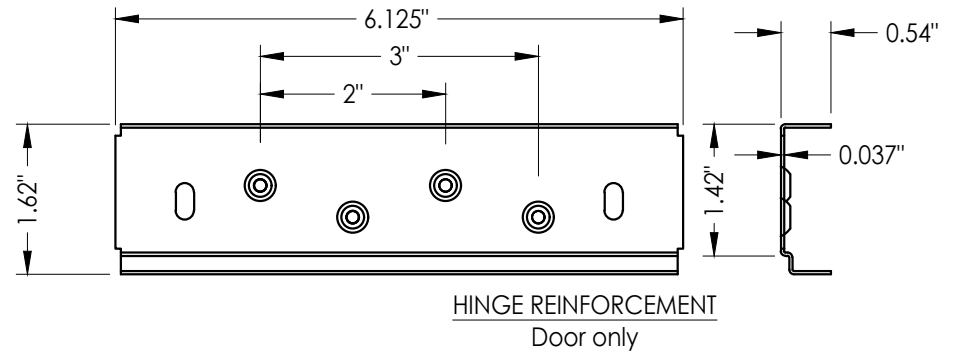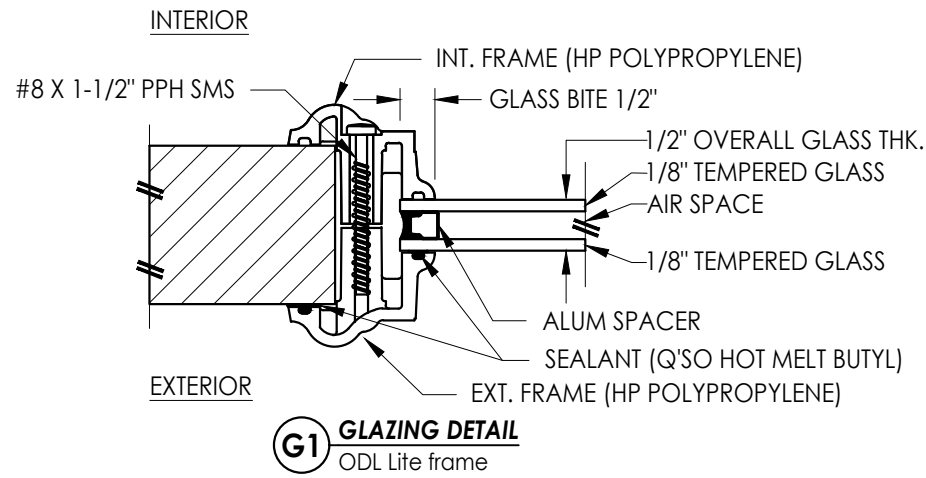

HARDWARE CHART	
MANUFACTURER	MODEL
YALE	Knob: NEW TRADITIONS DEADBOLT: NEW TRADITIONS (800 SERIES)
SCHLAGE	Knob/LEVER: "F" SERIES DEADBOLT: B60/62
KWIKSET	Knob: SIGNATURE SERIES DEADBOLT: SIGNATURE SERIES (980)

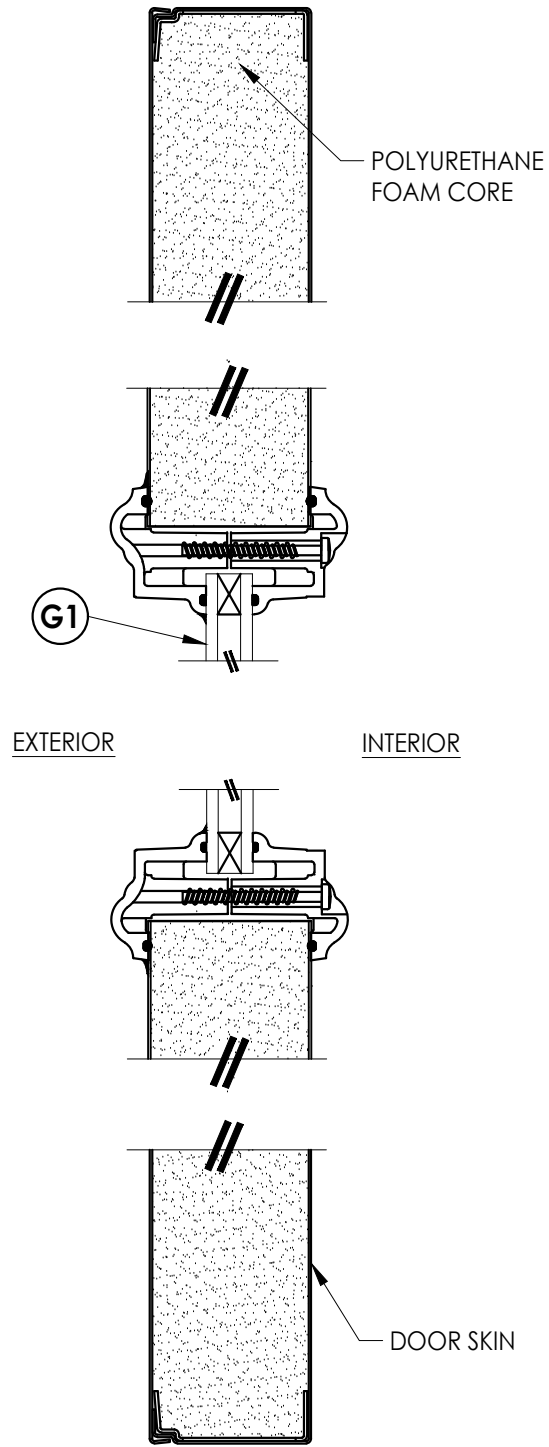

2
2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:
DOOR PANEL DETAILS

LFS	FBC	DATE	REVISIONS
6	7/03/26	UPDATE TO 9TH ED. (2026)	
5	7/06/23	UPDATE TO 8TH ED. (2023)	
4	7/20/20	UPDATE TO 7TH ED. (2020)	
3	7/20/17	UPDATE TO 6TH ED. (2017)	
2	3/03/15	UPDATE TO 5TH ED. (2014)	
1	1/17/12	UPDATE TO 2010 FBC	
NO.	DATE		

DATE: 6/17/08



SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-9542.2

SHEET 2 OF 8

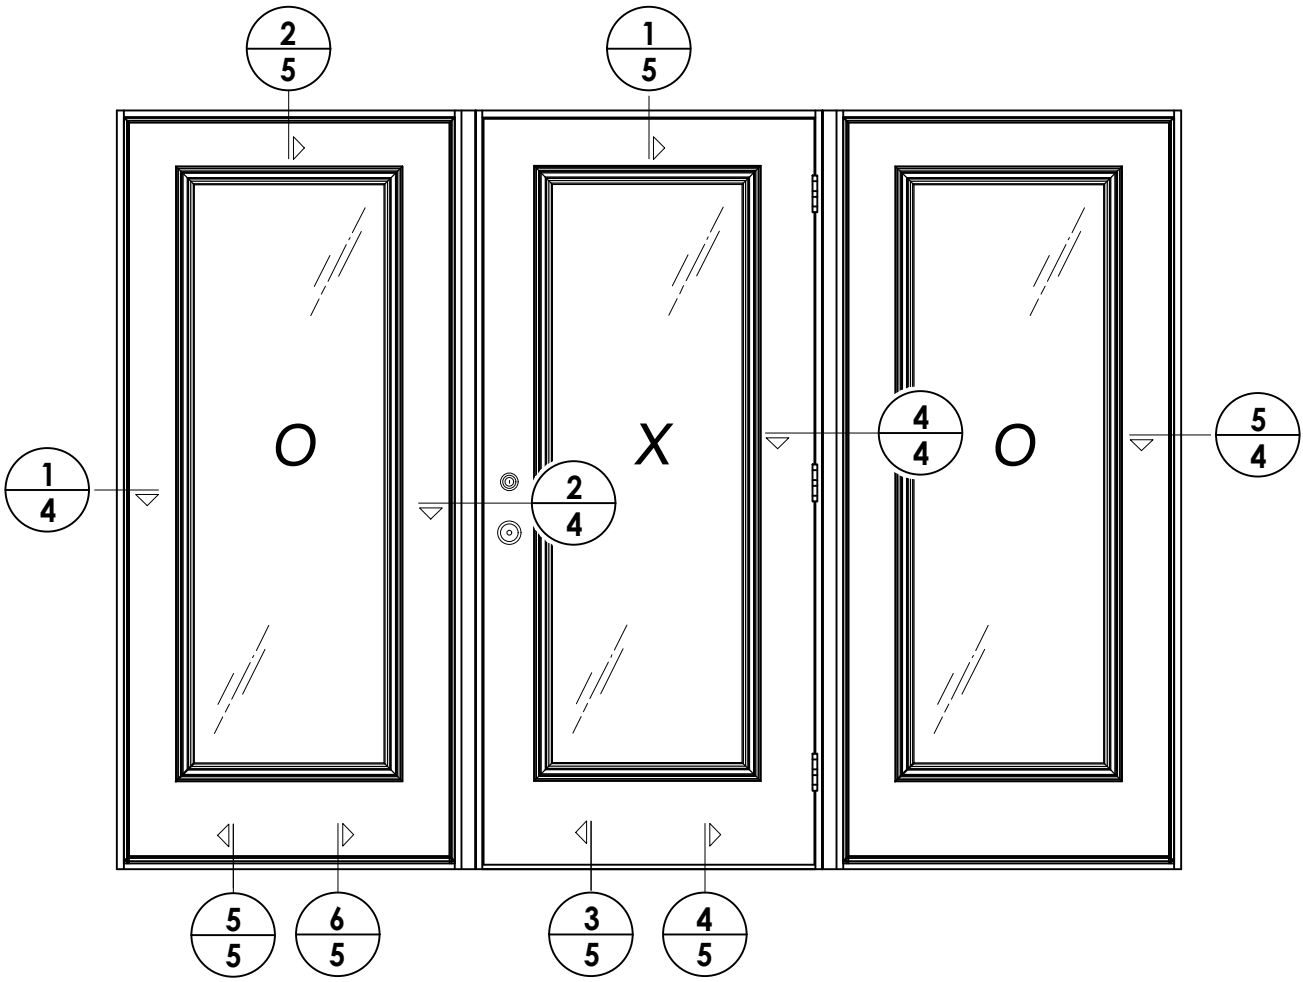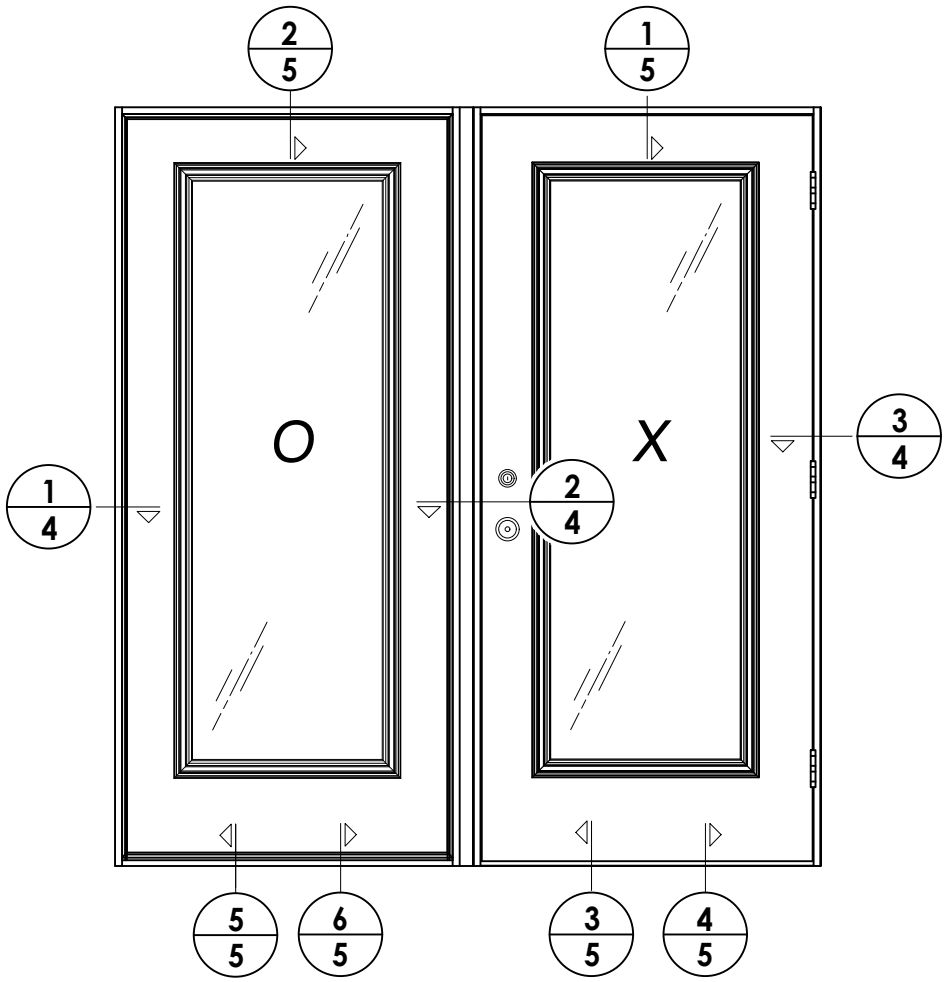


DATE: 6/17/08		DRAWING NO.: FL-9542.2		SHEET 3 OF 8	
DWG. BY: JK		CHK. BY: LFS		REVISIONS	
SCALE: N.T.S.		NO.		DATE	BY
6	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
5	7/06/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
4	7/20/20	UPDATE TO 7TH ED.	(2020)	FBC	LFS
3	7/20/17	UPDATE TO 6TH ED.	(2017)	FBC	JK
2	3/03/15	UPDATE TO 5TH ED.	(2014)	FBC	LFS
1	1/17/12	UPDATE TO 2010 FBC			JK
PART OR ASSEMBLY: ELEVATIONS					
PRODUCT: TAYLOR DOORS					
Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409					
R.W. BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813					


Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg

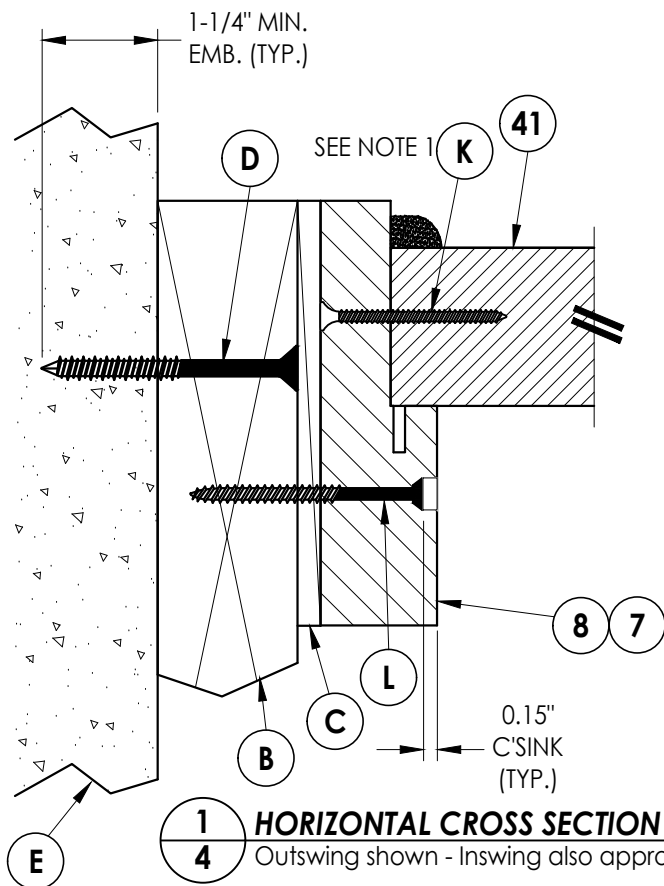


1
4 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

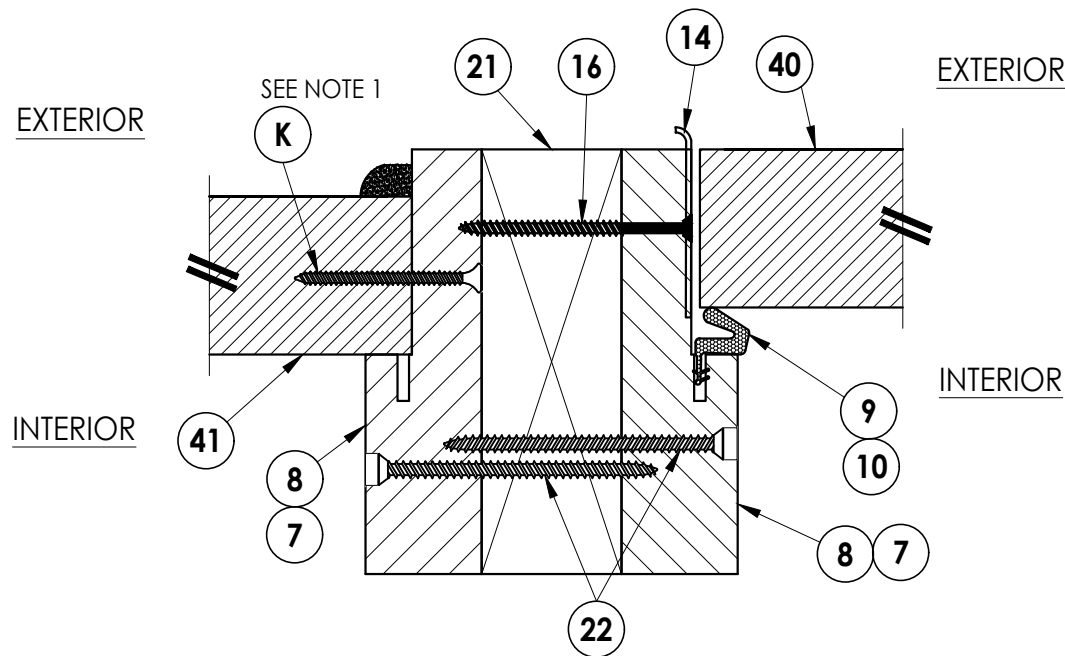


2
4 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

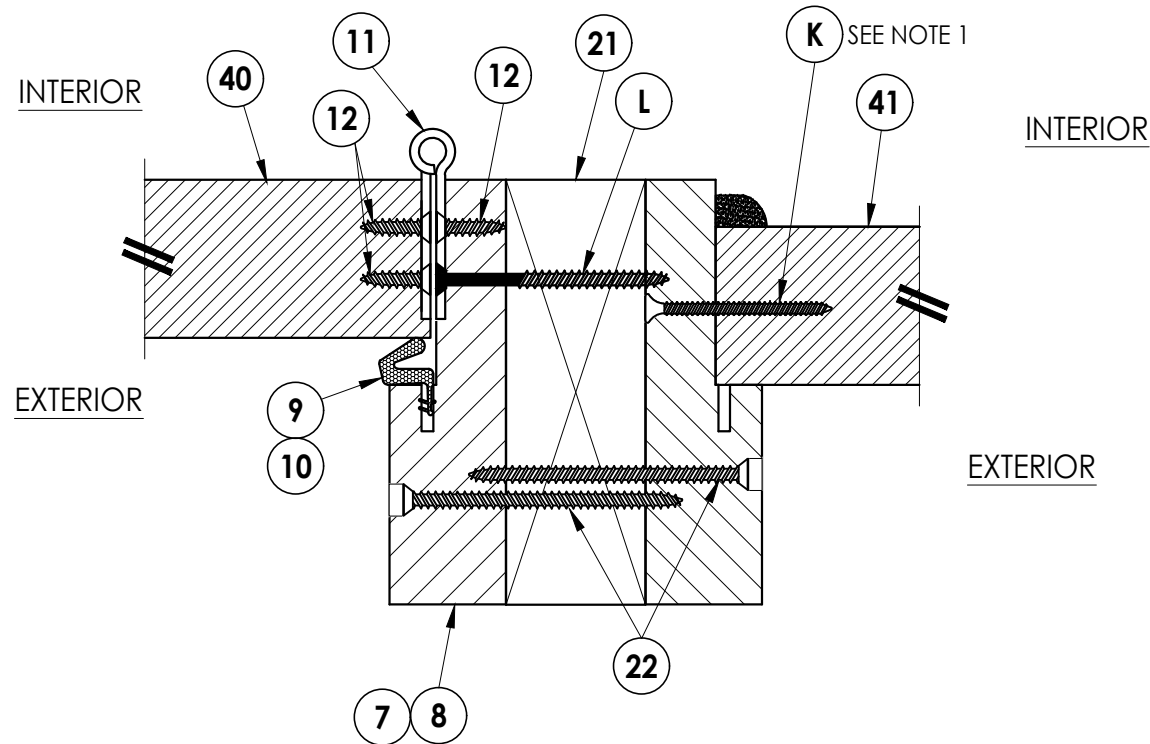

4
4 **HORIZONTAL CROSS SECTION**
Inswing hinge jamb @ sidelite jamb

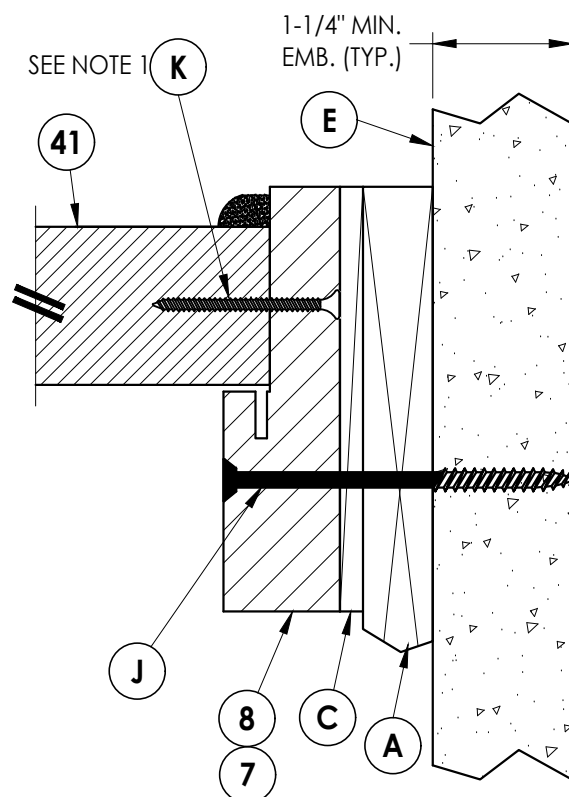

5
4 **HORIZONTAL CROSS SECTION**
Shown w/1X sub-buck

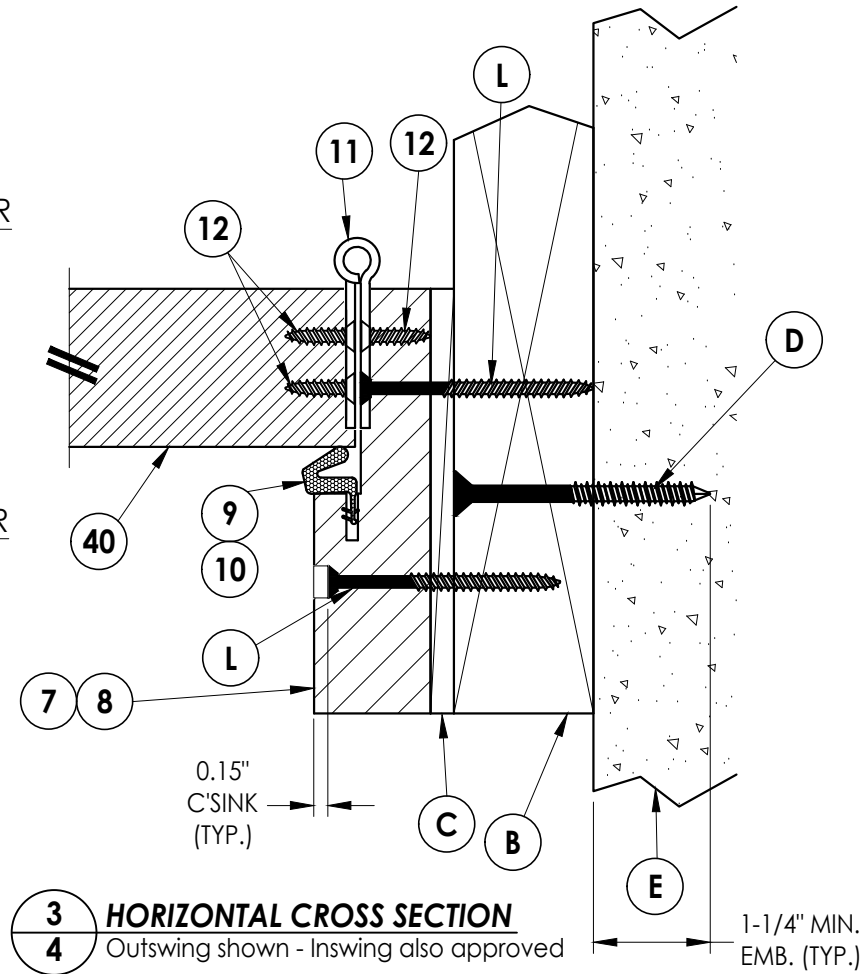

3
4 **HORIZONTAL CROSS SECTION**
Outswing shown - Inswing also approved

NOTE:

1. SIDELITE PANELS ANCHORED TO FRAME 6" FROM TOP OF FRAME THEN 10" O.C. (TYP.), 8 SCREWS TOTAL EACH JAMB.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:
HORIZONTAL
CROSS SECTIONS

LFS	FBC	(2026)	9TH ED.	UPDATE TO	NO.	DATE	REVISIONS
6	7/03/26	UPDATE TO	9TH ED.	(2026)	JK		
5	7/06/23	UPDATE TO	8TH ED.	(2023)	FBC		
4	7/20/20	UPDATE TO	7TH ED.	(2020)	FBC		
3	7/20/17	UPDATE TO	6TH ED.	(2017)	FBC		
2	3/03/15	UPDATE TO	5TH ED.	(2014)	FBC		
1	1/17/12	UPDATE TO	2010 FBC		JK		

DATE: 6/17/08

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-9542.2

SHEET 4 OF 8

Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg

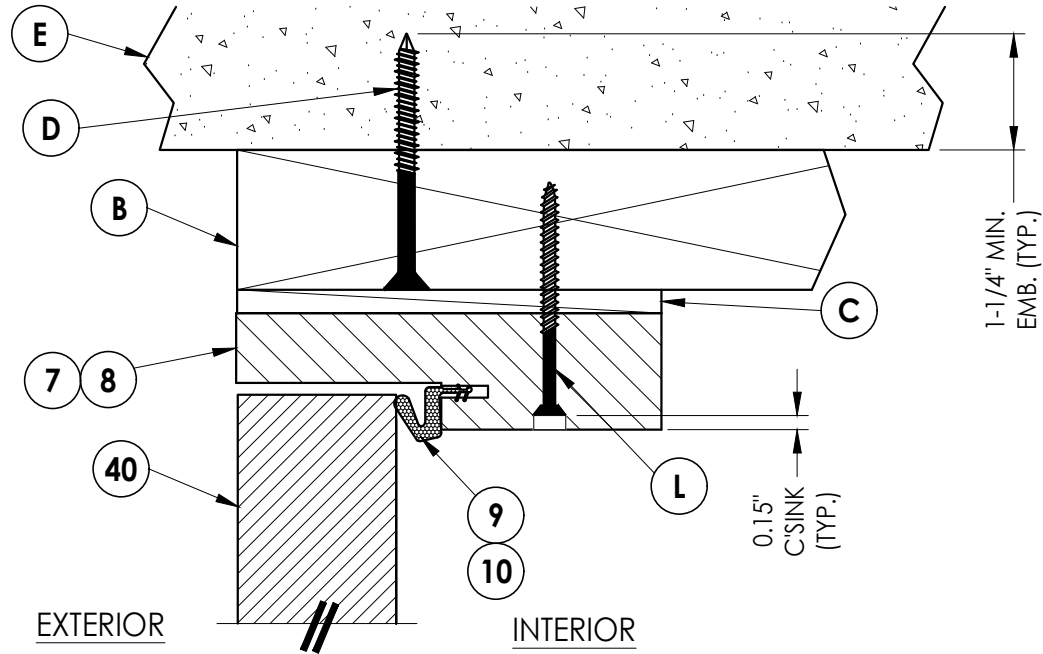


1 **VERTICAL CROSS SECTION**
5 Outswing shown - Inswing also approved

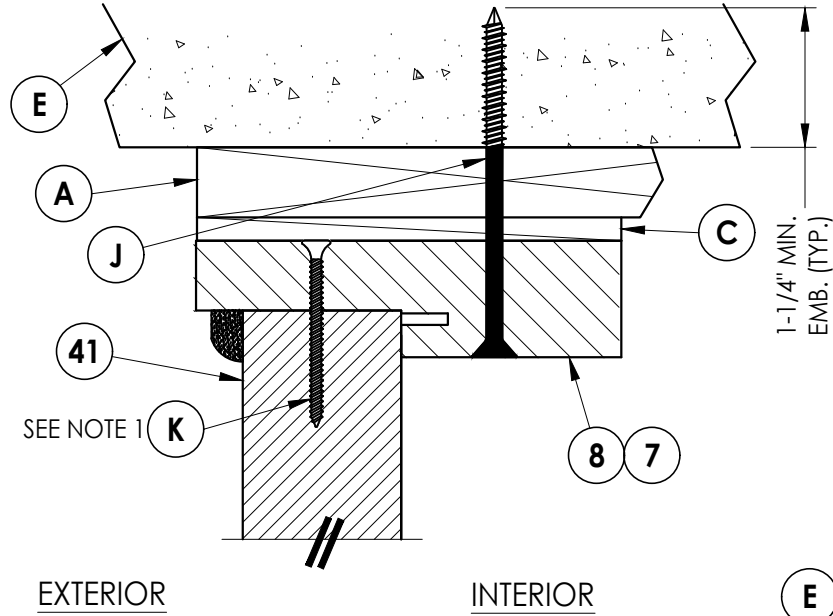


2 **VERTICAL CROSS SECTION**
5 Shown w/1X sub-buck


NOTE
1. SCREWS THRU FRAME & THRESHOLD INTO
SIDELITE PANEL LOCATED 6" FROM CORNERS
OF SIDELITE AND @ CENTERLINE OF SIDELITE.

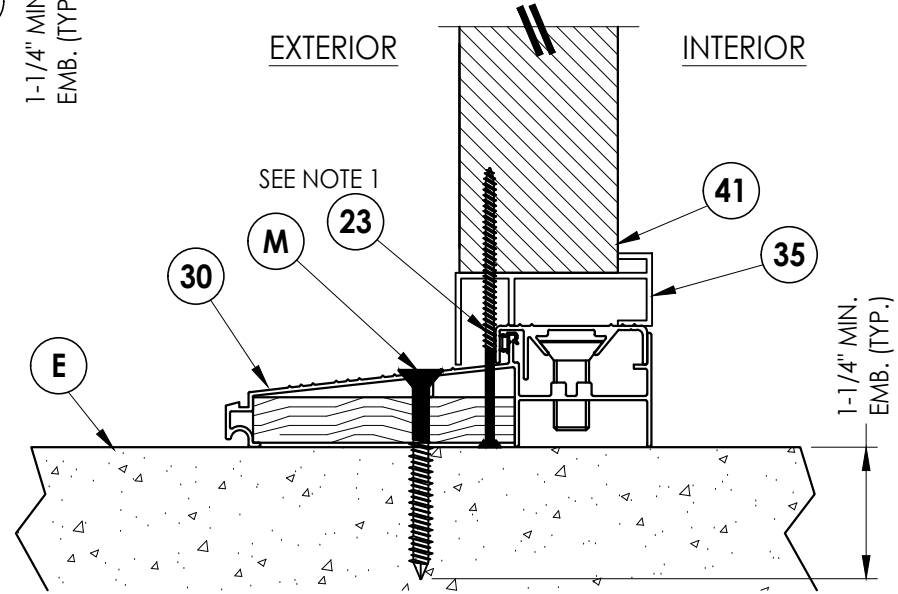


5 **VERTICAL CROSS SECTION**
5 Inswing configuration

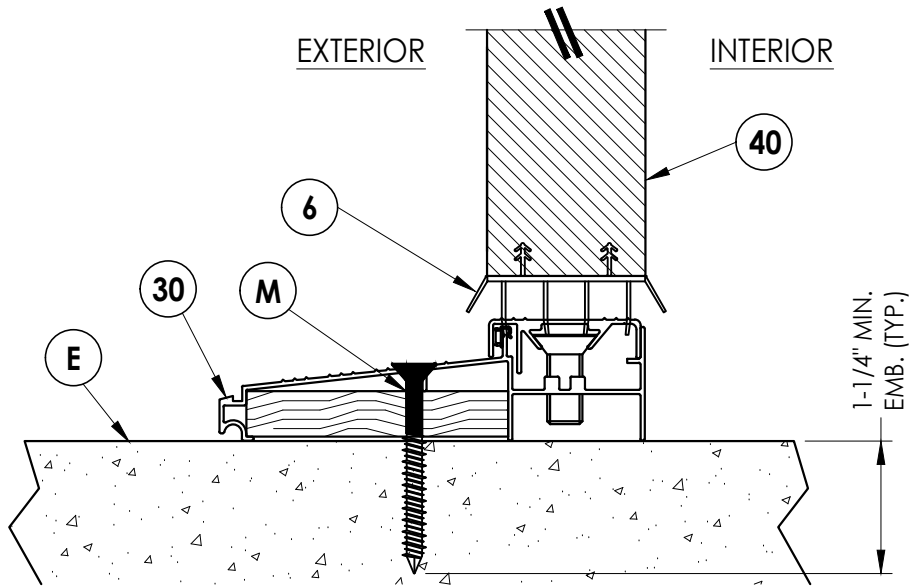

3 **VERTICAL CROSS SECTION**
5 Inswing configuration

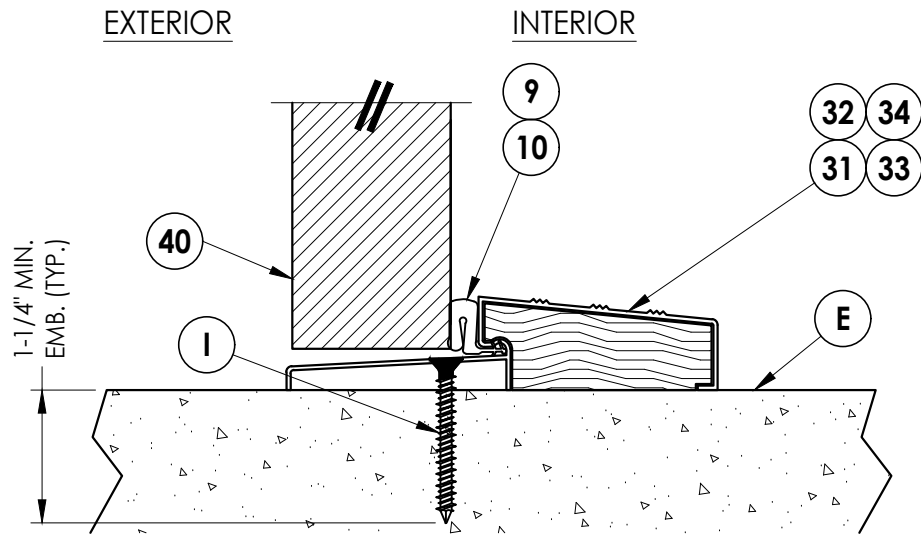

4 **VERTICAL CROSS SECTION**
5 Outswing configuration

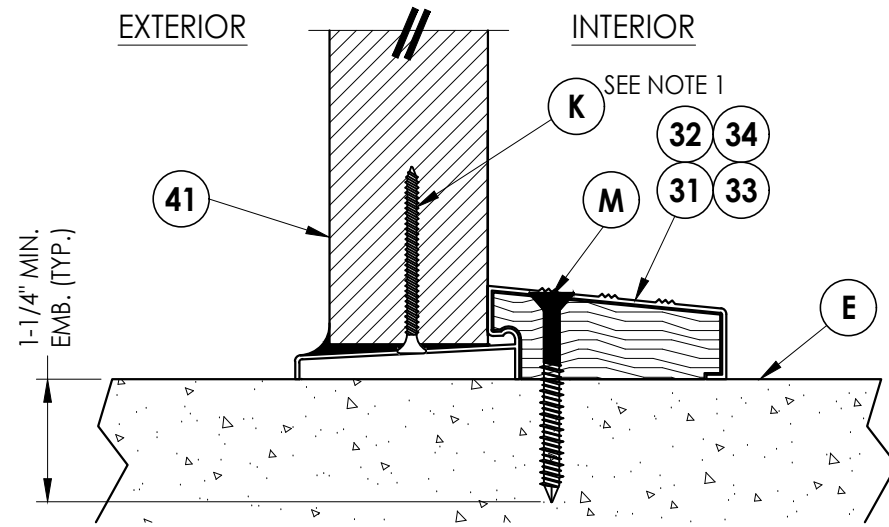

6 **VERTICAL CROSS SECTION**
5 Outswing configuration

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TAYLOR DOORS

PART OR ASSEMBLY:
VERTICAL
CROSS SECTIONS

NO.	DATE	REVISIONS				
		BY	JK	LFS	JK	LFS
6	7/03/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS	
5	7/06/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS	
4	7/20/20	UPDATE TO 7TH ED.	(2020)	FBC	LFS	
3	7/20/17	UPDATE TO 6TH ED.	(2017)	FBC	JK	
2	3/03/15	UPDATE TO 5TH ED.	(2014)	FBC	LFS	
1	1/17/12	UPDATE TO 2010 FBC			JK	

DATE: 6/17/08

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-9542.2

SHEET 5 OF 8

Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg

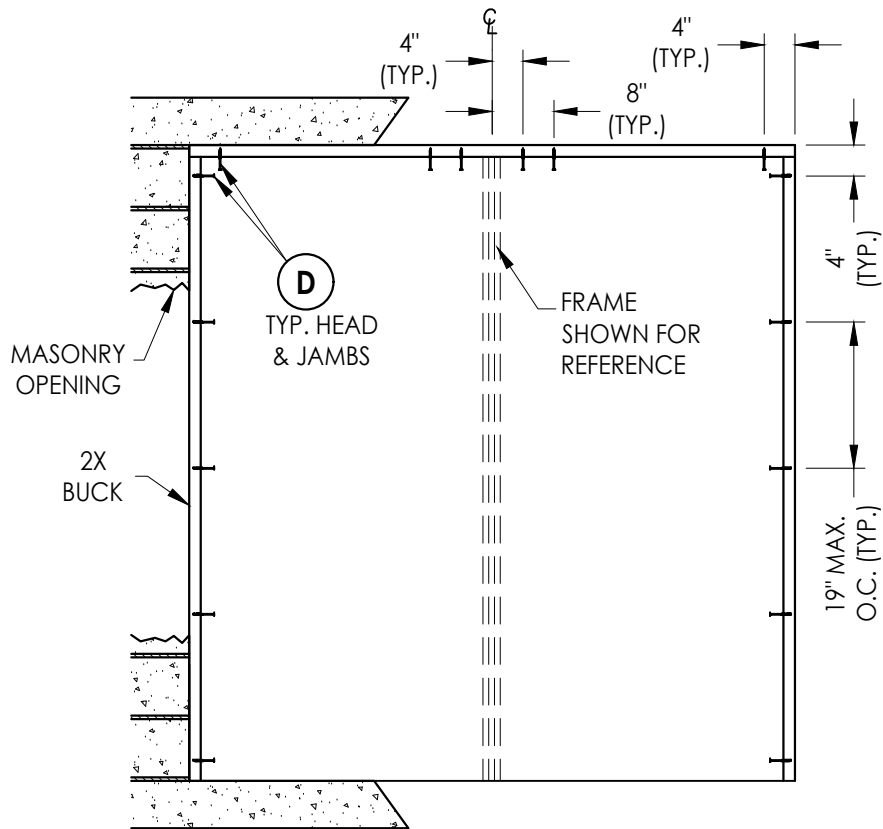

BUCK ANCHORING

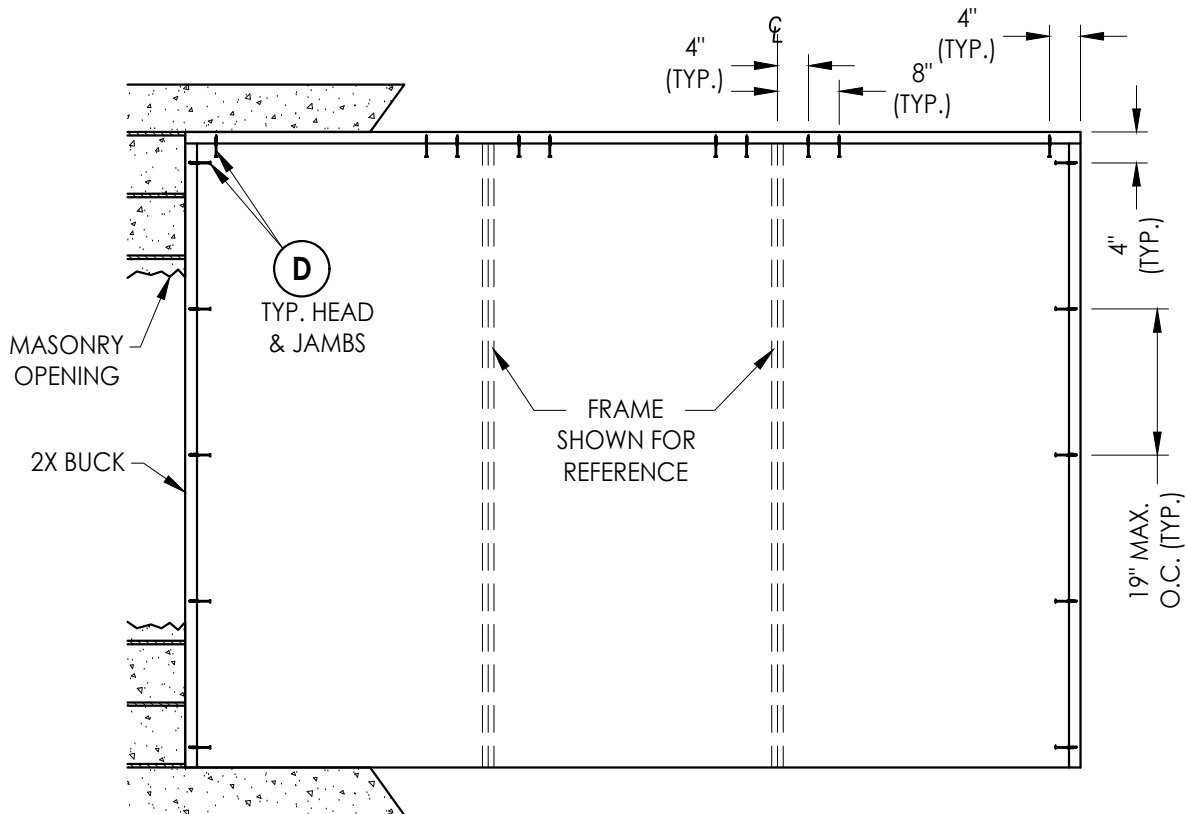

BUCK ANCHORING

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TALLYOR DOORS

PART OR ASSEMBLY:
BUCK ANCHORING

NO.	DATE	REVISIONS
6	7/03/26	UPDATE TO 9TH ED. (2026) FBC
5	7/06/23	UPDATE TO 8TH ED. (2023) FBC
4	7/20/20	UPDATE TO 7TH ED. (2020) FBC
3	7/20/17	UPDATE TO 6TH ED. (2017) FBC
2	3/03/15	UPDATE TO 5TH ED. (2014) FBC
1	1/17/12	UPDATE TO 2010 FBC
NO.	DATE	BY

DATE: 6/17/08

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-9542.2


SHEET 6 OF 8

Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg

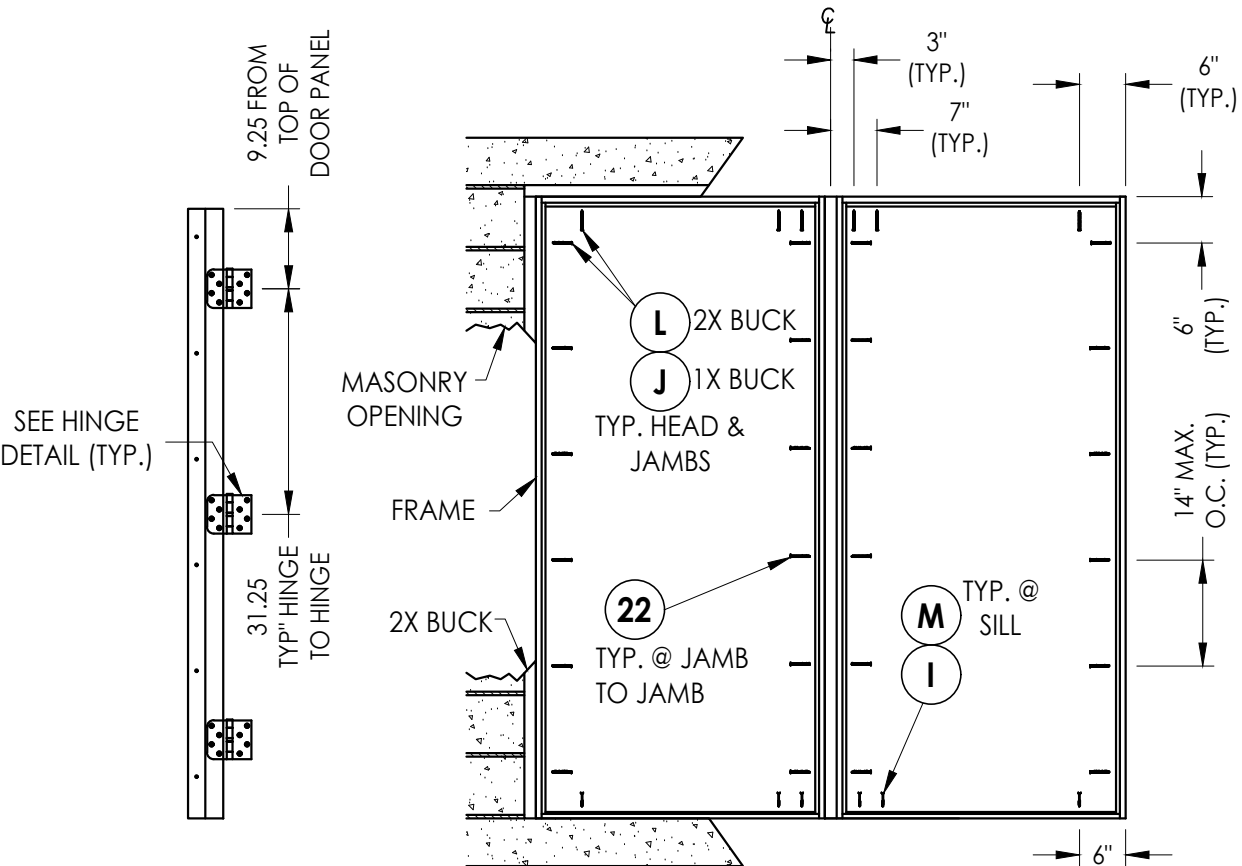

HINGE JAMB

FRAME ANCHORING

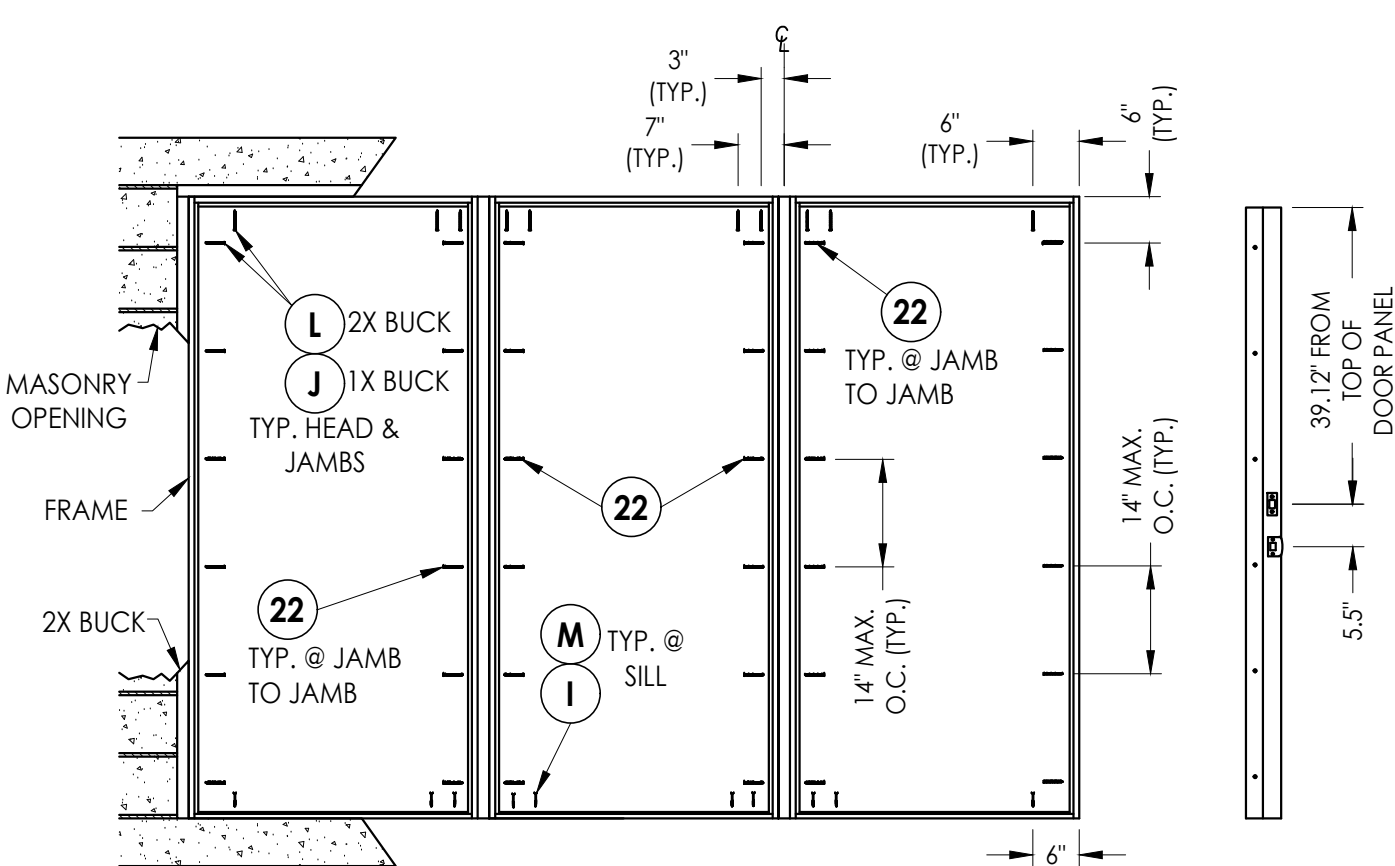

FRAME ANCHORING

STRIKE JAMB


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

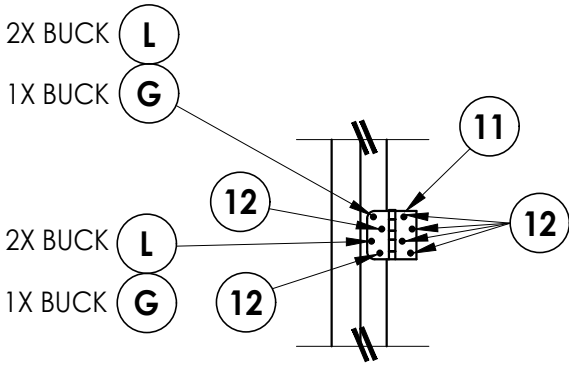

HINGE DETAIL

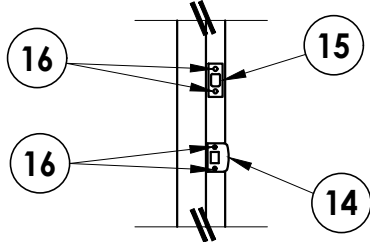

LATCH & DEADBOLT DETAIL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
TALYOR DOORS

PART OR ASSEMBLY:
FRAME ANCHORING

NO.	DATE	REVISIONS
6	7/03/26	UPDATE TO 9TH ED. (2026) FBC
5	7/06/23	UPDATE TO 8TH ED. (2023) FBC
4	7/20/20	UPDATE TO 7TH ED. (2020) FBC
3	7/20/17	UPDATE TO 6TH ED. (2017) FBC
2	3/03/15	UPDATE TO 5TH ED. (2014) FBC
1	1/17/12	UPDATE TO 2010 FBC

DATE: 6/17/08

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-9542.2


SHEET 7 OF 8

Z:\2023 FBC Drawings\Taylor Entrance Systems\FL-9542 R6\FL-9542.1-3.dwg


BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.55)	WOOD
B	2X BUCK (G >= 0.55)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
K	#7 X 2" PFH DRYWALL SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	1/4" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
6	DOOR BOTTOM SWEEP	VINYL
7	JAMB (POLYFIBER)	COMP.
8	JAMB (PINE)	WOOD
9	MEDIUM REACH COMPRESSION WEATHERSTRIP (TAYLOR DOORS)	FOAM
10	LONG REACH COMPRESSION WEATHERSTRIP (TAYLOR DOORS)	FOAM
11	HINGE	STEEL
12	#10 X 3/4" PFH WOOD SCREW	STEEL
14	LATCH STRIKE PLATE	STEEL
15	DEADBOLT STRIKE PLATE	STEEL
16	#8 X 2-1/2" PFH WOOD SCREW	STEEL
21	2X MULLION REINFORCEMENT (G >= 0.42)	WOOD
22	#10 X 3" PFH WOOD SCREW	STEEL
23	#6 X 3" PFH WOOD SCREW	STEEL
30	INSWING THRESHOLD (BY DLP)	ALUM./WOOD
31	OUTSWING THRESHOLD (QOS BY DLP)	ALUM./WOOD
32	OUTSWING THRESHOLD (QOSH BY DLP)	ALUM./WOOD
33	OUTSWING THRESHOLD (BY COMBO)	ALUM./WOOD
34	OUTSWING THRESHOLD (OSHC BY DLP)	ALUMINUM
35	INSWING SIDELITE ADAPTER	PVC
40	DOOR - SEE DOOR PANEL DETAIL SHEET FOR DETAILS	-
41	SIDELITE - SEE DOOR PANEL DETAIL SHEET FOR DETAILS	-




6 SWEEP

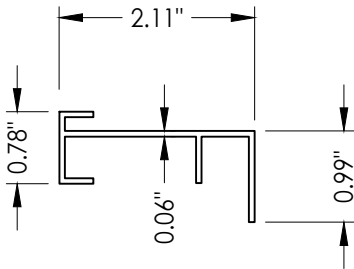


35 SIDELITE ADAPTER

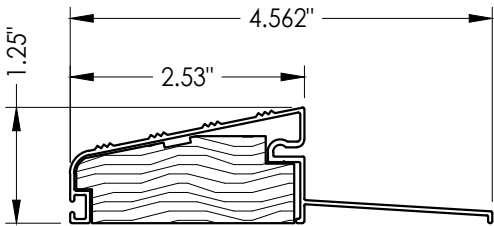


32 OUTSWING THRESHOLD
QOSH

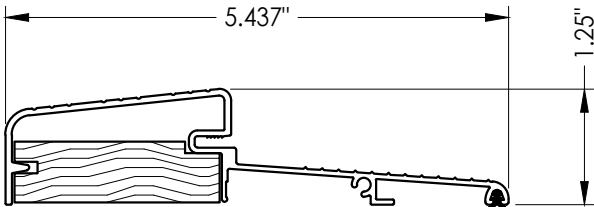


33 OUTSWING THRESHOLD
By Combo

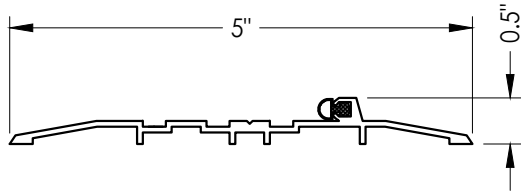


34 OUTSWING THRESHOLD
OSHC

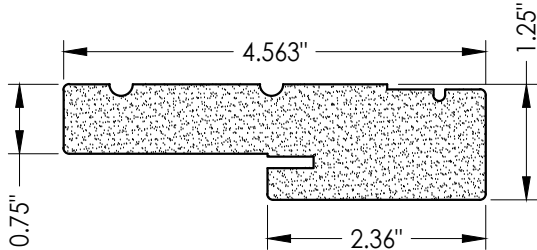


7 HEAD & SIDE
Jamb (Polyfiber)

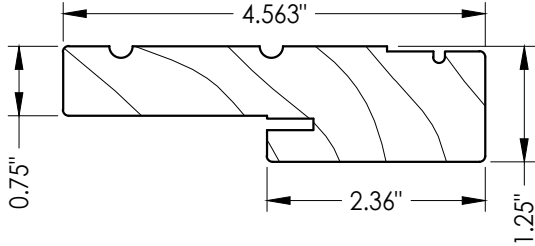

8 HEAD & SIDE
Jamb (wood)

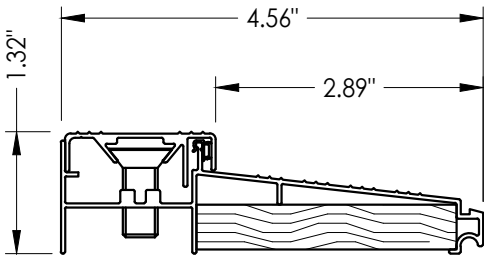

30 INSWING THRESHOLD

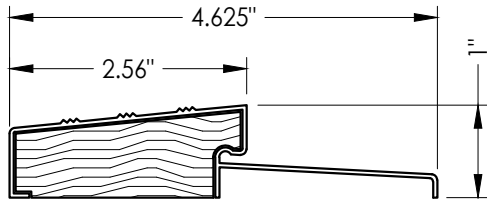

31 OUTSWING THRESHOLD
QOS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: TAYLOR DOORS				PART OR ASSEMBLY: BILL OF MATERIALS & COMPONENTS			
6	7/03/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	REVISIONS		
5	7/06/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
4	7/20/20	UPDATE TO 7TH ED. (2020)	FBC	LFS			
3	7/20/17	UPDATE TO 6TH ED. (2017)	FBC	JK			
2	3/03/15	UPDATE TO 5TH ED. (2014)	FBC	LFS			
1	1/17/12	UPDATE TO 2010 FBC	JK	JK			
NO.	DATE						
DATE: 6/17/08							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-9542.2							
SHEET 8 OF 8							