


GENERAL NOTES

1. THE PRODUCT SHOWN HEREIN CONSTRUCTED FROM EXTRUDED RIGID PVC FRAMES HAS BEEN TESTED TO AAMA/WDMA/CSA 101/I.S.2/A440-11, AND MEETS THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, 8TH EDITION (2023), FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE.
2. THIS PRODUCT IS NON-IMPACT RESISTANT AND REQUIRES THE USE OF IMPACT PROTECTIVE DEVICES (SHUTTERS) IN WINDBORNE DEBRIS REGIONS.
3. THE DESIGN PRESSURES INDICATED IN THIS DRAWING ARE AS LIMITED BY TESTED WATER AND STRUCTURAL PRESSURES. INSTALLED GLAZING SHALL MEET ASTM E 1300 FOR PROJECT REQUIRED DESIGN PRESSURES.
4. THIS DOCUMENT ADDRESSES PRODUCT ANCHORAGE TO ACHIEVE THE INDICATED DESIGN PRESSURES AT THE INDICATED SIZES, IN THE CONFIGURATION SHOWN IN THE ELEVATIONS. INSTALL PRODUCTS WITH MAXIMUM SHIM GAP, MINIMUM EDGE DISTANCE AND EMBEDMENT, AND WITH FASTENER TYPE AS SHOWN IN THE DETAILS AND/OR AS INDICATED IN TABLE 1. FOR FULL PRODUCT CONSTRUCTION DETAILS SEE TEST REPORTS CTLA 3026W AND BECS 20240233.3.01.
5. THE 4/3 ALLOWABLE STRESS INCREASE FACTOR (SHORT-TERM INCREASE FACTOR) HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF ANCHORAGE INTO WOOD SUBSTRATE.
6. THE OPENING SUBSTRATE MATERIALS (FRAMING, MASONRY, BUCKS) AND ATTACHMENT OF BUCKS TO THE SUBSTRATE ARE BY OTHERS AND SHALL BE VERIFIED BY THE ARCHITECT OR ENGINEER OF RECORD OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION (AHJ). BUCKING, OPENINGS, & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED BY OTHERS IN ACCORDANCE WITH THE FBC TO TRANSFER SUPERIMPOSED LOADS TO THE STRUCTURE. WITH MASONRY OPENINGS, WOOD BUCKS ARE OPTIONAL.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE COATED OR OTHERWISE PROTECTED TO PREVENT GALVANIC REACTIONS. WOOD BUCKS, IF USED, SHALL BE PRESSURE TREATED, WITH EITHER A TREATMENT OR COATING COMPATIBLE WITH THIS PRODUCT.
8. ALL ANCHORS USED SHALL BE OF A MATERIAL OR HAVE A COATING COMPATIBLE WITH THE PRESSURE TREATED WOOD BUCKS AND ALL OTHER WINDOW MATERIALS.
9. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS, OR AS APPROVED, SIGNED, AND SEALED BY A FLORIDA REGISTERED PROFESSIONAL ENGINEER ON A SITE-SPECIFIC BASIS.
10. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT SHALL BE THE RESPONSIBILITY OF OTHERS AND ARE NOT ADDRESSED BY THIS DOCUMENT.

6060 SINGLE HUNG TWIN WINDOW WITH FIN, NON-IMPACT

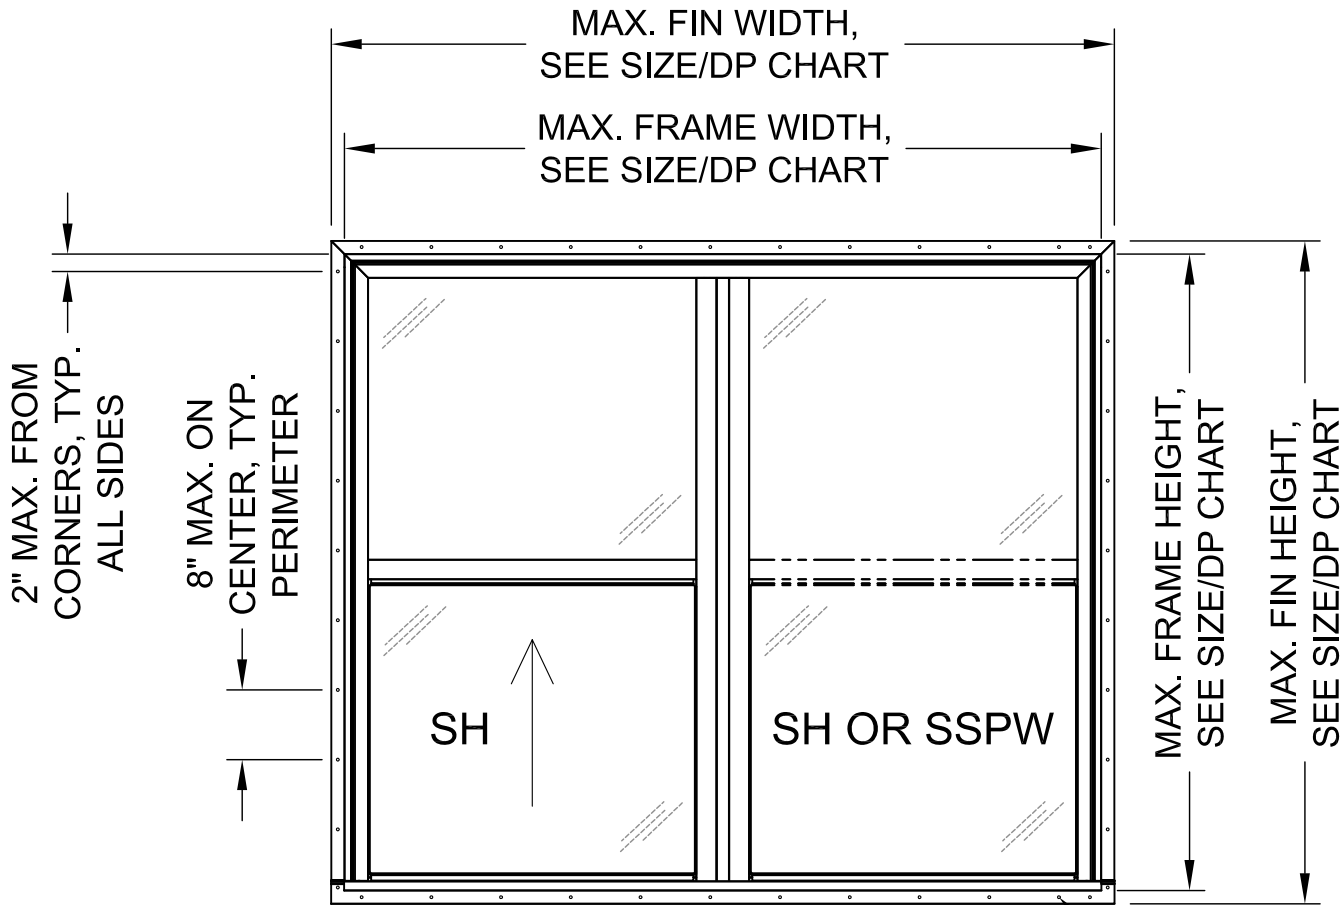

ELEVATION - FIN INSTALLATION

#10 WOOD SCREW
INSTALLATION
FASTENER
LOCATION, TYP.

SERIES 6060 SIZE/DP CHART

CONFIG.	MAX. FIN SIZE	MAX. FRAME SIZE	MAX. SASH SIZE	DESIGN PRESSURE RATING
SH SH	73-3/4" X 76-5/8"	71-1/4" X 73-1/2"	33" X 36"	+50/-50 PSF
SH SSPW	74-1/2" X 75-1/8"	72" X 72"	33-5/16" X 34-7/8"	+40/-40 PSF

Lucas Turner
2026.04.17
14:16:55
-05'00'

MGM

INDUSTRIES

287 FREE HILL ROAD | HENDERSONVILLE, TN 37075

SHEET DESCRIPTION: NOTES, FIN ELEVATION	DATE DRAWN: 3/5/2026
SCALE: NTS	REV: 0
DRAWING: FPA-MGM-SH-TWIN	SHEET: 1 OF 4

LUCAS A. TURNER


LICENSE

No. 58201


STATE OF FLORIDA

PROFESSIONAL ENGINEER

3/6/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320
Ph. 941-380-1574

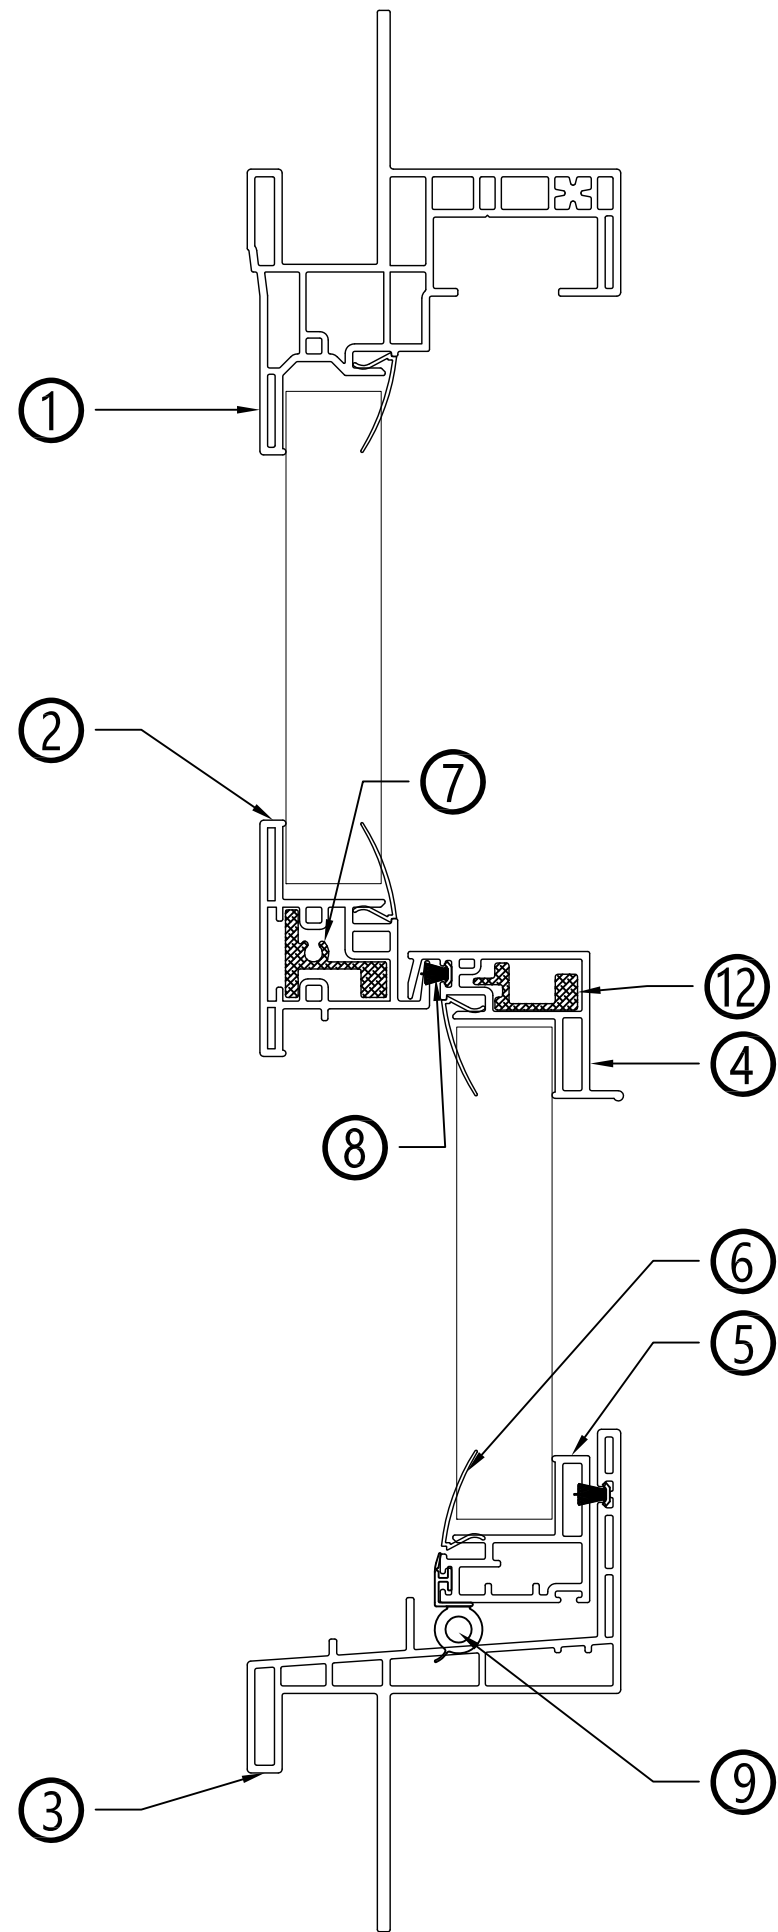

TYP. VERTICAL SECTION, SH

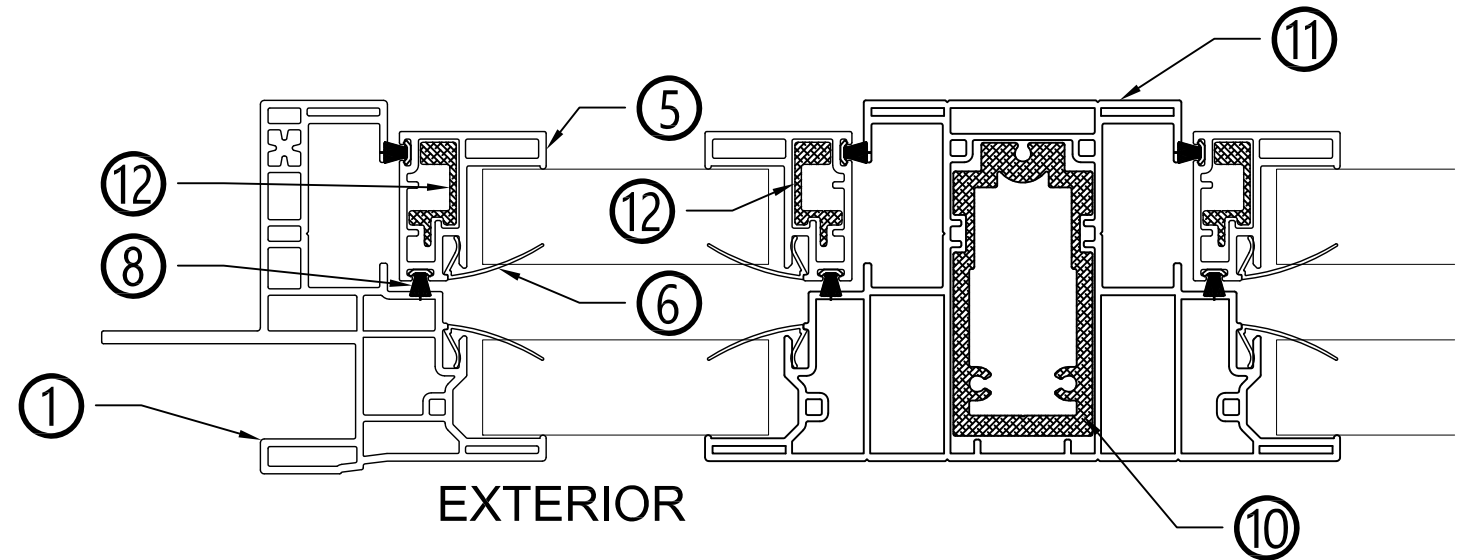

**TYP. HORIZ. SECTION
SH JAMB**

**TYP. HORIZ. SECTION
SH/SH MULLION**

- ① JAMB&HEAD 601
- ② CENTER MEETING RAIL 606
- ③ SILL 600
- ④ LOCK RAIL 607
- ⑤ SASH STILE 608
- ⑥ GLAZING BEAD 716
- ⑦ REINF MGM-034
- ⑧ WEATHER STRIP
- ⑨ BULB SEAL
- ⑩ MGM-021
- ⑪ MULL 609
- ⑫ REINF MGM-015



287 FREE HILL ROAD | HENDERSONVILLE, TN 37075

SHEET DESCRIPTION:
SECTION DETAILS

SCALE: NTS

DRAWING: FPA-MGM-SH-TWIN


DATE DRAWN:
3/5/2026

REV: 0


SHEET: 2 OF 4



3/6/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320
Ph. 941-380-1574

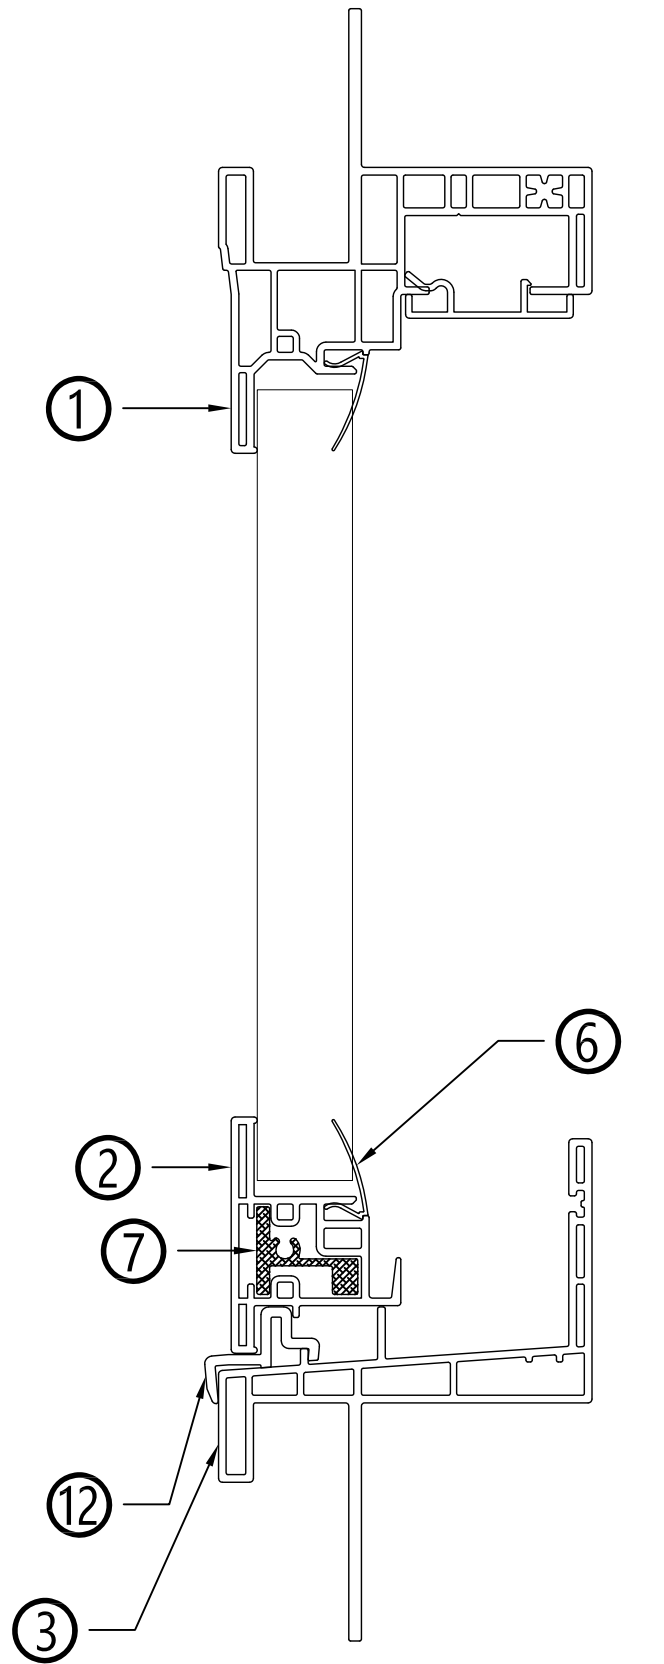

TYP. VERTICAL SECTION, SSPW

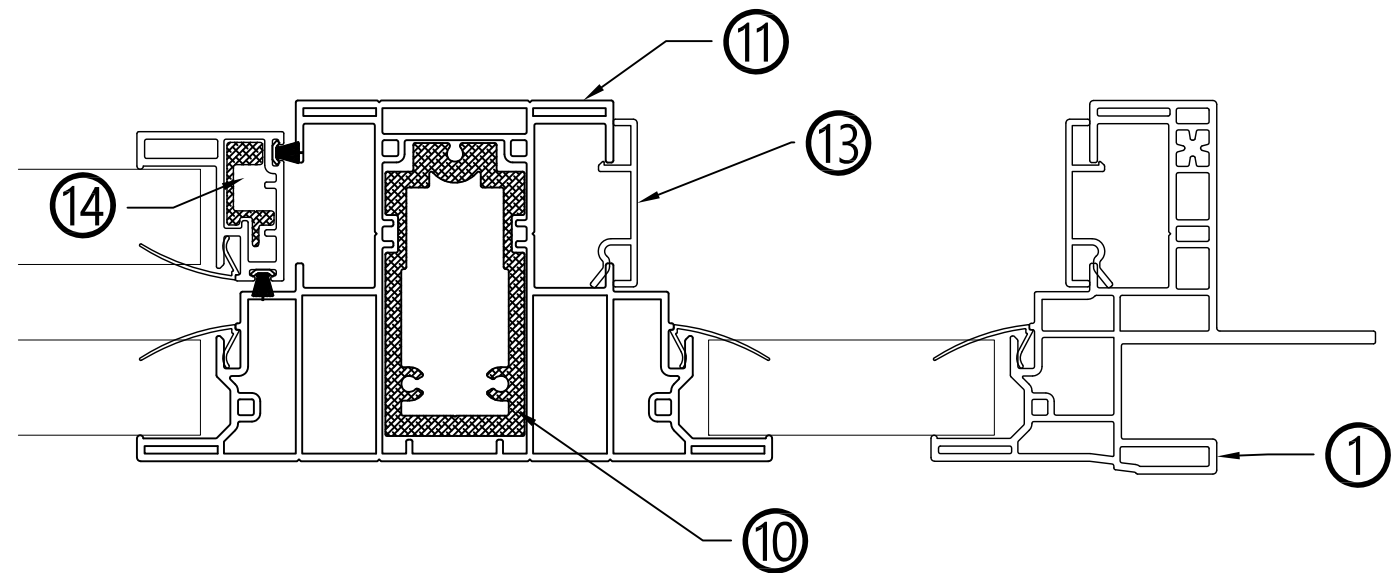

**TYP. HORIZ. SECTION
SH|SSPW MULLION**

**TYP. HORIZ. SECTION
SSPW JAMB**

- ① JAMB&HEAD 601
- ② CENTER MEETING RAIL 606
- ③ SILL 600
- ⑥ GLAZING BEAD 716
- ⑦ REINF MGM-034
- ⑩ MGM-021
- ⑪ MULL 609
- ⑫ PEDESTAL 6033
- ⑬ SASH STOP 717
- ⑭ REINF MGM-015




287 FREE HILL ROAD | HENDERSONVILLE, TN 37075


SHEET DESCRIPTION: SECTION DETAILS	DATE DRAWN: 3/5/2025
SCALE: NTS	REV: 0
DRAWING: FPA-MGM-SH-TWIN	SHEET: 3 OF 4



3/6/2026
 Lucas A. Turner, P.E.
 FL PE #58201
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 Ph. 941-380-1574

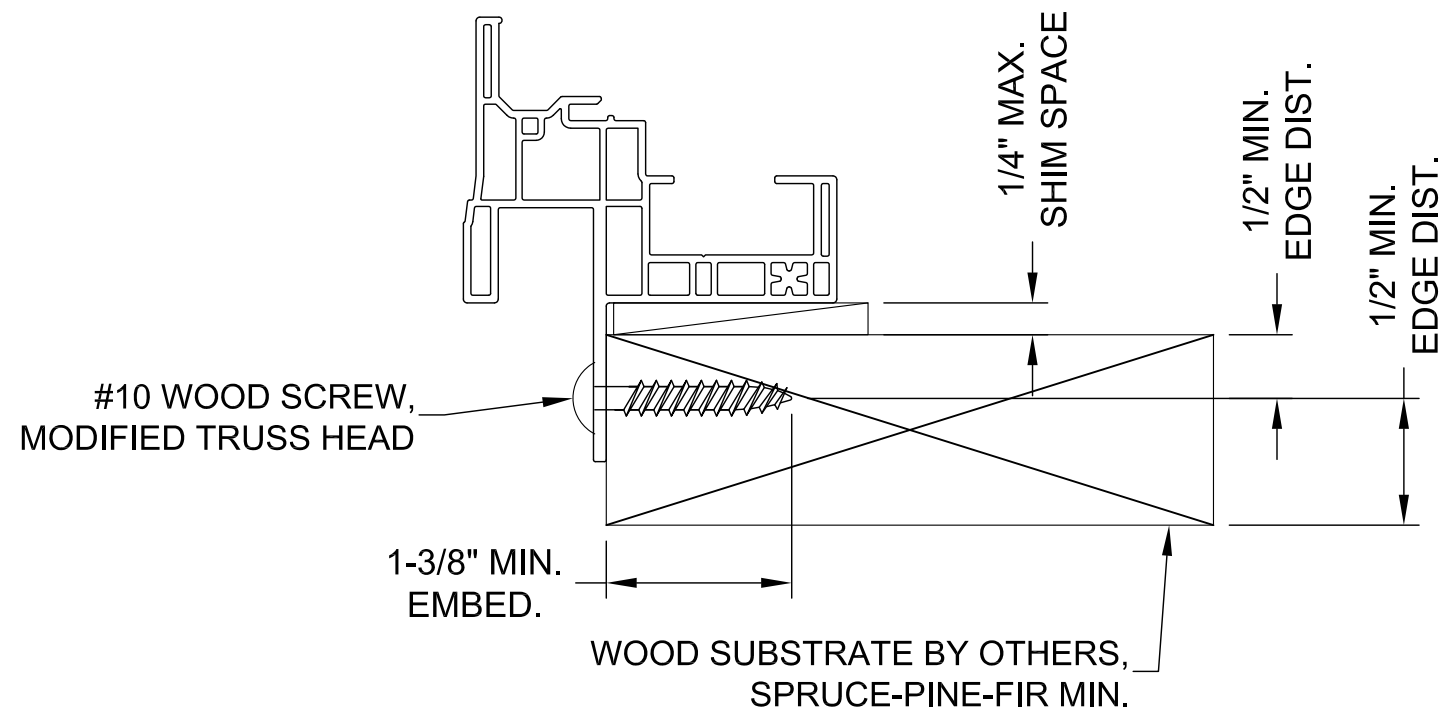

TYP. FIN INSTALLATION
HEAD/JAMB, SH AND SSPW

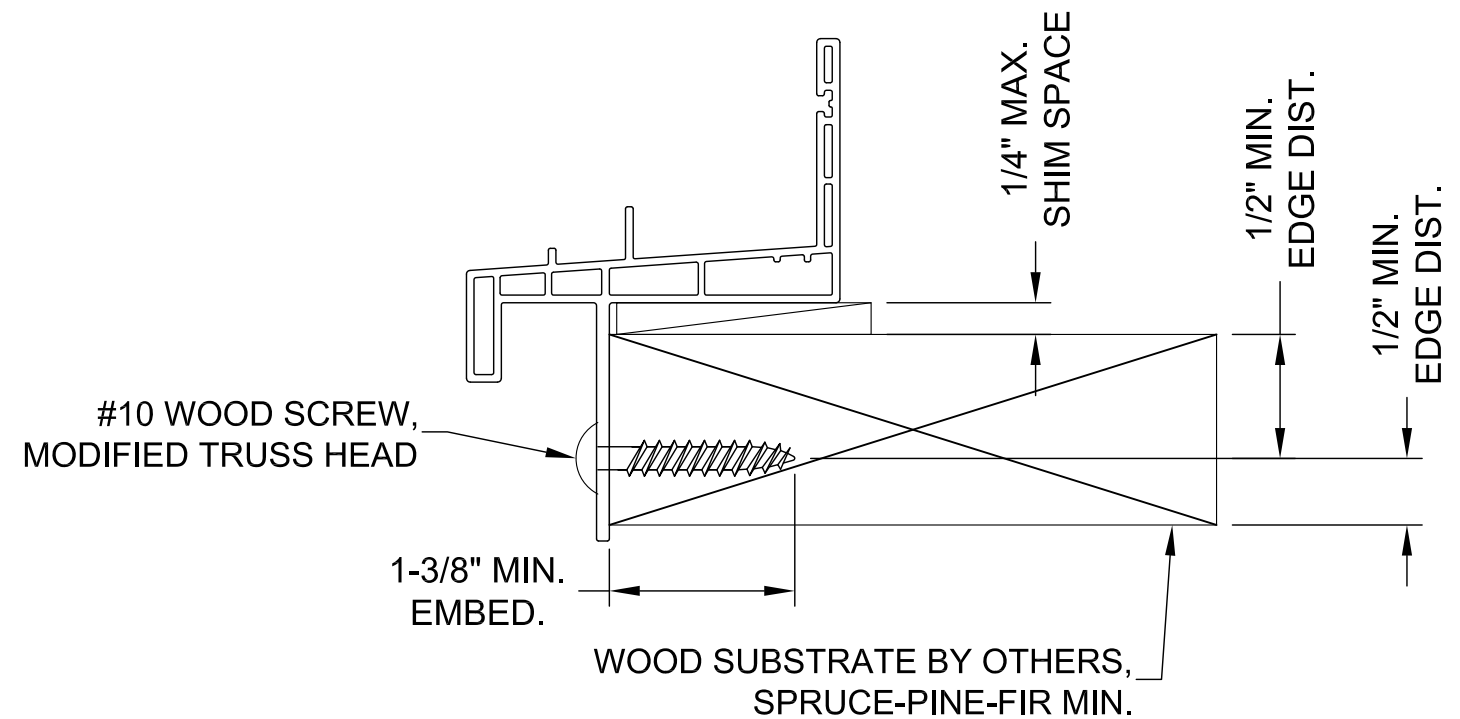

TYP. FIN INSTALLATION
SILL, SH AND SSPW



287 FREE HILL ROAD | HENDERSONVILLE, TN 37075

SHEET DESCRIPTION:
INSTALLATION DETAILS

SCALE: NTS

DRAWING: FPA-MGM-SH-TWIN

DATE DRAWN:
3/5/2025

REV: 0

SHEET: 4 OF 4



3/6/2026
Lucas A. Turner, P.E.
FL PE #58201
2428 Old Natchez Trc Trl
Camden, TN 38320
Ph. 941-380-1574