



NATIONAL CERTIFIED TESTING LABORATORIES

FIVE LEIGH DRIVE • YORK, PENNSYLVANIA 17406 • TELEPHONE (717) 846-1200
FAX (717) 767-4100
www.nctlinc.com

October 30, 2020

Dan Vezo
JELD-WEN, Inc.
3737 Lakeport Blvd
Klamath Falls, Oregon 97601

RE: Equivalence of ASTM E283-99 and ASTM E283-04(2012)

Dear Mr. Vezo:

At your request, I have reviewed the ASTM standard test method used for your product approvals to evaluate its equivalence to the same standard test method referenced by the Florida Building Code, Building, 7th Edition (2020). Specifically, I am comparing:

ASTM E283-99 Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen.

ASTM E283-04(2012) Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen. (Reference standard of 2020 FBC).

Noted differences between the standards include:


1. An explicit calibration method has been added to the current standard. However, the calibration intervals and conditions of acceptance are the same for both versions of the test method.

The noted differences do not affect the test specimen requirements or test methods or diminish the interpretation of results. It is my professional opinion that the standard specifications are equivalent.

NATIONAL CERTIFIED TESTING LABORATORIES, INC.

Joseph A. Reed, PE
FL PE 58920
FL REG 33474

cc: 23549-1

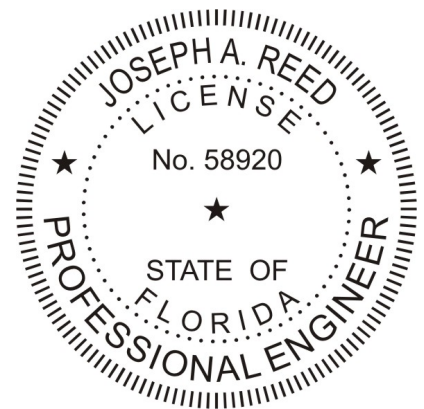

2020.10.30 08:56:41 -04'00'