

Equivalency Evaluation Report

Report No. ACE-EER-1253, Rev. 0 | Project No. ACE-2026-141 | 9/2/26 | Page 1 of 3

<u>Product Manufacturer</u>	<u>Product Name, Model and/or Description</u>
New Era Door Corp. dba Custom Door and Millwork 2787 N. Airport Rd., Unit No. 410 Fort Myers, Florida 33907	Impact Double Glazed Doors with Transom – Outswing and Inswing Impact Double Opaque Entry Door – Outswing and Inswing

Code: Current Edition of the Florida Building Code including the 9th Edition (2026) Florida Building Code

Compliance Methods: Product Approval Rule 61G20-3.015(5)(d) – Equivalency of Standards

- Impact Double Glazed Doors with Transom – Outswing and Inswing
 - CDM0003, Rev. F, dated 9/2/26 signed and sealed by Robert J. Amoruso, Custom Door and Millworks, Impact Double Glazed Door with Transom – Outswing and Inswing – Installation Anchorage Details
 - CTLA 1850W-1, dated September 09, 2008
- Impact Double Opaque Entry Door – Outswing and Inswing
 - CDM0004, Rev. F, dated 9/2/26, signed and sealed by Robert J. Amoruso, Custom Door and Millworks, Impact Double Opaque Entry Door – Outswing and Inswing – Installation Anchorage Details
 - CTLA 1850W, dated September 09, 2008

Performance Standards (used in testing):

- ASTM E330-02, Test Method for Structural Performance of Exterior Windows, Curtain Walls, and Doors by Uniform Static Air Pressure Difference.
- ASTM E331-00, Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference.
- ASTM E547-00, Water Penetration of Exterior Windows and Doors by Static Air Pressure Difference.
- ASTM E283-04, Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen
- ASTM E1886-05, Standard Test Method for Performance of Exterior Windows, Glazed Curtain Walls, Doors, and Storm Shutters Impacted by Missiles and Exposed to Cyclic Pressure Differentials.
- ASTM E1996-05, Standard Specification for Performance of Exterior Windows, Curtain Walls, Doors, and Storm Shutters Impacted by Windborne Debris in Hurricanes.

Equivalency Evaluation:

The following table shows the performance standards used in testing and those in the current edition of the FBC.

Amoruso Consulting Engineering, LLC
FBPE Registration No. 38327
Robert J. Amoruso, FL P.E. No. 49752

226 N. Nova Rd., #142
Ormond Beach, FL 32174
rjaengpe@gmail.com

Equivalency Evaluation Report

Report No. ACE-EER-1253, Rev. 0 | Project No. ACE-2026-141 | 9/2/26 | Page 2 of 3

Standard Used in Testing		Current Edition of the Florida Building Code including the 9th Edition (2026) Florida Building Code		Comments
Description	Revision Level	Building Volume (FBC)	Residential Volume (FRC)	
ASTM E330	02	14(2021)	14(2021)	See Evaluation Below
ASTM E547	00	Not in code	Not in code	
ASTM E331	00	00 (2023)	00 (2023)	
ASTM E283	04	04 (2012)	04 (2012)	
ASTM E1886	05	13a	13a	
ASTM E1996	05	17	17	

The AAMA and ASTM Standards listed above and used in testing have been compared to their current revision levels in the 9th Edition (2026) Florida Building Code and found to be acceptable. Changes in the current revisions do not affect the results obtained using previous versions of the reference standard.

ASTM E1996 Testing Evaluation:

- 1) Wind Zone 4 testing
 - a. ASTM E1996-14 moved Wind Zone 4 criteria to the non-mandatory appendix. As indicated in Appendix X4.1, ASTM E1996-17 the Wind Zone 4 requirement, though non-mandatory, is still present and may be specified when needed to meet specific building codes requirements. Those requirements are detailed in Sections 1609.1.2.2, 1609.1.2.4 and 1609.3 of the Florida Building Code. Based on a review of the test reports, those parameters are met.
- 2) The Missile Level and Impact Speed used in testing are consistent with those currently required by the Florida Building Code and ASTM E1996.
- 3) The static load (ASTM E330) and cyclic load (ASTM E1886/E1996) parameters used in testing are consistent with those currently required by the Florida Building Code.


Equivalency Evaluation Report

Report No. ACE-EER-1253, Rev. 0 | Project No. ACE-2026-141 | 9/2/26 | Page 3 of 3

Certificate of Independence per Product Approval Rule 61G20-3.009

Robert J. Amoruso, P.E., does not have, nor will acquire, any financial interest in the company manufacturing or distributing product(s) covered by this Product Evaluation Report.

Robert J. Amoruso, P.E., does not have, nor will acquire any financial interest in any other entity involved in the approval process or testing of the product(s) covered by this Product Evaluation Report.

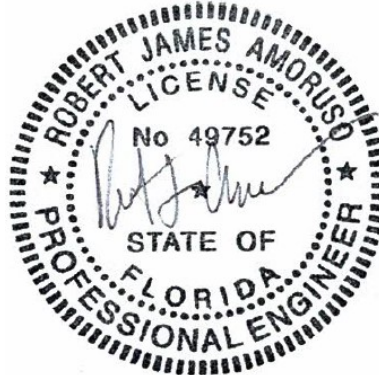

Digitally signed
by Robert J
Amoruso
Date:
2026.10.07
15:26:30 -04'00'

Evaluated by:
Robert J. Amoruso, P.E.
FL P.E. License No. 49752

Amoruso Consulting Engineering, LLC
FBPE Registration No. 38327
Robert J. Amoruso, FL P.E. No. 49752

226 N. Nova Rd., #142
Ormond Beach, FL 32174
rjaengpe@gmail.com