



August 26, 2020

Product Approval Administrator
DBPR Codes and Standards
2601 Blair Stone Road
Tallahassee, FL 32399

Regarding: Crawford Tracey Corporation
Pro-Tech 4SG Structurally Glazed System – Non-Impact
FL #15273.1 – EX 20-29758

To Whom It May Concern:


This office has reviewed the test reports detailing the structural performance of the above referenced product. These test reports pertain to testing that is in accordance with the standards listed in the table shown below, on the left-hand column. These noted standards are not adopted in the Florida Building Code Seventh Edition (2020); however, for the purpose of determining the performance of this product, these standards are equivalent to the corresponding standards on the right-hand column, which are adopted standards in the above referenced building code. The combination of these test standards is equivalent to AAMA 501-05 and is compliant with section 1709.8.4 of the Florida Building Code Seventh Edition (2020).

Code Title	Tests Performed according to:	Current Equivalent Standard
Test Method for Structural Performance of Exterior Windows, Curtain walls, and Doors by Uniform Static Air Pressure Difference	ASTM E330-02	ASTM E330/E330M-02
Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference	ASTM E331-00	ASTM E331-00(2009)
Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specific Pressure Difference Across the Specimen	ASTM E283-04	ASTM E283-04(2012)

Respectfully,



Frank L. Bennardo, P.E.
ENGINEERING EXPRESS®
#PE0046549 | Cert. Auth. 9885

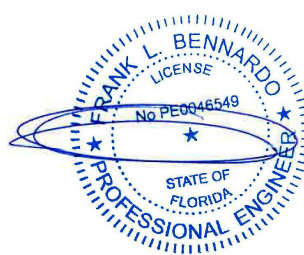

Digitally signed by
Frank Bennardo
Date: 2020.08.26
11:51:13 -04'00'