

TESTING EQUIVALENCY LETTER

Florida Department of Business & Professional Regulation
Building Codes and Standards
1940 North Monroe Street,
Tallahassee, Florida 32399

October 12, 2020

MANUFACTURER:

Aldora Aluminum & Glass Products, Inc.
11500 Miramar Pkwy, Suite 300
Miramar, Fl. 33025

PRODUCT:

Aldora
TCW-250 Product Line

To Whom It May Concern,

We are submitting the Aldora TCW-250 line of glazing products for Florida Product approval.

Previously, these products were approved under the Miami Dade NOA approval and three bays were tested under protocols of TAS 201-94, TAS 202-94, and TAS 203-94.

Please be advised that TAS 202-94 is more stringent than AAMA 501-15 and therefore this product complies with AAMA 501-15 as follows:

The AAMA 501-15 series of tests assesses the products in this order:

- 1) Air Leakage,
- 2) Water Penetration,
- 3) Structural Performance.


While the TAS 202-94 testing protocol is ordered:

- 1) Air Leakage,
- 2) Structural Performance,
- 3) Water Penetration.

The TAS 202-94 protocol tests for water intrusion after the structural performance test allowing for assessment of the product at a more compromised state than the AAMA 501-15 protocol. Under scrutiny the TAS 202-94 is an equivalent to AAMA 501-15 if not more stringent, and satisfies the purposes of the AAMA 501-15 protocol.

Sincerely,

William D. Cook, SECB
FL P.E. # 43904
FL S.I. # 2008

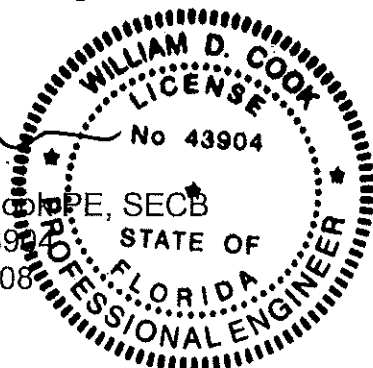

OCT 12 2020