



June 10, 2024

Product Approval Administrator
DBPR Codes and Standards
2601 Blair Stone Road
Tallahassee, FL 32399


Regarding: Special-Lite Inc.
AF-100 FRP Door- FL #19927.1 – EX # 24-73857

To Whom It May Concern:

This office has reviewed test report(s) showing structural performance of the above-noted product(s). These test report(s) pertain to testing performed in accordance with the referenced standard(s) in the table shown below. The noted standard(s) are not adopted in the Florida Building Code Eighth Edition (2023); however, for the purpose of determining the performance of the product, the standard(s) are equivalent to the corresponding standard(s), which are adopted in the above-referenced building code.

Code Title	Tests Performed according to:	Current Equivalent Standard
Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen.	ASTM E 283-04	ASTM E 283-19
Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference.	ASTM E 330-02	ASTM E 330-21
Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Uniform Static Air Pressure Difference.	ASTM E 331-00	ASTM E 331-16
Test Method for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Missile(s) and Exposed to Cyclic Pressure Differentials.	ASTM E 1886-05	ASTM E 1886-19
Specification for Performance of Exterior Windows, Curtain Walls, Doors, and Impact Protective Systems Impacted by Windborne Debris in Hurricanes.	ASTM E 1996-06	ASTM E 1996-20

Respectfully,

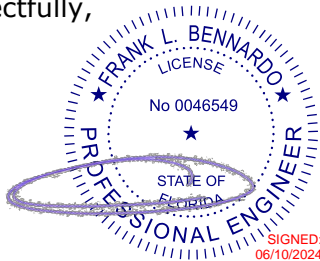

Frank Bennardo, P.E.
ENGINEERING EXPRESS®
#PE0046549 | Cert. Auth. 9885