



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**Allegion-Schlage Lock Company, LLC.
Louvered Outswing/Inswing Commercial Steel Single Doors
(Non-HVHZ) (Non-Impact)**

for

Florida Product Approval

FL# FL10356

Report No. 10346

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Louvered Outswing/Inswing Commercial Steel Single Doors
Door Material:	18 Ga. Min. Cold Rolled Steel
Product Dimensions:	See Installation Instructions LSDA330

Prepared for:

**Allegion-Schlage Lock Company, LLC.
11819 N. Pennsylvania Street
Carmel, IN 46032**

Prepared by:

Hermes F. Norero


Florida Professional Engineer # 73778

Date: 12/8/2025

Contents:

Evaluation Report Pages 1 – 4

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.12.10 18:49:58 -05'00'

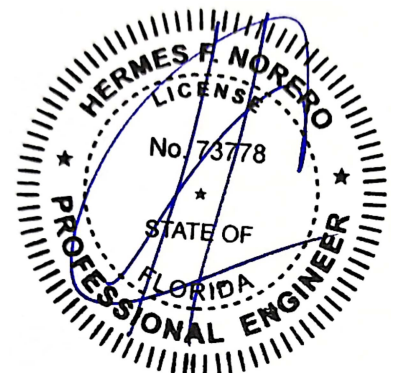

Hermes F. Norero, P.E.
Florida P.E. No. 73778

Manufacturer: Allegion-Schlage Lock Company, LLC.

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(d)

Product Name: Louvered Outswing/Inswing Commercial Steel Single Doors
(Non-HVHZ) (Non-Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Allegion-Schlage Lock Company, LLC.** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the Florida Building Code.

See Installation Instructions **LSDA330**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the Florida Building Code, **excluding** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the Florida Building Code and **does require** an impact resistant covering.
4. Site conditions that deviate from the details of Installation Instructions **LSDA330** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **LSDA330** for size and design pressure limitations.

Quality Assurance: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Intertek Testing Services NA, Inc. - QA Entity** (FBC Organization #: QUA1673).

Performance Standards: The product described herein has been tested per:

- ASTM E330-14

Referenced Data:

1. Product Testing performed by **UL LLC**
(FBC Organization # TST9628)
Report #: R3993-04CA16581, Report Date: 08/22/05
Report #: R3994-05NK08312, Report Date: 09/23/05
Report #: R3994-06NK07127, Report Date: 03/14/06
Report #: R26280-4787191722, Report Date: 08/22/05
2. Product Testing performed by **Element Materials Technology**
(FBC Organization # TST2613)
Report #: ESP01330P-1, Report Date: 04/16/13
Report #: ESP01330P-2, Report Date: 04/16/13
Report #: ESP011331P-2, Report Date: 12/01/06
3. Product Testing performed by **National Certified Testing Laboratories, Inc**
(FBC Organization # TST1589)
Report #: NCTL-210-3357-1, Report Date: 12/01/05
Report #: NCTL-210-3232-1, Report Date: 12/01/05
4. Product Testing performed by **Certified Testing Laboratories, Inc**
(FBC Organization # TST1577)
Report #: CTLA-882W-2, Report Date: 08/29/02
Report #: CTLA-1107W-2, Report Date: 9/05/03
5. Quality Assurance
Intertek Testing Services NA, Inc. - QA Entity
(FBC Organization # QUA1673)

Installation: Refer to Installation Instructions (**LSDA330**) for qualified installation methods and requirements.

Design Pressure: Refer to Installation Instructions (**LSDA330**) for design pressures dependent on hardware type, configuration, and size of units.

Equivalence of Test Standards:

Various test standards have been evaluated for differences in test methodology, if any, between tested editions of the test standards listed below and those editions referenced in the current Florida Building Code. The manufacturer has tested their products to the following test standard edition(s):

- 1) AASTM E330-02

Chapter 35 of the current Florida Building Code references the following editions of the above mentioned test standards:

- 1) ASTM E330-14

After review of the above-mentioned referenced standards and editions, it has been found that no significant technical changes have been made to the test standards that would affect the results. All referenced standards have been found to be equivalent.