



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Product Evaluation Report

of

**Windsor Windows and Doors
Pinnacle Clad Outswing Door
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL11517

Report No. 6877

Current Florida Building Code

Method:	1 – A (Certificate)
Category:	Exterior Door
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Pinnacle Clad Outswing Door
Material:	Wood and Aluminum
Product Dimensions:	See Installation Details WWD038

Prepared for:

**Windsor Windows and Doors
900 S. 19th Street
West Des Moines, IA 50265**


Prepared by:

Hermes F. Norero, P.E.

Florida Professional Engineer # 73778

Date: 02/09/2023

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2023.10.02 14:01:00 -0400

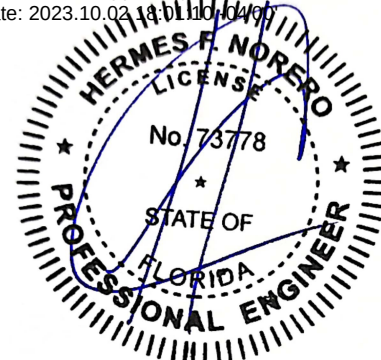

Contents:

Evaluation Report

Pages 1 – 3

 954.399.8478

 954.744.4738

 BUILDINGDROPS.COM

 CONTACT@BUILDINGDROPS.COM

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Manufacturer: Windsor Windows and Doors

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(a)

Product Name: Pinnacle Clad Outswing Door
(HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Windsor Windows and Doors** based on Method 1a of the State of Florida Product Approval, Florida Department of Business & Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **WWD038**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not** require an impact resistant covering.
4. Site conditions that deviate from the details of drawing **WWD038** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **WWD038** for size and design pressure limitations.

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Certification Agency: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a program audited by and approved by **Window and Door Manufacturers Association** (FBC Organization #: CER1508).

Performance Standards: The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-17
- TAS 201-94
- TAS 202-94
- TAS 203-94
- ASTM E1886-13
- ASTM E1996-14

Referenced Data:

1. Product Testing performed by **Element Materials Technology**.
(FBC Organization # TST9610)
Report #: ESP029955P.NAFS.SCREW, Report Date: 07/27/19
Report #: ESP029955P.NAFS Fin, Report Date: 07/27/19
Report #: ESP029955P.NAFS. Clip, Report Date: 07/27/19
Report #: ESP029955P.Rev.ASTM, Report Date: 01/21/19
Report #: ESP029955P.DADE, Report Date: 07/29/19
TAS Report Engineer of Record: Jason R. Steen, P.E.
2. Certification Agency
Window and Door Manufacturers Association
(FBC Organization #: CER1508)
3. Material Certification
Miami Dade County RER Notice Acceptance
Current NOA for Sentryglas Interlayer by Kuraray America, Inc

Installation:

Refer to Installation Instructions (**WWD038**) for details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**WWD038**) for details design pressure.