



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Product Evaluation Report

of

**Windsor Windows and Doors
Pinnacle Clad Casement Window
(Impact)**

for

Florida Product Approval

FL# FL11619

Report No. 8330

Current Florida Building Code

Method:	1 – A (Certificate)
Category:	Windows
Sub – Category:	Casement
Product:	Pinnacle Clad Casement
Material:	Wood
Cladding:	Aluminum 6063-T5
Product Dimensions:	See Installation Instructions WWD016

Prepared for:

**Windsor Windows and Doors
900 S. 19th Street
West Des Moines, IA 50265**


Prepared by:

Hermes F. Norero, P.E.

Florida Professional Engineer # 73778

Date: 03/03/2023

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2023.10.03 16:14:00 -0400

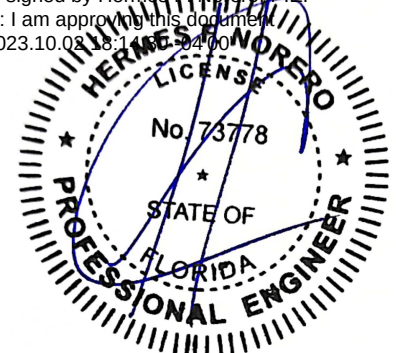

Contents:

Evaluation Report Pages 1 – 3

 954.399.8478

 954.744.4738

 BUILDINGDROPS.COM

 CONTACT@BUILDINGDROPS.COM

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Manufacturer: Windsor Windows and Doors

Product Category: Window

Product Sub-Category: Casement

Compliance Method: State Product Approval Method 1a

Product Name: Pinnacle Clad Casement Window
(Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Windsor Windows and Doors** based on Method 1a of the State of Florida Product Approval, Florida Department of Business & Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **WWD016**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **excluding** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. Approved impact protective system is **not** required on products with "WZ3" rating in design pressure tables in areas requiring impact resistance in Wind Zones 3 or less.
4. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and products with "WZ3" rating in design pressure tables **do not** require an impact resistant covering in Wind Zones 3 or less.
5. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and products with "WZ3" rating in design pressure tables **do** require an impact resistant covering in Wind Zones 4.
6. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and products with "WZ4" rating in design pressure tables **do not** require an impact resistant covering in Wind Zones 4 or less.

398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

7. Site conditions that deviate from the details of drawing **WWD016** require further engineering analysis by a licensed engineer or registered architect.
8. See Installation Instructions **WWD016** for size and design pressure limitations.

Certification Agency: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a program audited by and approved by **Window and Door Manufacturers Association** (FBC Organization #: CER1508).

Performance Standards: The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-11/17
- ASTM E1886-19
- ASTM E1996-20

Referenced Data:

1. Product Testing performed by **Element Materials Technology**.
(FBC Organization # TST9610)
Report #: ESP016941P, Report Date: 07/16/14
Report #: ESP016396P.ASTM, Report Date: 06/12/14
Report #: ESP038164P, Report Date: 01/11/22
Report #: ESP038164P.ASTM, Report Date: 07/11/22
2. Certification Agency
Window and Door Manufacturers Association
(FBC Organization #: CER1508)

Installation:

Refer to Installation Instructions (**WWD016**) for details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**WWD016**) for details design pressure.