

Evaluation Report

"Y-36" Wall Panel

Wall Panel Assembly

Manufacturer:

Morin – a Kingspan Group Company

685 Middle Street

Bristol, CT 06010

for

Florida Product Approval

FL 12228.3 R6

Florida Building Code 8th Edition (2023)

Method: 1 - D

Category: Structural Components

Sub - Category: Structural Wall

Product: "Y-36" Wall Panel

Material: Steel

**Thicknesses: 20 gauge (min.)
22 gauge (min.)**

Support: Steel Girts

This item has been digitally signed and sealed by James L. Buckner, P.E., on this date below. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

Prepared by:

James L. Buckner, P.E., SECB

Florida Professional Engineer # 31242


Florida Evaluation ANE ID: 1916

Project Manager: Diana Galloway

Report No. 23-558-Y36-SG-ER

(Revises 20-268-Y36-SG-ER.2, FL12228.3 R5)

Date: 12/20/2023

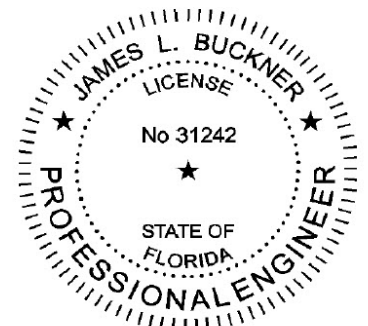

James L. Buckner, P.E.
FL31242

Contents:

Evaluation Report

Pages 1 – 9

Date: 2023.12.20

'16:45:44 -05'00

CBUCK, Inc. dba CBUCK Engineering

Phone: (561) 491-9927 · Email: cbuck@cbuckinc.net · Website: www.cbuckinc.net

Mailing Address: 1374 Community Dr., Jupiter, FL 33458

1. Product

- 1.1 **Manufacturer:** Morin – a Kingspan Group Company
685 Middle Street
Bristol, CT 06010
(860) 857-0900
- 1.2 **Product:** Structural Steel Wall Panel
- 1.3 **Product Name:** “Y-36”

2. Evaluation Scope:

- 2.1 **Compliance with the following**
2.1.1 Florida Building Code 8th Edition (2023)
- 2.2 **Evaluation Method:**
Florida Product Approval Rule 61G20-3.005 (2) (b)
- 2.3 **Evaluation Classification:**
Category: Structural Components
Sub Category: Structural Wall
- 2.4 **Properties Evaluated**
Wind Resistance Properties
Uniform Static Air Pressure per TAS 202
Air Infiltration per TAS 202
Water Penetration per TAS 202
Cyclic Wind Pressure per TAS 203
Missile Impact
Large Missile Impact per TAS 201
- 2.5 **Limits of Evaluation:**
This product assembly evaluation is limited to compliance with section 2.1 to section 2.4 of this report.

3.0 Evaluated Uses:

Morin’s “Y-36” Metal Wall Panel is used as an exterior wall cladding system.

4.0 Product Assembly Description:

- 4.1 **General:**
Morin’s “Y-36” metal wall panels are corrugated steel wall panels with fasteners and a common joint design for multiple panel integration. Panels are installed horizontally or vertically to steel girts.

5.0 General Assembly as Evaluated:

Wall Panel
Fasteners
Steel Girts

6.0 Evaluated Support Description:

Design of support system is outside the scope of this evaluation and shall be designed by others in accordance with current FBC and have been evaluated based on the following minimum characteristics:

- 6.1 Support Description: Steel Girts
6.2 Thickness: 16-gauge min.
6.3 Yield Strength: 50 ksi min.
6.4 Girt Spacing: Refer to Table A

7.0 Performance:

7.1 Wind Resistance

TABLE "A"				
ALLOWABLE LOADS				
	Negative	Positive	Negative	Positive
Design Pressure (PSF):	- 42.3	+ 42.3	- 98.5	+ 98.5
Panel Thickness:	20 gauge (min.)		22 gauge (min.)	
Max. Support Spacing:	84" (7' - 0")		60" (5' - 0")	
Fastener Spacing:	7.2" (every low cell)		7.2" (every low cell)	
Side-lap Spacing:	18"		18"	
Span Condition:	Single		Double	

Notes:

- 1- Allowable design pressure(s) for allowable stress design with 1.5 to 1 margin of safety applied to the test loads.
- 2- Diaphragm and axial load capacity is outside the scope of this evaluation.
- 3- Negative design pressures (Inward), Positive pressures (Outward).
- 4- Deflection limits are within L/120 in accordance with FBC 8th Edition (2023), Table 1604.3.

7.2 Impact Resistance:

Type: Large Missile Impact
Standard: TAS 201
Results: PASS

8.0 Performance Standards:

The following test protocols was performed to demonstrate compliance with the intent of the code:

- 8.1 TAS 201-94, Impact Test Procedure
- 8.2 TAS 202-94, Criteria for Testing Impact and Non-Impact Resistant Building Envelope Components Using Uniform Static Air Pressure Loading
- 8.3 TAS 203-94, Criteria for Testing Products Subject to Cyclic Wind Pressure Loading

9.0 Code Compliance:

- 9.1 The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in:
Florida Building Code 8th Edition (2023)

10.0 Limitations and Conditions of Use:

10.1 Scope of "Limitations and Conditions of Use" for this evaluation:

This evaluation report for "State Approval" contains technical documentation, specifications and installation method(s) which include "Limitations and Conditions of Use" throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under "State Approval".

10.2 Option for application outside "Limitations and Conditions of Use"

Rule 61G20-3.005(1)(e) allows engineering analysis for "project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code". Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.

- 10.3 This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUCK Engineering

is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.

10.4 Diaphragm and axial load capacity is outside the scope of this evaluation.

10.5 Design of support system is outside the scope of this report. Support shall be structural framing members complying with FBC Chapter 22 for steel and Chapter 16 for structural loading and shall be designed by others.

10.6 This evaluation is limited to the wall panel, wall panel fasteners and its attachment to the support. The structural properties and design of all other items are outside the scope of this evaluation and should be submitted to the permitting jurisdiction for review and approval.

10.7 The engineer of record or architect shall verify that the supporting structure is capable of resisting the superimposed loads from the wall panel system and that the supporting structure is capable of providing lateral stability to carry the wind loads to the building foundation.

10.8 All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC, including but limited to FBC Section 1405.17 and Chapter 22 for steel.

10.9 Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.

10.10 This report does not evaluate the use of this product assembly for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)

11.0 Quality Assurance:

The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through Farabaugh Testing & Engineering (FBC Organization ID# QUA 7733).

12.0 System/Components

12.1 Wall Panel:

Product Name:	"Y-36"
Material:	Steel
Thickness:	20-gauge (min.) OR 22-gauge (min.)
Panel Width:	36" (max.) Coverage
Rib Height:	1-1/2"
Yield Strength:	40 ksi min.

12.2 Fasteners:

12.2.1 Fastener 1:	Panel to Support Fastener
Type:	Hex-Head Screw with 5/8" WSW
Size:	#12 – 14 x 1"
Standard:	Per SAE J78-1979

12.2.2 Fastener 2:	Panel to Panel Side-Lap Fastener
Type:	Hex-Head Screw with 5/8" WSW
Size:	¼" - 14 x 7/8"
Standard:	Per SAE J78-1979

12.3 Side Lap Sealant:

Type:	Butyl Tape Sealer
Size:	½" (Wide) x 3/32" (Thick)

13.0 Installation Method:

Install per the following:

- Attach wall panel to girts with one screw per Section 12.2.1
- Fastener spacing: **7.2"** nominal
(every corrugation valley (low cell), attached to steel supports)
- Attach panel to panel with one screw per Section 12.2.2
- Sidelap spacing: **18" o.c.**
(secured at corrugation peaks (high cell), along the length of each side lap)
- Fasteners shall penetrate through support by 1/2 in. minimum. (through flange of steel supports)
- Panels may be installed horizontally or vertically.

The Morin's "Y-36" Metal Panel System shall be installed in compliance with the installation method listed in this report and applicable code sections of FBC 8th Edition (2023). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

(Refer to installation method at the end of this evaluation report.)

14.0 Evaluation Reference Data:**14.1 TAS 201-94, 202-94, 203-94 Test Report**

Farabaugh Testing & Engineering (FBC Organization ID# TST 1654)
Project No. T238-08 Date: 8/18/08

14.2 TAS 201-94, 202-94, 203-94 Test Report

Farabaugh Testing & Engineering (FBC Organization ID# TST 1654)
Project No. T230-08 Date: 8/11/08

14.3 Quality Assurance


Farabaugh Testing & Engineering (FBC Organization ID# QUA 7733)

14.4 Certification of Independence


By James L. Buckner, P.E. @ CBUCK Engineering
(FBC Organization # ANE 1916)

Installation Method
Morin - A Kingspan Company
"Y-36 Panel" Steel Wall Panel attached to Steel Supports

Drawings

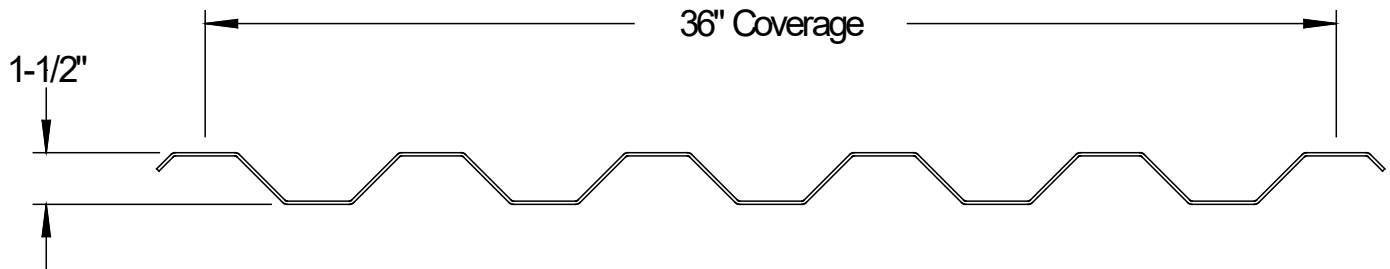


Typical Panel Profile

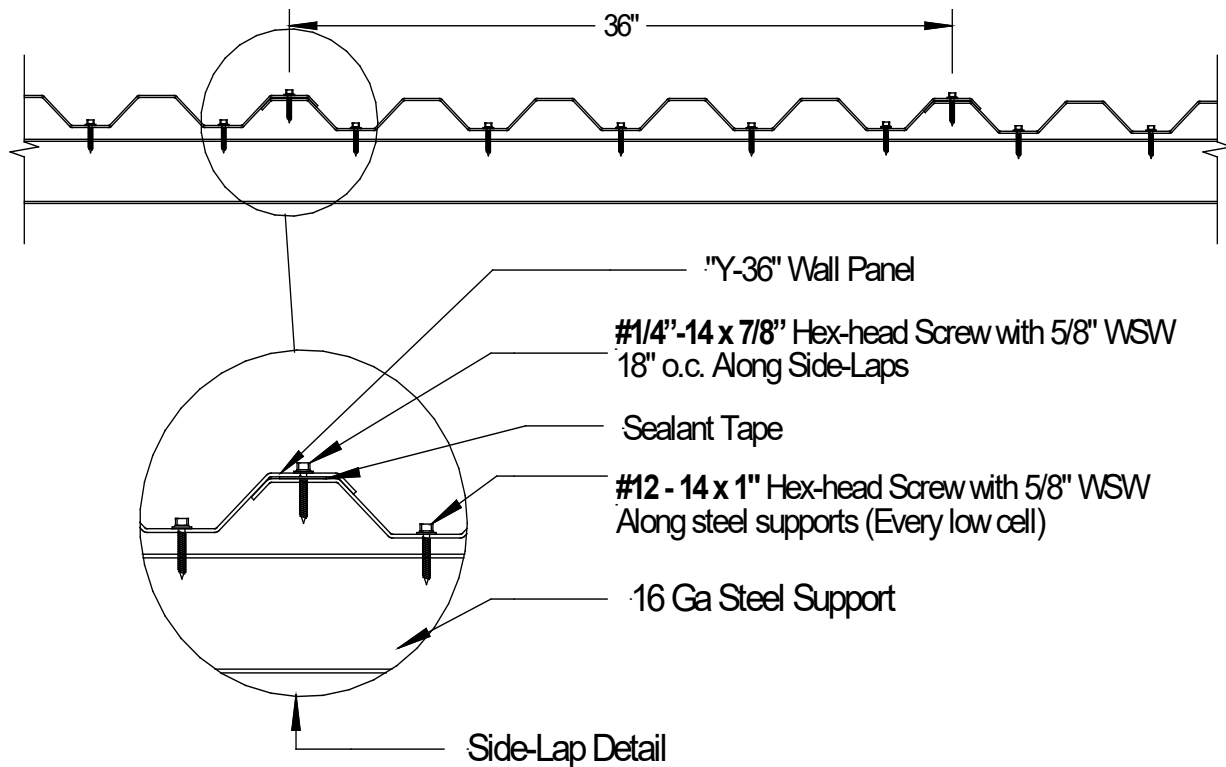

Assembly Profile View
Typical Fastening Pattern Across Row


Installation Method
Morin - A Kingspan Company
"Y-36 Panel" Steel Wall Panel attached to Steel Supports

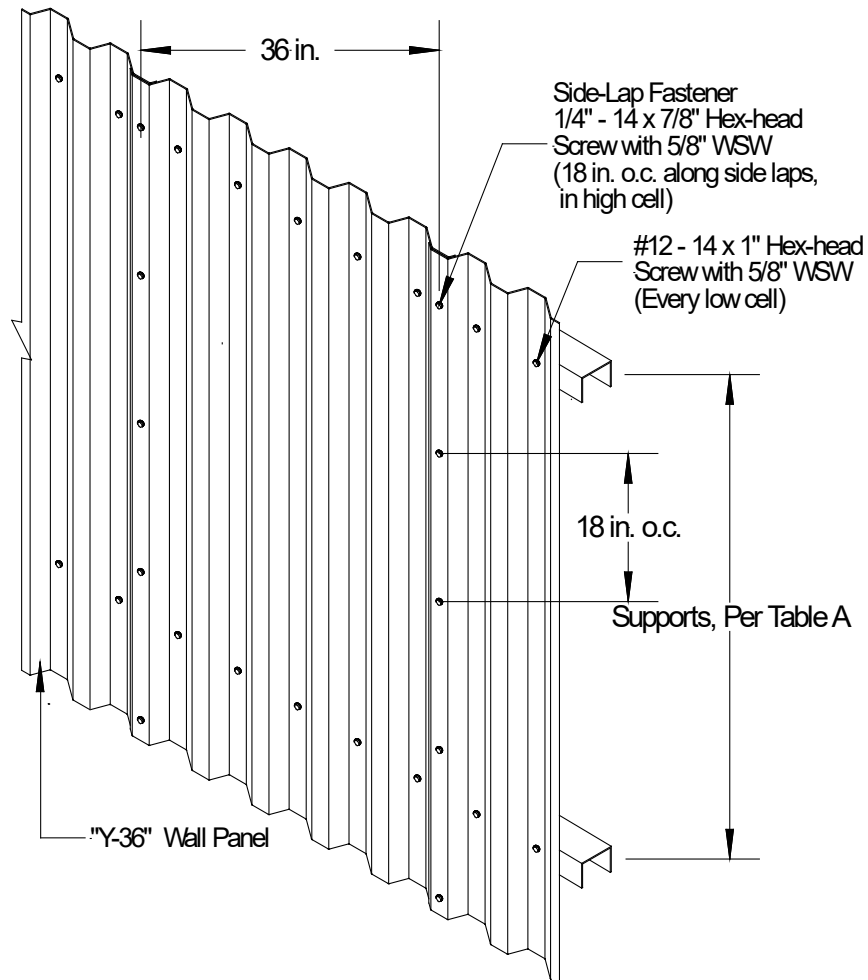

"Vertical Series"
Typical Assembly Isometric View

TABLE "A" ALLOWABLE LOADS		
Design Pressure:	± 42.3 PSF	± 98.5 PSF
Max. Support Spacing:	84" (7' - 0")	60" (5' - 0")
Fastener Spacing:	7.2" (every low cell)	7.2" (every low cell)
Side-lap Spacing:	18"	18"
Span Condition:	Single	Double

Installation Method
Morin - A Kingspan Company
"Y-36 Panel" Steel Wall Panel attached to Steel Supports

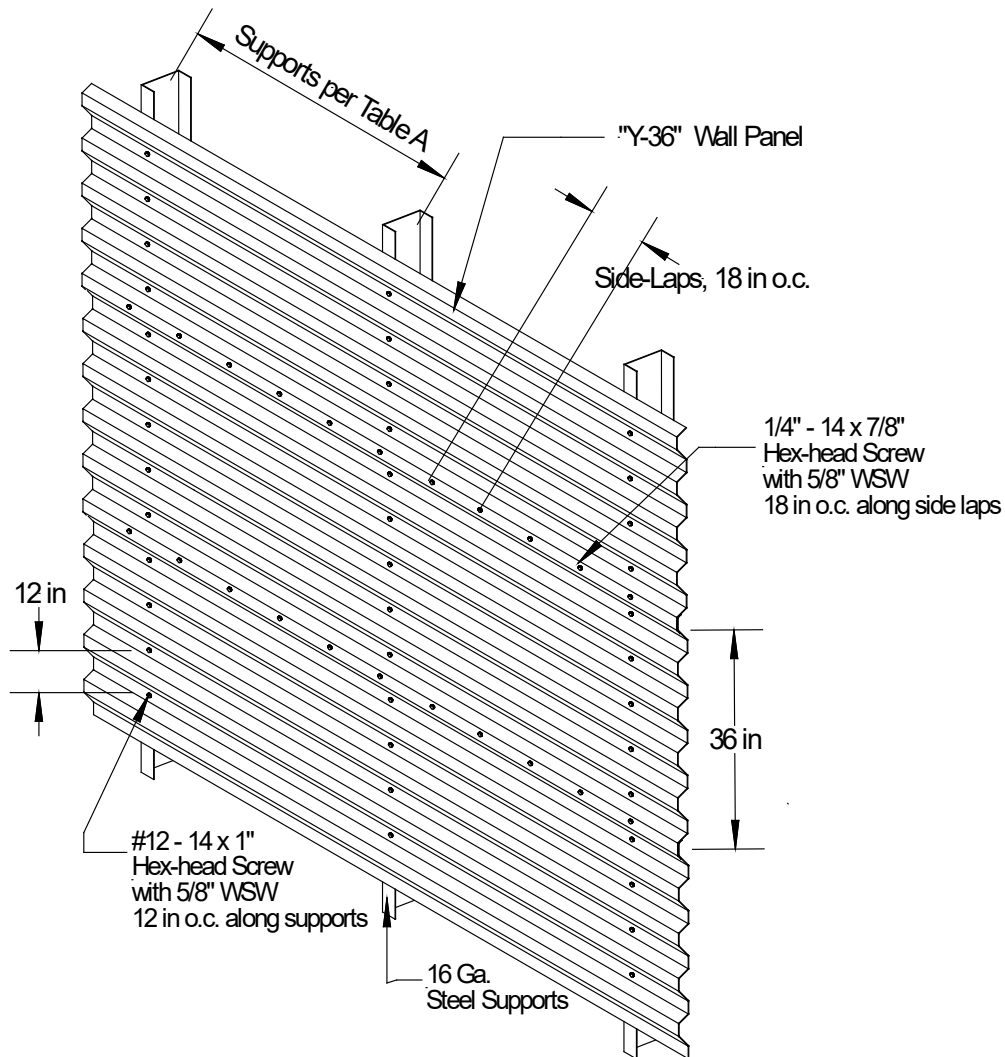

"Horizontal Series"
Typical Assembly Isometric View

TABLE "A" ALLOWABLE LOADS		
Design Pressure:	± 42.3 PSF	± 98.5 PSF
Max. Support Spacing:	84" (7'- 0")	60" (5'- 0")
Fastener Spacing:	7.2" (every low cell)	7.2" (every low cell)
Side-lap Spacing:	18"	18"
Span Condition:	Single	Double