

Product Evaluation Report**Report No.:** FL-15099.12**Date:** August 4, 2020

Product Category	Sub Category	Manufacturer	Product Name
Windows	Fixed	Doers Window Manufacturing, LLC 10741 Crossroads Commerce Blvd. Tampa, FL 33610 (813) 626-6000	4650 Fixed Window Impact Rated - HVHZ w/ Flange

Scope: Product Evaluation report issued by R W Building Consultants, Inc. & Lyndon F. Schmidt, P.E. (System ID # 1998) for Doers Window Manufacturing, LLC, based on Rule Chapter No. 61G20-3, Method 1D of the State of Florida Product Approval, Dept. of Business & Professional Regulation.

RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ", this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of drawing FL-15099.12 require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. See drawing FL-15099.12 for size and design pressure limitations.

Supporting Documents:

- | | |
|--|---|
| 1. Test Report No.
ESP011207P-1_D
ESP011398P-1A_D | Test Standard
TAS 201, 202, 203-94
TAS 201, 202, 203-94 |
| 2. Dade County NOA
19-0305.02
17-0808.02 | Materials
Trosifol/Butacite PVB Interlayer (Kuraray)
SentryGlas Interlayer (Kuraray) |
| 3. Drawing No.
No. FL-15099.12 | Prepared by
RW Building Consultants, Inc. (#9813) |
| 4. Calculations
Anchoring
ASTM E1300 Glass Load | Prepared by
RW Building Consultants, Inc. (#9813)
Lyndon F. Schmidt, P.E. |
| 5. Quality Assurance
Certificate of Participation issued by National Accreditation and Management Institute, certifying that Doers Window Manufacturing, LLC is manufacturing products within a quality assurance program that complies with ISO/IEC 17020 and Guide 53. | |

Testing Laboratory

Element Materials Tech.
Element Materials Tech.

Signed by


Ramesh C. Patel, P.E.
Ramesh C. Patel, P.E.

Signed & Sealed by

Lyndon F. Schmidt, P.E.

Signed & Sealed by

Lyndon F. Schmidt, P.E.

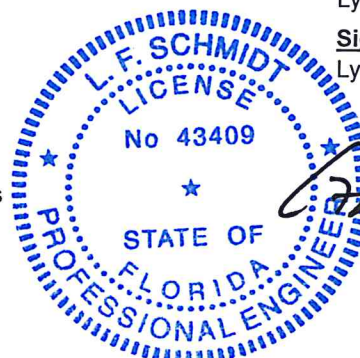

Lyndon F. Schmidt, P.E.
FL PE No. 43409
8/4/2020