

June 10, 2025

For the doors listed in Tables 1 through 2, Static Pressure Tests were conducted in accordance with ASTM-E330-2002 and/or ANSI/DASMA 108-2005. The pressures listed on the drawings are either direct results of these tests or results obtained through engineering rational analysis based on actual tests. I have concluded that the sectional garage door designs listed below in Tables 1 and 2 are in compliance with these test requirements of the Florida Building Code.

TABLE 1: Drawings for doors with Manufacturing Product Code (MPC) DSIE-1F171:

DRAWING	MAX. WIDTH	MAX. HEIGHT	DESIGN LOAD (PSF)	SUB-ITEM
101247-Rev21	18'0"	16'0"	+25/-25	15279.24
101481-Rev15	16'0"	16'0"	+25.5/-25.5	15279.15
101652-Rev12	9'0"	16'0"	+28/-29	15279.8

TABLE 2: Drawings for doors with Manufacturing Product Code (MPC) DSIU-1F171:

DRAWING	MAX. WIDTH	MAX. HEIGHT	DESIGN LOAD (PSF)	SUB-ITEM
104169-Rev04	16'0"	16'0"	+25.5/-25.5	15279.18
104183-Rev04	9'0"	16'0"	+28/-29	15279.10
104260-Rev04	18'0"	16'0"	+25/-25	15279.26

Test Reports:

The following test reports are based on testing conducted by Clopay Corporation at their Mason testing facility (accredited by ANAB for ASTM E330 and ANSI/DASMA 108 testing): ATC 17-011 (11/7/17), ATC 22-011 (3/31/22), ATC 23-008 (4/20/23).

Product Description for doors with MPC DSIE-1F171:

These doors consist of 2" double-skin insulated sections with an EPS core laminated to both skins. Outer skins are min. 27 ga. (0.016") G40 DDS per ASTM A653. The maximum section height is 21". These doors may have optional Impact Resistant Glazing (molded). Optional Impact-Resistant Glazing is a one-piece injection molded front frame and glazing. The following models are at least structurally equivalent to the tested door: 4300, 4301, 4310, HDG, HDGL, HDGF, 66, 66G, 67, 67G, 68, SP200, SF200, SE200, 6200, 6201, 6203. Not all models may be shown on a given drawing.

Product Description for doors with MPC DSIU-1F171:


These doors consist of 2" double-skin insulated sections with a PUR core laminated to both skins. Outer skins are min. 27 ga. (0.016") G40 DDS per ASTM A653. The maximum section height is 21". These doors may have optional Impact Resistant Glazing (Aluminum). Optional Impact-Resistant Glazing is an aluminum front frame and a separate polycarbonate glazing. The following models are at least structurally equivalent to the tested door: 9200, 9201, 9203, HDP20, HDPF20, HDPL20, 7200, 7201, 7203, 8200, 8201, 8203. Not all models may be shown on a given drawing.

Limitations:

The drawing(s) cited above are an explicit part of this evaluation report. The text of this report does not attempt to address all design details and relies on the illustrations and text of these drawings as well.

Jambs, lintels, sills or other structural elements required to prepare openings are not covered. The design of the supporting structural elements shall be the responsibility of the professional of record for the building or structure and in accordance with current building codes for the loads listed on the drawing(s) referenced above.

Installation requirements per the relevant Florida Administrative Rule, including attachments, are detailed on the drawing(s) listed above. Installation must be in accordance with manufacturer's installation instructions and must be as shown on the drawing(s) listed above. The manufacturer's licensed design professional listed on the drawing(s) has reviewed the attachment details and installation requirements.

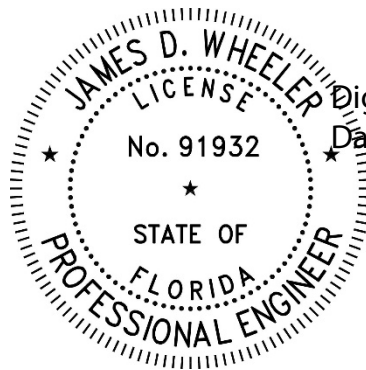

Digitally signed by Jim Wheeler
Date: 2025.06.23 12:27:01 -04'00'

Jim Wheeler, P. E.
Florida P.E. No. 91932