

R W Building Consultants, Inc.

Consulting and Engineering Services for the Building Industry

P.O. Box 230 Valrico, FL 33595 Phone 813.659.9197

Florida Board of Professional Engineers Certificate of Authorization No. 9813

Product Evaluation Report

Report No.: FL-15450.2

Date: June 26, 2015

Product Category	Sub Category	Manufacturer	Product Name
Exterior Doors	Sliding Exterior Doors Assemblies	Doers Window Manufacturing, LLC 4901 Oak Fair Blvd Tampa, FL 33610 (813) 626-6000	6000 Series Model 6250 Sliding Patio Door "Impact"

Scope: Product Evaluation report issued by R W Building Consultants, Inc. & Lyndon F. Schmidt, P.E. (System ID # 1998) for Doers Window Manufacturing, based on Rule Chapter No. 61G20-3, Method 1A of the State of Florida Product Approval, Dept. of Business & Professional Regulation.


RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

1. This product anchoring drawing has been evaluated and is in compliance with the 5th Edition (2014) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone" (HVHZ). See the Certification Agency Certificate for sizes, specifications & ratings.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of drawing FL-15450.2 require further engineering analysis by a licensed engineer or registered architect.
6. See drawing FL-15450.2 for size and design pressure limitations.

Supporting Documents:

- | | | | |
|--|--|---|--|
| 1. Test Report No.
TEL 02031266
TEL 02031268 | Test Standard
AAMA/WDMA/CSA101/I.S.2/A440-08
ASTM E1886-05 / E1996-06 | Testing Laboratory
TestingEvaluatoion Lab., Inc.
TestingEvaluatoion Lab., Inc. | Signed by
V.K.Wright
V.K.Wright |
| 2. Dade County NOA
13-0129.27 | Materials
DuPont PVB Interlayer | | |
| 3. Drawing No.
No. FL-15450.2 | Prepared by
RW Building Consultants, Inc. (CA #9813) | | Signed & Sealed by
Lyndon F. Schmidt, P.E. |
| 4. Calculations
Anchoring | Prepared by
RW Building Consultants, Inc. (CA #9813) | | Signed & Sealed by
Lyndon F. Schmidt, P.E. |
| 5. Quality Assurance
Certificate of Participation issued by Keystone Certifications, Inc., certifying that Doers Window Manufacturing, LLC is manufacturing products within a quality assurance program that complies with ISO/IEC 17020 and Guide 53. | | | |

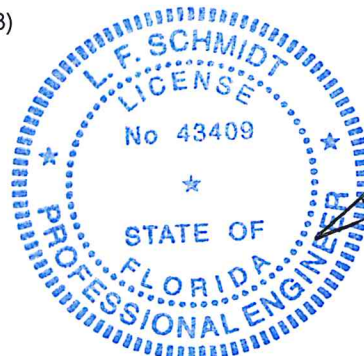

Lyndon F. Schmidt, P.E.
FL PE No. 43409
6/26/2015