



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**Andersen Corporation
Aluminum Reinforced Mullion System
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL15922

Report No. 8971

Current Florida Building Code

Method: 1 – D (Engineering Evaluation)
Category: Windows
Sub – Category: Mullions

Product: Aluminum Reinforced Mullion System
Materials: Aluminum 6061-T6
Product Dimensions: See Installation Instructions, AWD228

Prepared for:

**Andersen Corporation
100 Fourth Avenue North
Bayport, MN 55003**


Prepared by:

Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 10/19/2023

Contents:

Evaluation Report Pages 1 – 3

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2023.10.20 09:07:41 -04'00'

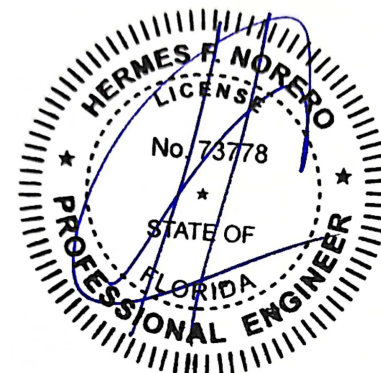

Hermes F. Norero, P.E.
Florida No. 73778

Manufacturer: Andersen Corporation

Product Category: Windows

Product Sub-Category: Mullions

Compliance Method: State Product Approval Method (1)(d)

Product Name: Aluminum Reinforced Mullion System (HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Andersen Corporation** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **AWD228**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **AWD228** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **AWD228** for size and design pressure limitations.

Quality Assurance:

The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Window and Door Manufacturers Association-QA**.
(FBC Organization # QUA2515)

Performance Standards:

The product described herein has been evaluated to Section 1709.8 of the Current Edition of FBC and has been evaluated per:

- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **Architectural Testing, Inc. (an Intertek company) - Fridley, MN**
(FBC Organization # TST1795)
Report #: ATI-16720-N, Report Date: 11/30/1995
Report #: ATI-02-31431.01, Report Date: 05/25/1999
Reports signed and sealed by Allen N. Reeves, FL P.E. No. 19354

Report #: ATI-76003.01-201-18, Report Date: 01/08/2008
Report signed and sealed by Joseph A. Reed, FL P.E. No. 58920

Installation:

Refer to Installation Instructions (**AWD228**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**AWD228**) for design pressures based on size, configuration, and glass types.