



EVALUATION REPORT

FLORIDA BUILDING CODE 6TH EDITION (2017)

Manufacturer: L.V. THOMPSON, INC. *Issued April 3, 2020*
 dba Thompson Architectural Metals Company (TAMCO)
 5015 E. Hillsborough Ave
 Tampa, FL 33610
 (813) 248-3456
<http://www.tamcometalroof.com>

Manufacturing: Tampa, FL

Quality Assurance: PRI Construction Materials Technologies (QUA9110)

SCOPE


Category: Roofing
Subcategory: Metal Roofing
Code Sections: 1504.3
Properties: Wind Resistance

REFERENCES

<u>Entity</u>	<u>Report No.</u>	<u>Standard</u>	<u>Year</u>
PRI Construction Materials Technologies (TST5878)	LVTI-021-02-01	TAS 125	2003

PRODUCT DESCRIPTION


Panel: 5V Crimp
Description: Preformed panel; 1/2-inch rib; Maximum 24-inch coverage; Non-structural application
Material: Min. 26 ga. ASTM A792 AZ50 or ASTM A653 G-90 steel (F_y = min. 40 ksi);
 Shall conform with FBC Section 1507.4.3

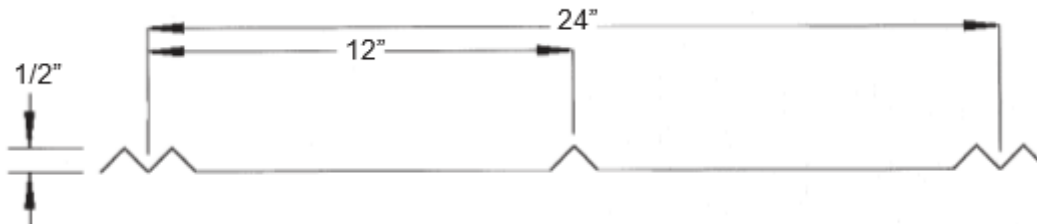

5V Crimp Panel Profile

APPROVED ASSEMBLIES

5V-1:	
Slope:	Shall be in accordance with FBC.
Roof Deck:	Solid or closely fitted min. 15/32 in. plywood sheathing for new and existing construction at max. 24 in. span. Deck shall be designed by others in accordance with FBC requirements.
Underlayment:	Installed in accordance with FBC requirements.
Attachment:	One (1) #9-15 x minimum 1.5" HWH wood screw with 0.5" O.D. sealing washer spaced maximum 16 in. o.c. as indicated in the figure below. Fasteners shall penetrate the deck a minimum 3/16-inch and shall conform with FBC sections 1507.4.4 and 1506.6.
Maximum Design Pressures:	-71.25 psf <i>Pressure calculated using 2:1 margin of safety per 1504.9</i>

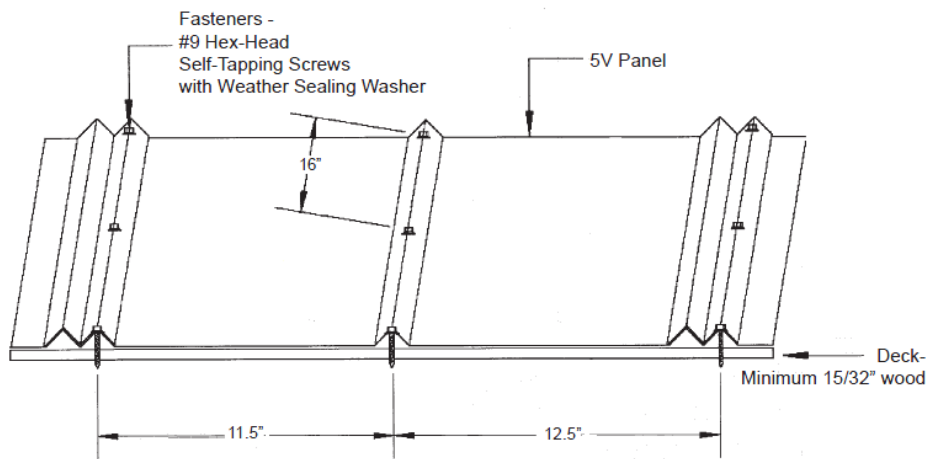


Maximum Mean Roof Heights for Gable/Hip Roofs
Slopes 2:12 – 6.1:12 and >6.1 – 12:12 (Gable Roofs only)

Exposure	Basic Wind Speed (mph)									
	120	130	140	150	160	170	180	190	200	
Zone 1										
B	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
C	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
D	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	52 ft	28 ft
Zone 2										
B	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	48 ft	33 ft
C	60 ft	60 ft	60 ft	60 ft	60 ft	33 ft	19 ft	NA	NA	NA
D	60 ft	60 ft	60 ft	55 ft	26 ft	NA	NA	NA	NA	NA
Zone 3 ^A										
B	60 ft	60 ft	60 ft	60 ft	40 ft	NA	NA	NA	NA	NA
C	60 ft	60 ft	33 ft	19 ft	NA	NA	NA	NA	NA	NA
D	60 ft	30 ft	NA	NA	NA	NA	NA	NA	NA	NA

Notes: 1) Exposure category for the structure location shall be as defined in the Florida Building Code 2) Limitations are based on an effective wind area of 10ft² or less 3) Topographic factors such as escarpments or hills are not included in the above assessment 4) Applicable for Enclosed Buildings without overhangs 5) NA = "Not Allowed" 6) $K_d = 0.85$ 7) Projects with mean roof heights of greater than 60 ft shall be evaluated by a licensed design professional 8) See page 4 for details for dimensions and locales of Zone 1, 2, and 3 9) V_{ult} is shown in the tables above. Design wind loads are calculated using $V_{asd} = V_{ult} \sqrt{0.6}$ per 1609.3.1.

^AFor hip roofs 2:12 to 5.6:12, Zone 3 shall be treated as Zone 2.

5V-2:	
Slope:	Shall be in accordance with FBC.
Roof Deck:	Solid or closely fitted min. 15/32 in. plywood sheathing for new and existing construction at max. 24 in. span. Deck shall be designed by others in accordance with FBC requirements.
Underlayment:	Installed in accordance with FBC requirements.
Attachment:	One (1) #9 x minimum 1.5" HWH wood screw with 0.5" O.D. sealing washer spaced maximum 8 in. o.c. as indicated in the figure below. Fasteners shall penetrate the deck a minimum 3/16-inch and shall conform with FBC sections 1507.4.4 and 1506.6.
Maximum Design Pressures:	-127.5 psf <i>Pressure calculated using 2:1 margin of safety per 1504.9</i>

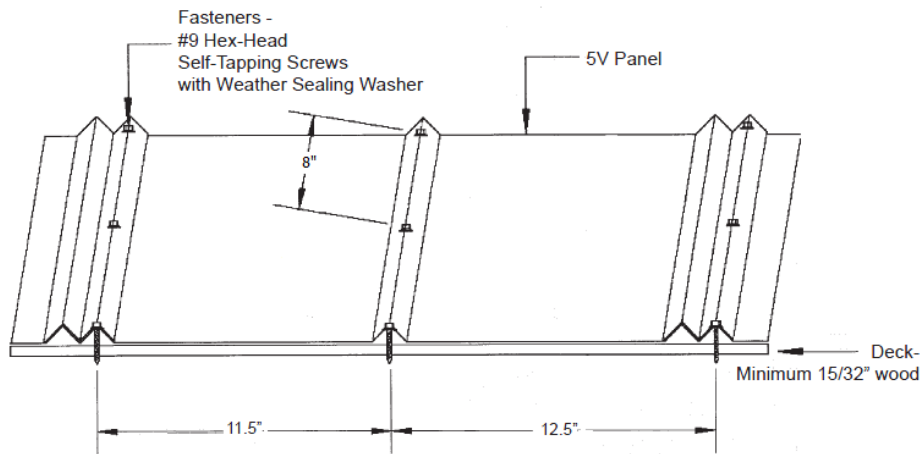


Maximum Mean Roof Heights for Gable/Hip Roofs
Slopes 2:12 – 6.1:12 and >6.1 – 12:12 (Gable Roofs only)

Exposure	Basic Wind Speed (mph)									
	120	130	140	150	160	170	180	190	200	
Zone 1										
B	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
C	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
D	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
Zone 2										
B	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
C	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
D	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	55 ft
Zone 3 ^A										
B	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft
C	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	48 ft	28 ft	19 ft	
D	60 ft	60 ft	60 ft	60 ft	60 ft	60 ft	38 ft	20 ft	NA	NA


Notes: 1) Exposure category for the structure location shall be as defined in the Florida Building Code 2) Limitations are based on an effective wind area of 10ft² or less 3) Topographic factors such as escarpments or hills are not included in the above assessment 4) Applicable for Enclosed Buildings without overhangs 5) NA = "Not Allowed" 6) $K_d = 0.85$ 7) Projects with mean roof heights of greater than 60 ft shall be evaluated by a licensed design professional 8) See page 4 for details for dimensions and locales of Zone 1, 2, and 3 9) V_{ult} is shown in the tables above. Design wind loads are calculated using $V_{asd} = V_{ult} \sqrt{0.6}$ per 1609.3.1.

^AFor hip roofs 2:12 to 5.6:12, Zone 3 shall be treated as Zone 2.

Gable

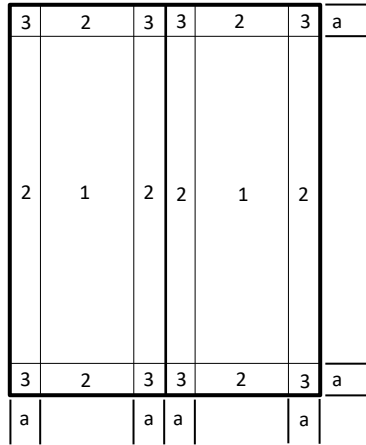

Hip

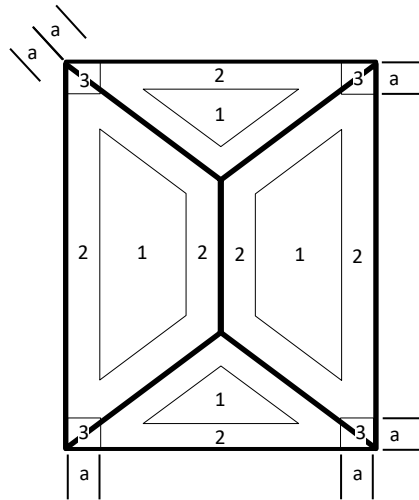


Dimension "a" shall be 10% of the least horizontal dimension or (0.4 x Mean Roof Height), whichever is smaller, but not less than either 4% of the least horizontal dimension or 3ft.

LIMITATIONS

1. Fire classification is not within the scope of this evaluation.
2. This report is not for use in the HVHZ.
3. The roof deck and the roof deck attachment shall be designed by others to meet the minimum design loads established for components and cladding and in accordance with FBC requirements.
4. Reroofing shall be in accordance with FBC Section 1511.
5. Installation of the evaluated products shall comply with this report, the FBC and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
6. All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

COMPLIANCE STATEMENT

The products evaluated herein by Zachary R. Priest, P.E. have demonstrated compliance with the Florida Building Code, 6th Edition (2017) as evidenced in the referenced documents submitted by the named manufacturer.

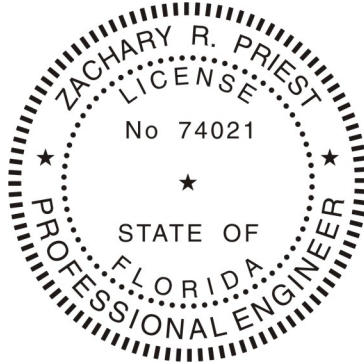

Zachary R. Priest, P.E.
Florida Registration No. 74021
Organization No. ANE9641

CERTIFICATION OF INDEPENDENCE

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

END OF REPORT