



R W Building Consultants, Inc.

Consulting and Engineering Services for the Building Industry

P.O. Box 230 Valrico, FL 33595 Phone 813.659.9197

Florida Board of Professional Engineers Certificate of Authorization No. 9813

Product Evaluation Report

Report No.: FL-16854.3

Date: June 30, 2015

| Product Category | Sub Category | Manufacturer | Product Name |
|------------------|--------------|--|---|
| Windows | Single Hung | Doers Window Manufacturing, LLC 4901 Oak Fair Blvd Tampa, FL 33610 (813) 626-6000 | 9450 Single Hung Window Impact Rated w/ Nailing Fin |

Scope: Product Evaluation report issued by R W Building Consultants, Inc. & Lyndon F. Schmidt, P.E. (System ID # 1998) for Doers Window Manufacturing, LLC, based on Rule Chapter No. 61G20-3, Method 1A of the State of Florida Product Approval, Dept. of Business & Professional Regulation.


RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

1. This product anchoring drawing has been evaluated and is in compliance with the 5th Edition (2014) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone" (HVHZ). See the Certification Agency Certificate for sizes, specifications & ratings.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and Section 1609.1.2.2 of the FBC.
4. Site conditions that deviate from the details of drawing FL-16854.3 require further engineering analysis by a licensed engineer or registered architect.
5. See drawing FL-16854.3 for size and design pressure limitations.

Supporting Documents:

- | | | | |
|---|---|---|--|
| 1. Test Report No. ATI C9934.04-401-44 ATI C9937.05-401-44 | Test Standard AAMA/WDMA/101/I.S.2/A440-08 ASTM E1886-05/E1996-06 | Testing Laboratory Architectural Testing, Inc. Architectural Testing, Inc. | Signed by Shawn G. Collins, P.E. Shawn G. Collins, P.E. |
| 2. Miami Dade NOA 14-0423.16 | Materials Testing Saflex® PVB Interlayer (Eastman Chemical Co.) | | |
| 3. Drawing No. No. FL-16854.3 | Prepared by RW Building Consultants, Inc. (CA #9813) | | Signed & Sealed by Lyndon F. Schmidt, P.E. |
| 4. Calculations Anchoring | Prepared by RW Building Consultants, Inc. (CA #9813) | | Signed & Sealed by Lyndon F. Schmidt, P.E. |

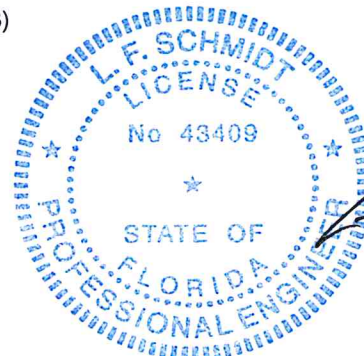

Lyndon F. Schmidt, P.E.
FL PE No. 43409
8/10/2015