

Evaluation Report – CW400 Captured Impact
October 26, 2020

Product Description: CW400, Captured Impact

Manufacturer: Tubelite Inc., 3056 Walker Ridge DR. NW Suite G, Walker, Michigan 49544

Statement of Compliance: This report evaluates the above-listed product per the requirements of FAC Product Approval Rule Chapter 61G20-3.005 (4). This product complies with the requirements of the 7th Edition (2020) Florida Building Code including the HVHZ. The product testing standards performed are outlined below.

Technical Documentation:


- 1) This report, prepared by Lucas A. Turner, P.E., at 2428 Old Natchez Trc Trl, Camden, TN
- 2) Approval drawing FPA-400-CAP-IMP, signed and sealed by Lucas A. Turner, P.E.
- 3) Test reports B3864.01-450-18, B3864.03-450-18, B3864.04-450-18, and B3864.05-450-18 by Architectural Testing, Inc., signed and sealed by Vinu Abraham, with testing performed: ASTM E 283-2004, ASTM E 331-2009, AAMA 501.1-2015, AAMA 501.5-2015, ASTM E330-2002, ASTM E 1886-2013a, ASTM E 1996-2017, and TAS 201/202/203-1994
- 4) Supplemental Calculations to support FPA-400-CAP-IMP, signed and sealed by Lucas A. Turner, P.E.
- 5) Certification statement from Trelleborg, the supplier for dry-glazed gasket PTB28, for compliance with ASTM C 864

Installation: Units must be installed according to approval document FPA-400-CAP-IMP.

Limitations of Use: This product:

- May be used in the panel sizes, maximum glass DLO sizes, and design pressures as shown in FPA-400-CAP-IMP
 - Is impact resistant and does not require the use of shutters in windborne debris regions. As noted in FPA-400-CAP-IMP, glass types 1 through 3 are Large Missile impact resistant and glass type 4 is Small Missile impact resistant.
 - May be used in the High Velocity Hurricane Zone
 - Requires 1-5/16" overall I.G. glazing with 1/4" fully tempered outboard lite, and inboard lite consisting of 1/4" HS + interlayer + 1/4" HS where the interlayer by glazing type is:
 - Glazing Type 1 – 0.090" Kuraray Sentry Glas per M-D NOA 17-0808.02[†]
 - Glazing Type 2 – 0.075" Eastman Chemical Saflex CP per M-D NOA 20-0622.03
 - Glazing Type 3 – 0.090" Kuraray Trosifol (Butacite) PVB per M-D NOA 19-0305.02[†]
 - Glazing Type 4 – 0.060" Kuraray Trosifol (Butacite) PVB per M-D NOA 19-0305.02[†]
- [†] I have evaluated the interlayer materials in these NOAs and find that they comply with the requirements of the 7th Ed. (2020) Florida Building Code for use in this product.
- Requires 6063-T5 and –T6 aluminum extrusions as indicated in FPA-400-CAP-IMP

Certification of Independence: I do not have, nor do I intend to acquire, nor will I acquire, a financial interest in Tubelite Inc. or in any company manufacturing or distributing products for which this report is being issued. I do not have, nor do I intend to acquire, nor will I acquire, a financial interest in any other entity involved in the testing or approval process of this product.

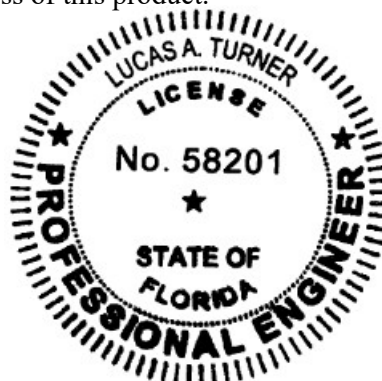

22

10/26/2020

Lucas A. Turner, P.E.
FL PE #58201