



**EVALUATION REPORT**

**FLORIDA BUILDING CODE, 7<sup>TH</sup> EDITION (2020)**

**Manufacturer:** ATLAS ROOFING CORPORATION *Issued August 12, 2021*  
 2000 Riveredge Parkway, Suite 800  
 Atlanta, GA 30328  
 (770) 612-6267  
[www.atlasroofing.com](http://www.atlasroofing.com)

**Quality Assurance:** PRI Construction Materials Technologies, LLC (QUA9110)

**SCOPE**

**Category:** Roofing  
**Subcategory:** Underlayments  
**Code Edition:** Florida Building Code, 7<sup>th</sup> Edition (2020) including High-Velocity Hurricane Zones (HVHZ)  
**Code Sections:** 1507.1.1 1523.1.1  
**Properties:** Physical properties

**REFERENCES**

<u>Entity</u>	<u>Report No.</u>	<u>Standard</u>	<u>Year</u>
PRI Construction Materials Technologies (TST6049)	MSA-026-02-01	ASTM D 1970	2015a

**PRODUCT DESCRIPTION**

**Fabral All Purpose High-Temp Underlayment** ASTM D 1970 SBS modified, self-adhering underlayment with a fiberglass mat reinforcement and a poly-fabric surface for use in the HVHZ and non-HVHZ. The self-adhesive side is covered with a release film, which is removed during installation.

**APPLICATION METHOD**

*Installation shall be in accordance with the published manufacturer's installation instructions, the FBC, and the requirements below.*

Deck substrates shall be clean, dry, and free from any irregularities and debris. All fasteners in the deck shall be checked for protrusion and corrected prior to underlayment application.

The roof deck shall be constructed of closely fitted plywood sheathing for new or existing construction. Plywood deck shall be installed in accordance with FBC requirements. Roof decks shall have no more than 1/8" gap at abutting joints.

Exposure of the underlayment shall be limited to a maximum 30 days.

Underlayment may be self-adhered to primed or unprimed plywood substrates in the non-HVHZ.

Mechanically fastened roof coverings as prescribed in FBC Table 1507.1.1 shall be permitted.

## LIMITATIONS


---

- 1) Fire Classification is not within the scope of this evaluation.
- 2) Roof slope limitations shall be in accordance with FBC requirements.
- 3) Installation of the evaluated product shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
- 4) Products described within this report may be used as described in other current FBC product approval documents.
- 5) Roof coverings shall not be adhered directly to the underlayment unless otherwise approved in this or other current FBC product approval documents.
- 6) All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

## COMPLIANCE STATEMENT

---

The products evaluated herein by Zachary R. Priest P.E. have demonstrated compliance with the Florida Building Code, 7<sup>th</sup> Edition (2020) including High-Velocity Hurricane Zones (HVHZ) as evidenced in the referenced documents submitted by the named manufacturer.

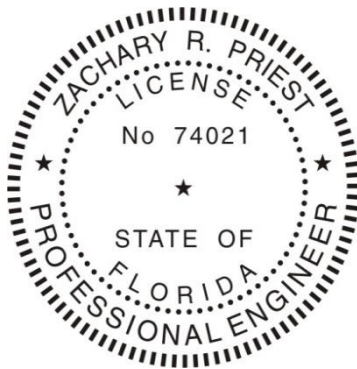

**This item has been  
digitally signed and  
sealed by Zachary R.  
Priest, PE, on 8/12/2021.**

**Printed copies of this  
document are not  
considered signed and  
sealed and the signature  
must be verified on any  
electronic copies.**

Zachary R. Priest, P.E.  
Florida Registration No. 74021  
Organization No. ANE9641

## CERTIFICATION OF INDEPENDENCE

---

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

**END OF REPORT**