

STRUCTURAL SOLUTIONS, P.A.*

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IBC-1818-136-26		Test Date:	12/10/2014		Project No.:	14-149			
Design Pressures:	+25.1 psf, -28.4 psf		Report Date:	10/30/2020		Model #	1380			
Test Pressures:	+37.7 psf, -42.6 psf		Test Location:	Entrematic, Winston-Salem, NC						
ASCE 7-16 Criteria:	Up to 5 Feet of Door Width in Zone 5; Roof Slope ≤ 10°; Enclosed Building									
	Exp. B, 30' MRH		Exp. C, 15' MRH		Exp. C, 25' MRH		Exp. D, 15' MRH		Exp. D, 25' MRH	
	175 mph		159 mph		151 mph		144 mph		138 mph	

Reference Test Report and Drawing:

- Structural Solutions, P.A.* Garage Door Static Pressure Test Report for IBC-1818-136-26 dated 10/30/2020
- Entrematic Drawing number IBC-1818-136-26 dated 12/8/2014

Description of Test Specimen:

18'-2"x8'-0" Model 1380, 27 ga steel garage door as shown in drawing IBC-1818-136-26.

Test Standards and Report Conclusion:

The above referenced Test Report states the following:

- The tests were conducted in accordance with ASTM E330-14 and DASMA 108-05.
- The test was witnessed and certified by Thomas L. Shelmerdine, PE (FL PE# 48579)
- The test facility at Entrematic is accredited by the American Association for Laboratory Accreditation, Certificate #2595.01.


Summary:

The 18'-2"x8'-0" Model 1380 as described on drawing IBC-1818-136-26 meets or exceeds the testing criteria as described above. By comparison to the construction of the 18'-2"x8'-0" Model 1380, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IBC-1818-136-26:

- Amarr Model 1380 doors with widths up to 18'-2" and heights up to 14'-0"
- 4 windows may be installed in 1 section, either 38-1/8" x 10-5/8" x 3/32" SSB (meets ASTM E1300-04), or 2 layers of 21-3/8" x 3-1/4" x 0.080" plexi-glass with aluminum spacer.

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 7th Edition (2020).

Submitted By:

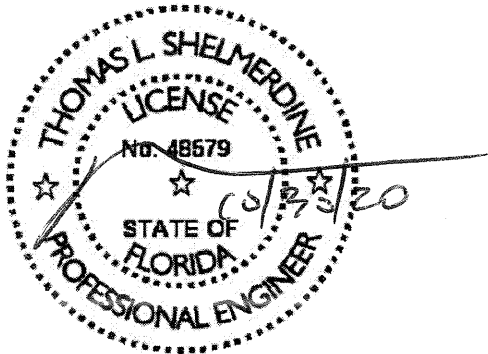

STRUCTURAL SOLUTIONS, P.A.* (*Florida: dba Structural Solutions of North Carolina, Inc., Firm #29412)

Thomas L. Shelmerdine, PE (NC PE #14654; Florida PE #0048579)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096