

STRUCTURAL SOLUTIONS, P.A.*

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IRC-1418-130-26		Test Date:	12/10/2014	Project No.:	14-148
Design Pressures:	+25.1 psf, -28.4 psf		Report Date:	11/2/2020	Model #	1480
Test Pressures:	+37.7 psf, -42.6 psf		Test Location:	Entrematic, Winston-Salem, NC		
ASCE 7-16 Criteria:	Up to 5 Feet of Door Width in Zone 5; Any Roof Slope; Enclosed Building					
	Exp. B, 30' MRH	Exp. C, 15' MRH	Exp. C, 25' MRH	Exp. D, 15' MRH	Exp. D, 25' MRH	
	168 mph	152 mph	145 mph	138 mph	133 mph	

Reference Test Report and Drawing:

- Structural Solutions, P.A.* Garage Door Static Pressure Test Report for IRC-1418-130-26 dated 11/02/2020
- Entrematic Drawing number IRC-1418-130-26 dated 12/8/2014

Description of Test Specimen:

18'-2"x8'-0" Model 1480, 27 ga steel garage door as shown in drawing IRC-1418-130-26.

Test Standards and Report Conclusion:

The above referenced Test Report states the following:

- The tests were conducted in accordance with ASTM E330-14 and DASMA 108-05.
- The test was witnessed and certified by Thomas L. Shelmerdine, PE (FL PE# 48579)
- The test facility at Entrematic is accredited by the American Association for Laboratory Accreditation, Certificate #2595.01.


Summary:

The 18'-2"x8'-0" Model 1480 as described on drawing IRC-1418-130-26 meets or exceeds the testing criteria as described above. By comparison to the construction of the 18'-2"x8'-0" Model 1480, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IRC-1418-130-26:

- Amarr Model 1480 doors with widths up to 18'-2" and heights up to 14'-0"
- 4 windows may be installed in 1 section (38-5/8" x 14" x 1/8" DSB glass - meets ASTM E1300-04)

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 7th Edition (2020).

Submitted By:

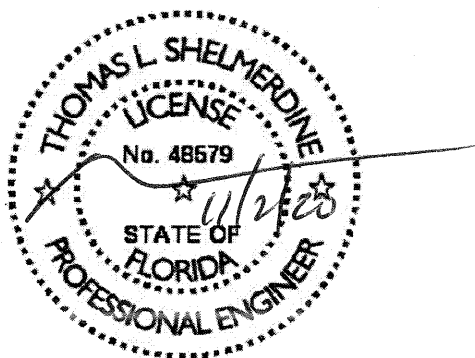

STRUCTURAL SOLUTIONS, P.A.* (*Florida: dba Structural Solutions of North Carolina, Inc., Firm #29412)

Thomas L. Shelmerdine, PE (NC PE #14654; Florida PE #0048579)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096