

| PRODUCT EVALUATION REPORT                                                                               |                                                                                                                                                                         |
|---------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Project No.: ACE-2025-143                                                                               | Report No.: ACE-PER-1212, Rev. 0                                                                                                                                        |
| <u>Product Manufacturer</u><br>Positive Lock<br>402 East 39 <sup>th</sup> St.<br>Russellville, AR 72802 | <u>Product Name, Model and/or Description</u><br>Positive Lock THPA(H)-40 Horizontally Mounted Panic Device<br>Positive Lock THPA(H)-80 Vertically Mounted Panic Device |

**Code:** Current edition of the Florida Building Code including the 9th Edition (2026) Florida Building Code

**Compliance Method:** 61G20-3.005(1)(d) – Product Evaluation Report by a Licensed Professional Engineer

**Product Testing:**

- Certified Testing Laboratories, 1924 Premier Row, Orlando, FL 32809
  - Report No. CTLA-815W, dated 07/11/03 and addendum letter dated 03/22/05, both signed and sealed by Ramesh Patel, P.E. for TAS 201/202/203 to 100 psf DP, Single Door Test
  - Report No. CTLA-815W-1, dated 07/14/03 and addendum letter dated 03/22/05, both signed and sealed by Ramesh Patel, P.E. for TAS 201/202/203 to 100 psf DP, Double Door Test

**Product Installation Instructions:**

- See Drawing No. PL-815W, Rev. C, dated 7/23/26, *Positive Lock Model THPA(H) Panic Device*, signed, and sealed by Robert J. Amoruso, P.E.


**Limitations & Conditions of Use:**

- This product has been evaluated for use in all areas in the State of Florida including the HVHZ (High Velocity Hurricane Zone). This product is Impact Resistance.
- Refer to Product Installation Instructions noted above for:
  - Maximum allowable wind loads at related maximum allowable size(s).
  - Other load limitations applicable to the product, if any.
  - Overall dimensions and material/grade of main product components, accessories, etc.
  - Illustrated diagrams of the attachment of the product to the structure.
  - Anchor type(s), size(s), substrate(s), embedment, edge distance, and spacing/locations if and when applicable.
- Site wind pressures shall be determined by a licensed professional engineer in accordance with the current edition of the Florida Building Code (and/or ASCE 7 as referenced in the current edition of the Florida Building Code) for components and cladding based on allowable stress design.

**Certificate of Independence per Product**  
**Approval Rule 61G20-3.009**

Robert J. Amoruso, P.E., does not have, nor will acquire, any financial interest in the company manufacturing or distributing product(s) covered by this Product Evaluation Report.

Robert J. Amoruso, P.E., does not have, nor will acquire any financial interest in any other entity involved in the approval process or testing of the product(s) covered by this Product Evaluation Report.

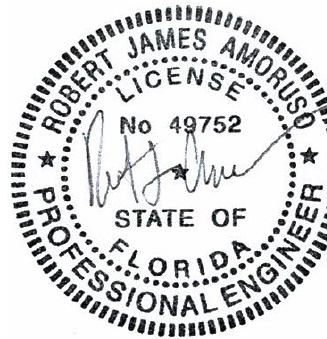

Digitally signed  
by Robert J  
Amoruso  
Date: 2026.08.19  
15:34:52 -04'00'

Evaluated By:  
Robert J. Amoruso, P.E.  
FL P.E. License Number 49752