

R W Building Consultants, Inc.

Consulting and Engineering Services for the Building Industry

P.O. Box 230 Valrico, FL 33595 Phone 813.659.9197

Florida Board of Professional Engineers Certificate of Authorization No. 9813

Product Evaluation Report

Report No.: FL-18506.7

Date: December 15, 2015

Product Category	Sub Category	Manufacturer	Product Name
Exterior Doors	Swinging Exterior Door Assemblies	HMF Express LLC 2501 Northchase Pkway SE Wilmington, NC 28405 (910) 452-1845 Ext:1139	"HH6-PCD" Steel Door w/ Sidelite & Transom Outswing "Impact"

Scope: This is a Product Evaluation report issued by R W Building Consultants, Inc. and Lyndon F. Schmidt, P.E. (System ID # 1998) for HMF Express LLC based on Rule Chapter No. 61G20-3, Method 1D of the State of Florida Product Approval, Department of Business & Professional Regulation.


RW Building Consultants and Lyndon F. Schmidt, P.E. do not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

Limitations:

- This product has been evaluated and is in compliance with the 5th Edition (2014) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
- Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
- When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and Section 1609.1.2.2 of the FBC.
- Site conditions that deviate from the details of drawing FL 18506.7 require further engineering analysis by a licensed engineer or registered architect.
- This product does not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
- All steel shall be protected as specified in Section 2222.6 of the FBC.
- See drawing FL-18506.7 for size and design pressure limitations.

Supporting Documents:

- | | | | |
|--|--|--|--|
| 1. Test Report No.
TEL 02991411 | Test Standard
TAS 201, 202 & 203-94 | Testing Laboratory
Testing Evaluation Lab., Inc. | Signed by
William B. Shelton, P.E. |
| 2. Miami-Dade NOA
11-1222.01
14-0423.17 | Materials Testing
(EPS) Expanded Polystyrene (Carpenter Co.)
Saflex PVB Interlayer (Eastman Chemical Co.) | | |
| 3. Drawing No.
No. FL-18506.7 | Prepared by
RW Building Consultants, Inc. (CA #9813) | | Signed & Sealed by
Lyndon F. Schmidt, P.E. |
| 4. Calculations
Anchoring
ASTM E 1300 Glass Load | Prepared by
RW Building Consultants, Inc. (CA #9813)
Lyndon F. Schmidt, P.E. | | Signed & Sealed by
Lyndon F. Schmidt, P.E. |
| 5. Quality Assurance
Certificate of Participation issued by PFS Corporation, certifying that HMF Express LLC is manufacturing products within a quality assurance program that complies with ISO/IEC 17020 and Guide 53. | | | |

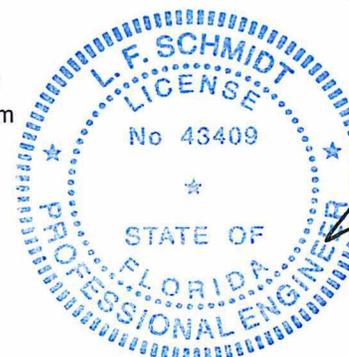

Lyndon F. Schmidt, P.E.
FL PE No. 43409
12/17/2015