



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**La Finestra, LC
Pre-Glazed Window Wall
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL18507

Report No. 9656

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Windows
Sub – Category:	Fixed
Product:	Pre-Glazed Window Wall
Materials:	Aluminum 6063-T6
Product Dimensions:	See Installation Instructions, LFT011

Prepared for:

**La Finestra, LC
2790 NW 104th Court
Doral, FL 33172**


Prepared by:

Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 6/3/2025

Contents:

Evaluation Report Pages 1 – 4

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.04 14:08:52 -04'00'

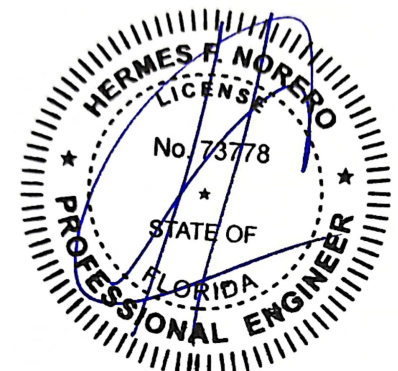

Hermes F. Norero, P.E.
Florida P.E. No. 73778

Manufacturer: La Finestra, LC

Product Category: Windows

Product Sub-Category: Fixed

Compliance Method: State Product Approval Method (1)(d)

Product Name: Pre-Glazed Window Wall
(HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **La Finestra, LC** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **LFT011**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **LFT011** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **LFT011** for size and design pressure limitations.

Quality Assurance:

The manufacturer has demonstrated compliance of manufacture of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation & Management Institute** (FBC Organization # QUA1789).

Performance Standards:

The product described herein has been evaluated per:

- TAS 201-94
- TAS 202-94
- TAS 203-94
- AAMA 501-15

Referenced Data:

1. Product Testing performed by **Hurricane Engineering & Testing, Inc.** (FBC Organization # TST1691)
Report #:
Dated:
HETI-08-2141B 07/07/2008
HETI-08-2142 07/07/2008
HETI-15-5108 08/25/2015
HETI-15-5109 08/25/2015
HETI-15-5122 10/30/2015
HETI-15-5123 10/30/2015
HETI-16-5032 04/21/2016
HETI-16-5033 04/22/2016
HETI-16-5034 04/19/2016
HETI-16-5035 04/19/2016
HETI-16-5083 08/16/2016
HETI-16-5086 08/16/2016
HETI-16-5087 08/16/2016
Signed and Sealed by Rafael E. Droz-Seda, FL P.E. No. 39228
HETI-21-7106 12/01/2021
Signed and Sealed by Ram N. Tewari, FL P.E. No. 46767
2. Miami Dade County Notice of Acceptance (NOA) for Interlayers
Current NOA for Sentryglas Interlayer by Kuraray America, Inc.
3. Quality Assurance
National Accreditation & Management Institute
(FBC Organization #: QUA1789)

Installation:

Refer to Installation Instructions (**LFT011**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**LFT011**) for design pressures based on size, configuration, and glass types.

Equivalency Statement:

This note shall serve to state that the manufacturer's products in question comply with Chapter 17 & 24 of the Current Florida Building Code for testing in accordance with AAMA 501-15 "Methods of Tests for Exterior Walls".

Further, the testing on this product complies with the requirements specified within the AAMA 501-15 standard, as required by the Florida Building Code. This standard is listed under Chapter 35 of the current Florida Building Code and titled "Methods of Tests for Exterior Walls".

At a minimum, AAMA 501-15 requires exterior wall systems be tested to ASTM E283, ASTM E330 and ASTM E331 test standards.

The manufacturer has successfully tested their products to ASTM E283, ASTM E330, and ASTM E331 in accordance with the test requirements set forth within TAS 202-94. All test methods and procedures may be considered equivalent or better than those in AAMA 501-15.

All test results meet or exceed requirements of the Current Florida Building Code.