

STRUCTURAL SOLUTIONS, P.A.*

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IBC-2409-104-11-R		Test Date:	8/20/2015	Project No.:	15-093
Design Pressures:	+15.6 psf, -18.3 psf		Report Date:	10/29/2020	Model #	2400
Test Pressures:	+23.4 psf, -27.5 psf		Test Location:	Entrematic, Winston-Salem, NC		
ASCE 7-16 Criteria:	Up to 5 Feet of Door Width in Zone 5; Roof Slope ≤ 10°; Enclosed Building					
	Exp. B, 30' MRH	Exp. C, 15' MRH	Exp. C, 25' MRH	Exp. D, 15' MRH	Exp. D, 25' MRH	
	135 mph	122 mph	116 mph	111 mph	106 mph	

Reference Test Report and Drawing:

- Structural Solutions, P.A.* Garage Door Static Pressure Test Report for IBC-2409-104-11-R dated 10/29/2020
- Entrematic Drawing number IBC-2409-104-11-R dated 8/19/2015

Description of Test Specimen:

9'-2"x8'-0" Model 2400, 24 ga steel garage door as shown in drawing IBC-2409-104-11-R.

Test Standards and Report Conclusion:

The above referenced Test Report states the following:

- The tests were conducted in accordance with ASTM E330-14 and DASMA 108-05.
- The test was witnessed and certified by Thomas L. Shelmerdine, PE (FL PE# 48579)
- The test facility at Entrematic is accredited by the American Association for Laboratory Accreditation, Certificate #2595.01.


Summary:

The 9'-2"x8'-0" Model 2400 as described on drawing IBC-2409-104-11-R meets or exceeds the testing criteria as described above. By comparison to the construction of the 9'-2"x8'-0" Model 2400, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IBC-2409-104-11-R:

- 9'-2" x 8'-0" Model 2000 doors (which are constructed of thicker 20 ga steel in lieu of 24 ga)
- 9'-2" x 8'-0" Amarr 2402 and Amarr 2002 doors (which are alternate model numbers for Model 2400 & Model 2000 respectively)
- 9'-2" x 8'-0" Amarr 2412 and Amarr 2012 doors (which are Model 2400 & Model 2000 with drop-in insulation)
- 9'-2" x 8'-0" Amarr 2422 and Amarr 2022 doors (which are Model 2400 & Model 2000 with drop-in insulation & steel backing inserts over the insulation)
- Model 2400, Model 2000, Amarr 2402, Amarr 2412, Amarr 2422, Amarr 2202, Amarr 2012, and Amarr 2022 doors with widths up to 9'-2" and heights up to 10'-0"
- 2 windows may be installed in 1 section (21 5/8" x 9 5/8" x 0.080" plexiglass, 21 3/8" x 3 1/4" x 1/8" DSB, or 21 3/8" x 3 1/4" x 0.080" plexiglass)

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 7th Edition (2020).

Submitted By:

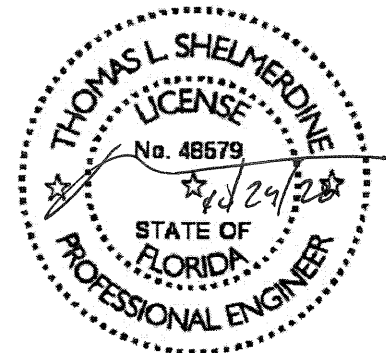

STRUCTURAL SOLUTIONS, P.A.* (*Florida: dba Structural Solutions of North Carolina, Inc., Firm #29412)

Thomas L. Shelmerdine, PE (NC PE #14654; Florida PE #0048579)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096