



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

GAF

1 Campus Drive
Parsippany, NJ 07054
(800) 766-3411

PEER-GAF-006.A.R26

FL20663-R26 (NON-HVHZ)

Date of Issuance: 06/13/2016

Revision 26: 02/04/2026

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under F.A.C. [Rule 61G20-3](#) and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for compliance with the 8th Edition (2023) Florida Building Code [sections noted herein](#).

DESCRIPTION: GAF Liquid Applied Roof Systems (NON-HVHZ)

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.

CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle. Reference is made to the NEMO|etc. [Directory of P.E. Evaluations](#) to ascertain the status and/or current version of this PEER. If the PEER is not listed at the Nemo Directory, then it is no longer valid.

ADVERTISEMENT: "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be in its entirety.

INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 5, plus 29-pages of Appendix.

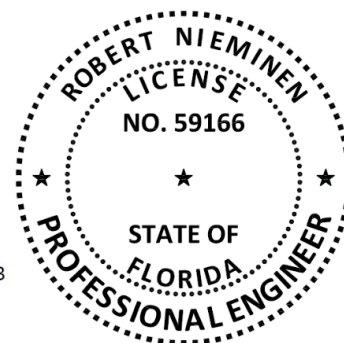
Prepared by:

Digitally signed by
Robert Nieminen
Date: 2026.02.04
'11:58:23 -05'00

This item has been digitally signed and sealed by Robert Nieminen, P.E.

Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

Robert Nieminen, Florida P.E. 59166, FBC ANE1983
NEMO ETC, LLC, Florida CA #32455



CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2018 NEMO ETC, LLC

ROOFING SYSTEMS EVALUATION:

1. SCOPE:

Product Category: Roofing
Sub-Category: Liquid Applied Roof Systems
Product Approval Method: Method 1, Option D: Codified Material, Evaluation by Engineer
Compliance Statement: **GAF Liquid Applied Roof Systems**, as produced by **GAF**, has demonstrated compliance with the following sections of the **8th Edition (2023) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTY	STANDARD
1504.3.1	Wind resistance	FM 4474
1504.7	Impact resistance	FM 4470
1507.10.2	Material standard	ASTM D2178, D4601, D4897
1507.11.2	Material standard	ASTM D6163, D6164, D6222
1507.15.2	Material standard	ASTM D6083, D6694

3. REFERENCES:

ENTITY	EXAM	REFERENCE	DATE	ENTITY	EXAM	REFERENCE	DATE
GAF	Equivalency	Declaration	08/02/22	FM (TST 1867)	FM 4470	RR204845	05/09/16
NEMO (TST6049)	ASTM D6083, T1 (IL)	4p-GAF-SSLAP-001.A	05/29/24	FM (TST 1867)	FM 4470	RR206245	09/30/16
NEMO (TST6049)	Physical Properties	4j-GAF-SSUDL-004.A	11/19/24	FM (TST 1867)	FM 4470	3055491	12/05/16
NEMO (TST6049)	ASTM D6904	4p-GAF-SSLAP-002.A	12/10/24	FM (TST 1867)	FM 4470	3058483	12/09/16
NEMO	Various PPT	PEER-GAF-007.A&B	Current	FM (TST 1867)	FM 4474	PR455417-R2	12/23/20
PRI (TST 5878)	Physical Properties (AZ)	GAF-672-02-01	05/31/16	FM (TST1867)	FM 4470	PR452971-R1	01/28/20
PRI (TST 5878)	Physical Properties (AZ)	GAF-679-02-01	05/31/16	FM (TST1867)	FM 4470	RR227768-267	04/09/21
PRI (TST 5878)	Physical Properties (S-SC)	GAF-676-02-01	05/31/16	FM (TST1867)	FM 4474	PR457312	04/20/21
PRI (TST 5878)	Physical Properties (AZ)	GAF-659-02-01	06/02/16	FM (TST1867)	FM 4470	PR459831	04/21/21
PRI (TST 5878)	Physicals (AZ)	376T0077	06/15/20	FM (TST1867)	FM 4474	PR456101	06/24/21
PRI (TST 5878)	ASTM D6083, T2 (IL)	743T0014	07/31/20	FM (TST1867)	FM 4474	PR461047	10/25/21
PRI (TST 5878)	ASTM D6083, FIN (AZ)	376T0159	08/31/21	FM (TST1867)	FM 4474	PR460126	09/20/22
PRI (TST 5878)	PDS Verify	376T0340	10/28/22	FM (TST1867)	FM 4474	RR241387	05/10/24
PRI (TST 5878)	PDS Verify	376T0341	10/28/22	FM (TST1867)	FM 4474	PR468153	11/04/24
PRI (TST 5878)	ASTM D6694 (OH)	376T0425.1	04/02/24	FM (TST1867)	FM 4470	PR469015	05/13/25
ACRC (TST4671)	FM 4474	09-019	10/27/09	FM (TST1867)	FM 4470	PR469209	06/03/25
ACRC (TST4671)	FM 4474	09-020	10/28/09	FM (TST1867)	FM 4470	PR471457	09/11/25
ACRC (TST4671)	FM 4474	09-021	10/28/09	NEMO (TST6049)	FM 4474	4a-GAF-22-LSWUS-01.A	04/26/23
ACRC (TST4671)	FM 4474	09-022	10/29/09	NEMO (TST6049)	FM 4474	4a-GAF-22-LSWUS-01.B	04/27/23
ACRC (TST4671)	FM 4474	09-023	10/29/09	NEMO (TST6049)	Criticality	4i-GAF-SSCRT-001.A	05/29/24
ACRC (TST4671)	FM 4474	10-001	02/10/10	NEMO (TST6049)	FM 4474	4a-GAF-SSWUS-001.A	07/24/24
ACRC (TST4671)	FM 4474	16-003	03/04/16	NEMO (TST6049)	Criticality	4i-GAF-SSCRT-002.A	12/10/24
ERD (TST6049)	FM 4474	4696-04-97-1	07/11/97	PRI (TST 5878)	FM 4474	GAF-457-02-04	02/05/14
ERD (TST6049)	FM 4474	4697-12-00-1	12/07/00	PRI (TST 5878)	FM 4474	GAF-462-02-11	07/01/14
ERD (TST6049)	FM 4474	GAF-SC10845.04.16	04/26/16	PRI (TST 5878)	Criticality	GAF-559-02-03	10/16/14
FM (TST 1867)	FM 4470	3000150	09/01/99	PRI (TST 5878)	FM 4474	QCP-018-02-01	11/14/14
FM (TST 1867)	FM 4470	3023606	10/18/06	PRI (TST 5878)	FM 4474	GAF-654-02-01	05/17/16
FM (TST 1867)	FM 4470	3046328	09/13/12	PRI (TST 5878)	FM 4474	376T0339	01/20/23
FM (TST 1867)	FM 4470	3047636	08/08/13	PRI (TST 5878)	Physicals (AZ)	376T0340	10/28/22
FM (TST 1867)	FM 4470	3048496	12/19/13	PRI (TST 5878)	Physicals (AZ)	376T0341	10/28/22
FM (TST 1867)	FM 4470	RR204674	04/06/16	UL (QUA9625)	QA	Service confirm	04/22/25
FM (TST 1867)	FM 4470	RR204740	04/13/16	UL (QUA9625)	QA	Florida BCIS	Current
FM (TST 1867)	FM 4470	RR204846	05/09/16				

4. PRODUCT DESCRIPTION:

This PEER covers the **GAF Liquid Applied Roof Systems** applied to Approved substrates as outlined in the [Limitations of Use](#) herein. The following products make up the subject roof covers.

TABLE 1: EVALUATED COMPONENTS					
TYPE	PRODUCT	MATERIAL STANDARD			PLANT(S)
		REFERENCE	TYPE	GRADE	
LIQUID APPLIED MEMBRANE COMPONENTS:	GAF Premium Acrylic HydroStop® Top Coat	ASTM D6083	I	N/A	AZ
	GAF Surface Seal SB Thermoplastic Rubber Coating		I	N/A	IL
	GAF High Solids Silicone Roof Coating	ASTM D6694	N/A	N/A	OH
	GAF Acrylic Base Coat	N/A (not codified)	N/A	N/A	AZ
	GAF Premium Acrylic HydroStop® Base Coat				AZ
	GAF Premium Fabric				SC
SURFACING:	GAF TrafficCoat Pedestrian Surface Coating (Smooth or Textured)	N/A (not codified)	N/A	N/A	AZ
PRIMERS:	GAF BarrierGuard® Surface Coating	N/A (not codified)	N/A	N/A	AZ
	GAF SureBond Primer				AZ
BASE SHEETS:	GAFLAS® Stratavent® Nailable Venting Base Sheet	ASTM D4897	II	N/A	AL, GA-S
BASE PLYS:	Ruberoid® 20 Smooth	ASTM D6163	I	S	AR
	Ruberoid® HW 25 Smooth		I	S	GA-S
	Ruberoid® HW Smooth	ASTM D6164	I	S	GA-S
	Ruberoid® Mop Smooth 1.5		I	S	GA-S
VAPOR BARRIER MEMBRANES:	GAFLAS® #75 Base Sheet	ASTM D4601	II	N/A	AL, CA-F, GA-S
	Tri-Ply® #75 Base Sheet		II	N/A	AL, CA-F, GA-S
	GAFLAS® #80 Ultima Base Sheet		II	N/A	AL, GA-S
	GAFLAS® Ply 4	ASTM D2178	IV	N/A	AL, CA-F, GA-S
	Tri-Ply Ply 4 Ply Sheet		IV	N/A	AL, CA-F, GA-S
	GAFLAS® Ply 4 M		IV	N/A	AL
	GAFLAS® FlexPly™ 6		VI	N/A	AL, GA-S
	GAFLAS® FlexPly™ 6 M		VI	N/A	AL
	Ruberoid® 20 Smooth	ASTM D6163	I	S	AR
	Ruberoid® HW 20 Smooth		I	S	AR
	Ruberoid® HW 25 Smooth		I	S	GA-S
	Ruberoid® HW 30 Smooth		I	S	AR
	Ruberoid® 30 Granule		I	G	GA-S
	Ruberoid® HW Smooth	ASTM D6164	I	S	GA-S
	Ruberoid® Mop Smooth		I	S	GA-S
	Ruberoid® Mop Smooth 1.5		I	S	GA-S
	Ruberoid® Mop Plus Smooth		I	S	GA-S
	Liberty™ SBS Self-Adhering Cap Sheet		I	G	AR, GA-S
	Ruberoid® HW Granule		I	G	GA-S
	Ruberoid® Mop Granule		I	G	CA-S, GA-S
	Ruberoid® HW Plus Granule		II	G	GA-S
	Ruberoid® Mop Plus Granule		II	G	GA-S
	Ruberoid® Torch Smooth	ASTM D6222	I	S	CA-S, GA-S, IN
	Ruberoid® Torch Granule		I	G	CA-S, GA-S, IN
	GAF SA Vapor Retarder XL and XL40	N/A	N/A	N/A	IN

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER is not for use in FBC High Velocity Hurricane Zone jurisdictions, as defined in FBC Chapter 2 (Broward and Miami-Dade Counties).
- 5.3 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This PEER does not include evaluation of roof edge termination. Refer to **FBC 1504.5** for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC 1511** for requirements and limitations regarding recover installations.
- 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with [ANSI/SPRI FX-1](#) or [Testing Application Standard TAS 105](#).
- 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with [ANSI/SPRI IA-1](#), [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#) shall be conducted on mock-ups of the proposed new roof assembly.
- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#).
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied). Refer to **FBC 1609** for determination of design wind loads.
- 5.7.2 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC Chapter 16**. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI WD1](#), [FM Loss Prevention Data Sheet 1-29](#), [Roofing Application Standard RAS 117](#) or [RAS 137](#). Assemblies marked with an asterisk* carry the limitations set forth in **Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (February 2020)** for Zone 2/3 enhancements.
- 5.7.3 For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with **FBC Chapter 16**. No rational analysis is permitted for these systems.

- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3**. Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on [Page 1](#) of this PEER, or are not referenced in [Section 4](#).

6. INSTALLATION:

GAF Liquid Applied Roof Systems shall be installed in accordance with **GAF** current, published installation instructions, subject to the [Limitations of Use](#) noted herein.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[UL \(QUA9625\)](#): (360) 817-5512; bsai.inspections@ul.com

- THE 29-PAGES THAT FOLLOW FORM PART OF THIS PEER -

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
1A	Wood	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Liquid Applied Roof System	8
1B	Wood	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	9
1C	Wood	New, Reroof (Tear-Off) or Recover	C-1	Mechanically Attached Insulation, Liquid Applied Roof System	10
1D	Wood	New, Reroof (Tear-Off) or Recover	C-1	Mechanically Attached Insulation, Bonded Base Ply, Liquid Applied Roof System	10
1E	Wood	New or Reroof (Tear-Off)	E-2	Non-Insulated, Mechanically Attached Base Sheet, Liquid Applied Roof System	10
2A	Steel or Structural concrete	New, Reroof (Tear-Off) or Recover	B-1	Mechanically Attached Base Insulation, Bonded Top Insulation, Bonded Base Ply, Liquid Applied Roof System	11
2B	Steel or Structural concrete	New, Reroof (Tear-Off) or Recover	C-1	Mechanically Attached Insulation, Liquid Applied Roof System	11
2C	Steel or Structural concrete	New, Reroof (Tear-Off) or Recover	C-1	Mechanically Attached Insulation, Bonded Base Ply, Liquid Applied Roof System	12
3A	Structural concrete	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Liquid Applied Roof System	14
3B	Structural concrete	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Base Ply, Liquid Applied Roof System	17
3C	Structural concrete	New or Reroof (Tear-Off)	F	Non-Insulated, Liquid Applied Roof System	19
4A	Deck with Lightweight Concrete	New, Reroof (Tear-Off)	E-2	LWC to Deck, Mechanically Attached Base Sheet, Liquid Applied Roof System	20
4B	Deck with Lightweight Concrete	New	F	LWC to Deck, Non-Insulated, Liquid Applied Roof System	20
5A	Various	Recover	A-1	Bonded Insulation, Liquid Applied Roof System	21
5B	Various	Recover	A-1	Bonded Insulation, Bonded Base Ply, Liquid Applied Roof System	26
5C	Various	Recover	F	Non-Insulated, Liquid Applied Roof System	29

The following notes apply to the systems outlined herein:

- The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- Unless otherwise noted, fasteners and stress plates shall be as follows. Fasteners shall be of sufficient length for the following engagements:

FASTENER/PLATE OPTIONS				
DECK TYPE	BY	PARTS		MINIMUM ENGAGEMENT
		LOOSE PARTS	PRE-ASSEMBLED PARTS	
Wood	GAF	Drill-Tec #12 Fastener, Drill-Tec #12 DP Fastener, Drill-Tec #12 DPH Fastener, Drill-Tec #14 Fastener or Drill-Tec #14 HD Fastener with Drill-Tec 3" Standard Steel Plate, Drill-Tec 3" Steel Plate, Drill-Tec AccuTrac Flat Plate, Drill-Tec AccuTrac Recessed Plate (insulation only), Drill-Tec 3" Flat Steel Plate or Drill-Tec 3" Recessed Steel Plate	Drill-Tec 3" ASAP Flat, Drill-Tec 3" ASAP Recessed, Drill-Tec ASAP 3S or Drill-Tec Heavy Duty ASAP Roofing Fastener Assembled with a 3" Metal Plate	Minimum ¾-inch plywood penetration or minimum 1-inch wood plank embedment
Steel	GAF	Drill-Tec #12 Fastener, Drill-Tec #12 DP Fastener, Drill-Tec #12 DPH Fastener, Drill-Tec #14 Fastener, Drill-Tec #14 HD Fastener, Drill-Tec XHD Fastener or Drill-Tec #15 EHD Fastener with Drill-Tec 3" Standard Steel Plate, Drill-Tec 3" Steel Plate, Drill-Tec AccuTrac Flat Plate, Drill-Tec AccuTrac Recessed Plate (insulation only), Drill-Tec 3" Flat Steel Plate or Drill-Tec 3" Recessed Steel Plate	Drill-Tec 3" ASAP Flat, Drill-Tec 3" ASAP Recessed, Drill-Tec ASAP 3S, Drill-Tec Heavy Duty ASAP Roofing Fastener Assembled with a 3" Metal Plate or Drill-Tec Extra Heavy Duty ASAP Roofing Fastener – Insulation	Minimum ¾-inch steel penetration and engage the top flute of the steel deck
	Note:	Unless otherwise noted, Drill Tec #12 DF Fastener or Drill Tec #14 DF Fastener with Drill Tec 3" DF Steel Insulation Plate may be used in place of Drill-Tec #12 Fastener or Drill-Tec #14 Fastener with Drill-Tec 3" Standard Steel Plate when used to secure DensDeck Prime, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board to steel deck, up to a maximum allowable design pressure (MDP) of -120.0 psf.		
	Note:	Unless otherwise noted, Drill Tec #12 DF Fastener or Drill Tec #14 DF Fastener with Drill Tec 3" DF Steel Insulation Plate may be used in place of Drill-Tec #12 Fastener or Drill-Tec #14 Fastener with Drill-Tec 3" Standard Steel Plate when used to secure min. 0.5-inch thick Structodek High Density Fiberboard Roof Insulation or min. 1.5-inch EnergyGuard POLYISO INSULATION or EnergyGuard Ultra Polyiso Insulation to steel deck.		

FASTENER/PLATE OPTIONS				
DECK TYPE	BY	PARTS		MINIMUM ENGAGEMENT
		LOOSE PARTS	PRE-ASSEMBLED PARTS	
Structural Concrete	GAF	Drill-Tec #14 Fastener, Drill-Tec #14 HD Fastener or Drill-Tec CD-10 with Drill-Tec 3" Standard Steel Plate, Drill-Tec 3" Steel Plate, Drill-Tec AccuTrac Flat Plate, Drill-Tec AccuTrac Recessed Plate (insulation only), Drill-Tec 3" Flat Steel Plate or Drill-Tec 3" Recessed Steel Plate	Drill-Tec 3" ASAP Flat (#14 only) or Drill-Tec Heavy Duty ASAP Roofing Fastener Assembled with a 3" Metal Plate	Minimum 1-inch embedment. Fasteners installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions
	Note:	Unless otherwise noted, Drill Tec #14 DF Fastener with Drill Tec 3" DF Steel Insulation Plate may be used in place of Drill-Tec #14 Fastener with Drill-Tec 3" Standard Steel Plate when used to secure min. DensDeck Prime, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Ultralight Coated Glass-Mat Roof Board to structural concrete deck, up to a maximum allowable design pressure (MDP) of -120.0 psf.		
	Note:	Unless otherwise noted, Drill Tec #14 DF Fastener with Drill Tec 3" DF Steel Insulation Plate may be used in place of Drill-Tec #14 Fastener with Drill-Tec 3" Standard Steel Plate when used to secure min. 0.5-inch thick Structodek High Density Fiberboard Roof Insulation or min. 1.5-inch EnergyGuard POLYISO INSULATION or EnergyGuard Ultra Polyiso Insulation to structural concrete deck.		

- 3 Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- 4 Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for, or installed below, rigid insulation board for System Types B-1, C-1, C-2, D-1 or D-2, whereby fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
- 5 Preliminary insulation attachment: Unless otherwise noted, use FBC Approved fasteners and plates and refer to Section 2.2.10.1.3 of [FM Loss Prevention Data Sheet](#) 1-29.
- 6 Unless otherwise noted, insulation adhesive application rates are as follows.
 - ✓ Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
 - ✓ If applying hot asphalt to concrete deck, deck shall be primed with ASTM D41 primer.
 - ✓ When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.
 - ✓ The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.

INSULATION ADHESIVE REFERENCES				
By	ADHESIVE	REFERENCE	FBC FILE OR NOA	MINIMUM RATE
GAF	GAF LRF Adhesive M	'LRF-M'	N/A	Continuous 0.75 to 1-inch ribbons, 12-inch o.c.
GAF	GAF LRF Adhesive M Canister	'LRF-M Canister'	N/A	Continuous 1 to 1.5-inch ribbons, 12-inch o.c.
GAF	GAF LRF Adhesive XF	'LRF-XF'	N/A	Continuous 0.75 to 1-inch ribbons, 12-inch o.c.
OMG, Inc.	OlyBond 500 Adhesive Fastener	'OB500'	FL1608	Continuous 0.75-inch wide ribbons, 12-inch o.c. (PaceCart, SpotShot or Canister)
Generic, ASTM D312, Type IV	hot asphalt	N/A	N/A	Full coverage at 25-30 lbs/square

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS				
ADHESIVE	INSULATION		MIN. TAPERED THICKNESS (IN)	MDP (psf)
	LISTED PRODUCT	FBC FILE OR NOA		
LRF-M	EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation	FL16311	0.5	-232.5
LRF-XF	EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation	FL16311	0.5	-292.5
LRF-XF	EnergyGuard RA	25-0123.02	0.5	-487.5
OB500	EnergyGuard Polyiso Insulation, EnergyGuard Ultra Polyiso Insulation	FL16311	0.5	-292.5
OB500	EnergyGuard RA	25-0123.02	0.5	-487.5
Hot asphalt	Any EnergyGuard polyisocyanurate listed with adhesive herein	Various	0.5	-240.0

- 8 For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of [FM Loss Prevention Data Sheet](#) 1-29.
- 9 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI](#) WD1, [FM Loss Prevention Data Sheet](#) 1-29, [Roofing Application Standard](#) RAS 117 and RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 for Zone 2/3 enhancements.
- 10 For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with [ANSI/SPRI](#) FX-1 or [Testing Application Standard](#) TAS 105.
- 12 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, [FM Loss Prevention Data Sheet](#) 1-52 or [Testing Application Standard](#) TAS 124.
- 13 Refer to FBC 1511 for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-1 the base insulation layer is optional and for System Type C-2, D-1 or D-2, the insulation is optional. Alternatively, an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation ([Note 5](#) herein). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.
- 14 Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For "pre-existent" LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.

15 For bonded membrane applications, unless otherwise noted, refer to the following.

MEMBRANE / ADHESIVE COMBINATIONS ROOF COVERS			
REFERENCE	LAYER	MATERIAL	APPLICATION
SBS-CA1	Base Ply or Ply:	Ruberoid 20 Smooth, Ruberoid Mop Smooth 1.5	Matrix 101 Premium SBS Membrane Adhesive at 1.5 – 2.0 gal./square. Laps are torched or heat-welded
SBS-TA	Base Ply or Ply:	Ruberoid HW Smooth or Ruberoid HW 25 Smooth	Torch-applied. 3-inch wide side laps are torched or hot air welded.
GAF BarrierGuard Surface Coating	Primer:	Two (2) coats at 0.67 gal./square per coat	
GAF SureBond Primer	Primer:	0.5 gal./square	
GAF Premium Acrylic HydroStop	Insulation Joint Treatment:	Top Insulation Layer if no Base Ply is installed: GAF Premium Acrylic HydroStop Base Coat is brush applied over all top-layer insulation joints at 6-inch width at a rate of 1.25 gal./square, centered about each joint. 6-inch wide GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat. The fabric is then saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at 1.25 gal./square.	
	Lap Treatment:	(OPTIONAL) For use over Base Sheet or Base Ply only: GAF Premium Acrylic HydroStop Base Coat is brush applied over all base sheet or base ply laps at 6-inch width at a rate of 1.25 gal./square, centered about each lap. 6-inch wide GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat. The fabric is then saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at 1.25 gal./square.	
GAF Premium Acrylic HydroStop Base Coat System:	LARS:	GAF Premium Acrylic HydroStop Base Coat is brush applied at a minimum rate of 1.25 gal./square. GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat with 4 in. wide seams, and is saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at a minimum rate of 1.25 gal./square.	
GAF Premium Acrylic HydroStop System:	LARS or Cap Ply:	Base Coat: GAF Premium Acrylic HydroStop Base Coat is brush applied at a minimum rate of 1.25 gal./square. GAF Premium Fabric is embedded in the wet GAF Premium Acrylic HydroStop Base Coat with 4 in. wide seams, and is saturated with additional GAF Premium Acrylic HydroStop Base Coat brush applied at a minimum rate of 1.25 gal./square. Top Coat: Two (2) or more coats of GAF Premium Acrylic HydroStop Top Coat are applied at a minimum rate of 0.75 gal./square per coat.	
	Surfacing:	(Optional) GAF TrafficCoat Pedestrian Surface Coating (Smooth or Textured) applied per GAF published installation instructions.	
GAF Acrylic Base Coat	Base Coat:	1.75 gal./sq.	
GAF High Solids Silicone Roof Coating	Top Coat:	2.0 gal./sq.	
GAF Bleed-Block Asphalt Primer System	LARS:	GAF Bleed-Block Asphalt Primer Base Coat is brush applied at a rate of 1.25 gal./sq. GAF Premium Fabric is embedded in the wet GAF Bleed-Block Asphalt Primer Base Coat with 4 in. wide seams, and is saturated with additional GAF Bleed-Block Asphalt Primer Base Coat brush applied at a minimum rate of 1.25 gal./sq.	
GAF Surface Seal SB Thermoplastic Rubber Coating	LARS:	Two (2) coats at 1.5 gal./square per coat. Consult GAF for allowable cure-time between coats.	

MEMBRANE / ADHESIVE COMBINATIONS VAPOR BARRIERS		
REFERENCE	MATERIAL	APPLICATION
VB-APP-TA (smooth)	Ruberoid Torch Smooth	Torch-applied
VB-APP-TA (granule)	Ruberoid Torch Granule	Torch-applied
VB-BP1-AA	One or more GAFGLAS #75 Base Sheet, Tri-Ply #75 Base Sheet, GAFGLAS #80 Ultima Base Sheet	Hot asphalt at 25 lbs/square.
VB-BP2-AA	One or two plies, GAFGLAS Ply 4, GAFGLAS Ply 4 M, Tri-Ply Ply 4 Ply Sheet, GAFGLAS FlexPly 6 or GAFGLAS FlexPly 6 M	Hot asphalt at 25 lbs/square.
VB-SBS-AA	Ruberoid 20 Smooth, Ruberoid Mop Smooth, Ruberoid Mop Smooth 1.5, Ruberoid Mop Plus Smooth, Ruberoid 30 Granule or Ruberoid Mop Granule, Ruberoid Mop Plus Granule	Hot asphalt at 25 lbs/square.
VB-SBS-CA	Ruberoid 20 Smooth, Ruberoid Mop Smooth, Ruberoid Mop Smooth 1.5, Ruberoid Mop Plus Smooth, Ruberoid 30 Granule or Ruberoid Mop Granule, Ruberoid Mop Plus Granule	Matrix 102 SBS Membrane Adhesive at 1.5 gal./sq.
VB-SBS-SA	Liberty SBS Self-Adhering Cap Sheet	Self-adhering
VB-SBS-TA	Ruberoid HW 20 Smooth, Ruberoid HW 25 Smooth, Ruberoid HW 30 Smooth, Ruberoid HW Smooth, Ruberoid HW Granule or Ruberoid HW Plus Granule	Torch-applied

16 **Thermal Barrier and/or Vapor Barrier Options:**

16A **Structural Concrete Decks:** The lesser of the MDP listings below vs. that for the selected assembly applies.

STRUCTURAL CONCRETE DECK: VAPOR BARRIER FOLLOWED BY ADHERED INSULATION					
OPTION #	PRIMER	VAPOR BARRIER (Note 15)		INSULATION ADHESIVE PER TABLE 3A	MDP (PSF)
		TYPE	APPLICATION		
C-VB-1.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (granule)	Torch-applied	Hot asphalt	-225.0
C-VB-2.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-BP-AA1	Hot asphalt applied	Hot asphalt	-360.0
C-VB-3.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-BP2-AA or VB-SBS-AA	Hot asphalt applied	Hot asphalt	-495.0
C-VB-4.	None	GAF SA Vapor Retarder XL	Self-adhering	LRF-M, 12-inch o.c.	-180.0
C-VB-5.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (granule), VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA	See Note 15	LRF-M, 12-inch o.c.	-180.0
C-VB-6.	GAF SA Primer	GAF SA Vapor Retarder	Self-adhering	LRF-M, 12-inch o.c.	-202.5
C-VB-7.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-BP1-AA, VB-BP2-AA or VB-SBS-AA	Hot asphalt applied	LRF-M, 12-inch o.c.	-495.0
C-VB-8.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (granule)	Torch-applied	LRF-XF, 12-inch o.c.	-169.0
C-VB-9.	None	GAF SA Vapor Retarder XL	Self-adhering	LRF-XF 12-inch o.c.	-180.0
C-VB-10.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (granule), VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA	See Note 15	LRF-XF, 12-inch o.c.	-180.0
C-VB-11.	GAF SA Primer	GAF SA Vapor Retarder	Self-adhering	LRF-XF, 12-inch o.c.	-202.5
C-VB-12.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-SBS-SA	Self-adhering	LRF-XF, 12-inch o.c.	-250.0
C-VB-13.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-BP1-AA, VB-BP2-AA or VB-SBS-AA	Hot asphalt applied	LRF-XF, 12-inch o.c.	-262.5
C-VB-14.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	Ruberoid 30	Hot asphalt applied	LRF-XF, 12-inch o.c.	-270.0
C-VB-15.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (smooth)	Torch-applied	OB500, 12-inch o.c.	-165.0
C-VB-16.	None	GAF SA Vapor Retarder XL	Self-adhering	OB500, 12-inch o.c.	-180.0
C-VB-17.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-SBS-AA, VB-SBS-CA, VB-SBS-SA or VB-SBS-TA	See Note 15	OB500, 12-inch o.c.	-180.0
C-VB-18.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-SBS-SA	Self-adhering	OB500, 12-inch o.c.	-187.5
C-VB-19.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	Ruberoid 20 Smooth	Matrix 102 SBS Membrane Adhesive at 1.5 gal/square	OB500, 12-inch o.c.	-202.5
C-VB-20.	GAF SA Primer	GAF SA Vapor Retarder	Self-adhering	OB500, 12-inch o.c.	-202.5
C-VB-21.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-APP-TA (granule)	Torch-applied	OB500, 12-inch o.c.	-225.0
C-VB-22.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	Ruberoid HW Smooth	Torch-applied	OB500, 12-inch o.c.	-232.5
C-VB-23.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	VB-BP1-AA, VB-BP2-AA or VB-SBS-AA	Hot asphalt applied	OB500, 12-inch o.c.	-352.5

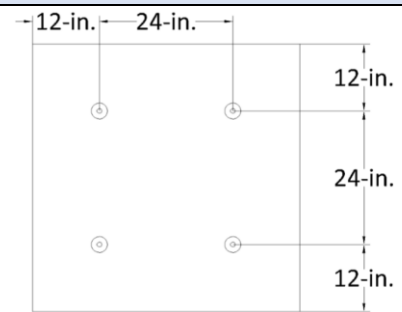
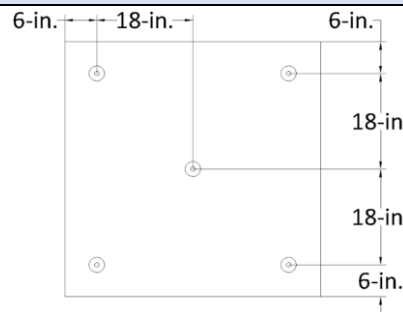
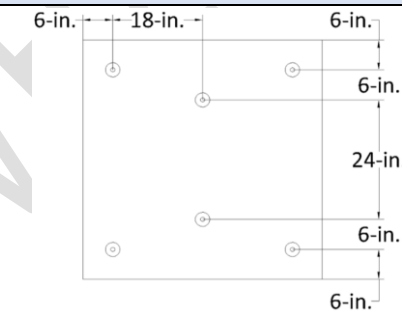
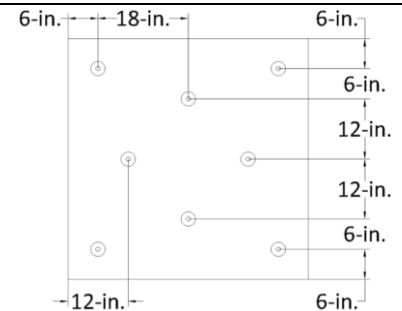
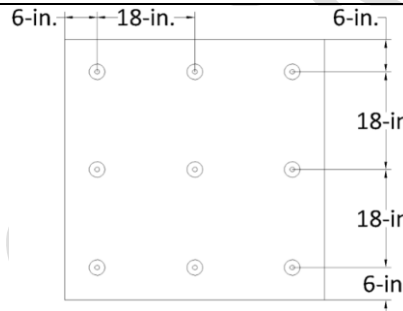
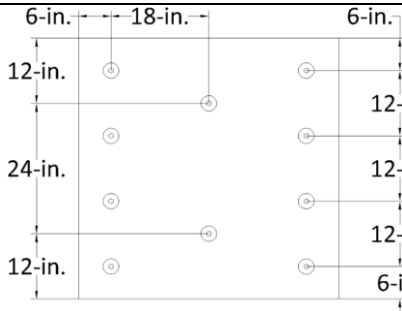
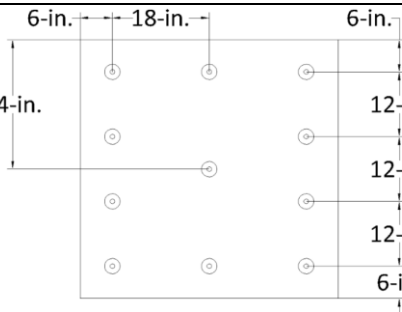
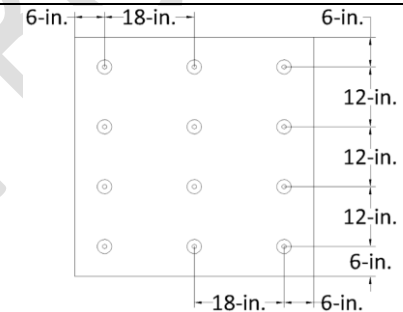
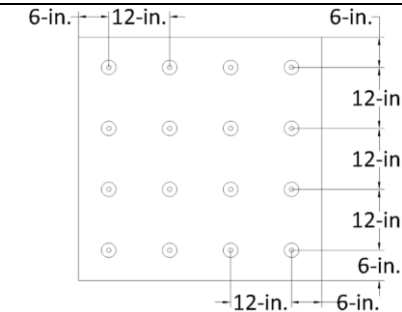
16B **Decks followed by Vapor Barrier followed by Lightweight Concrete (LWC):** The lesser of the MDP listings below vs. that for the selected assembly from the Lightweight Concrete tables applies:

DECK FOLLOWED BY VAPOR BARRIER FOLLOWED BY CELLULAR LIGHTWEIGHT INSULATING CONCRETE					
OPTION #	PRIMER	VAPOR BARRIER		LIGHTWEIGHT CONCRETE PER TABLE 4A – 4B (Note 14)	MDP (PSF)
		TYPE	ATTACH		
LWC-VB-1.	Matrix 307 Premium Asphalt Primer or ASTM D41 primer	Ruberoid HW 25 Smooth, Ruberoid HW Smooth	Torch-applied	Min. 540 psi pre-existent cellular LWC	-358.0

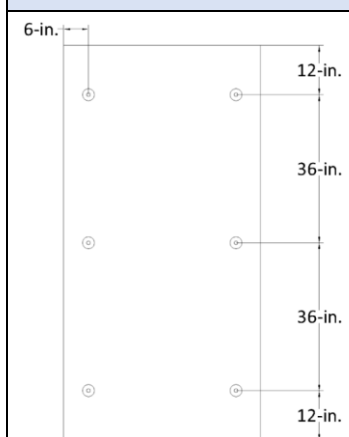
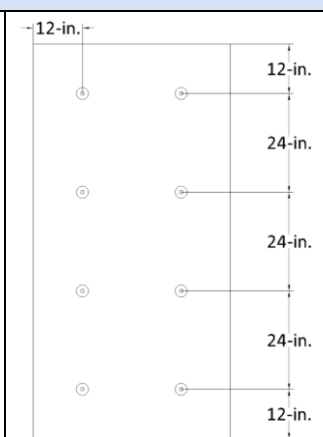
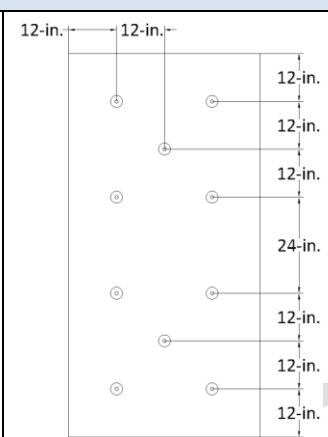
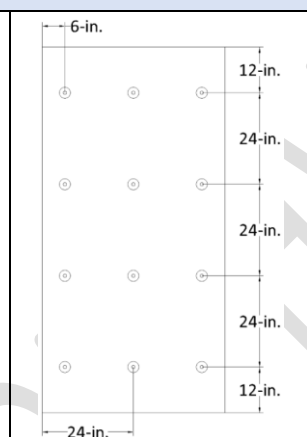
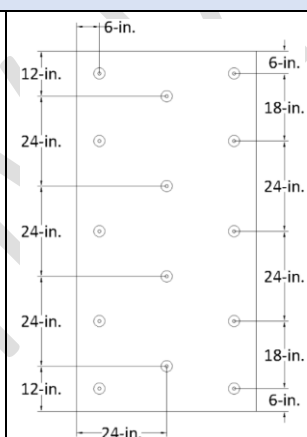
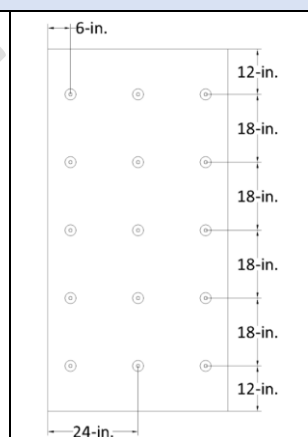
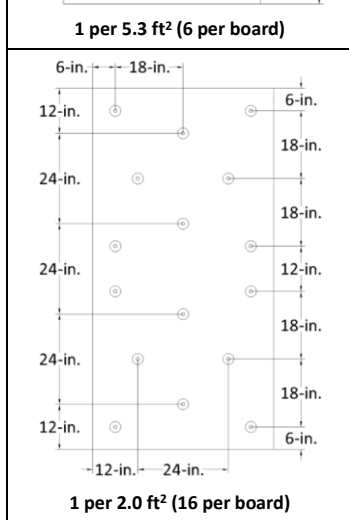
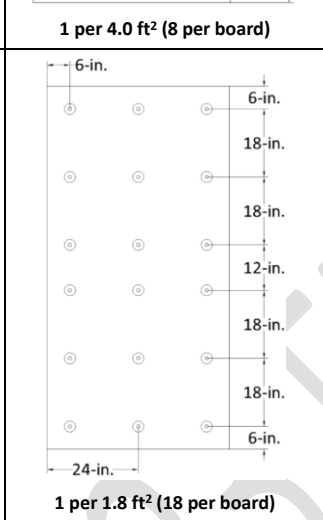
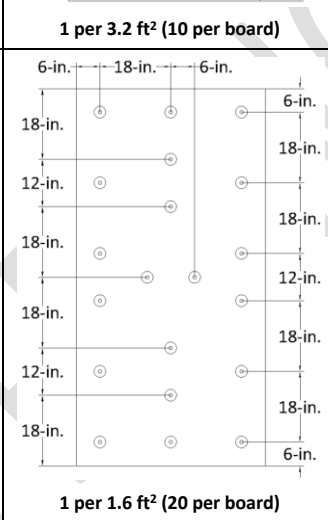
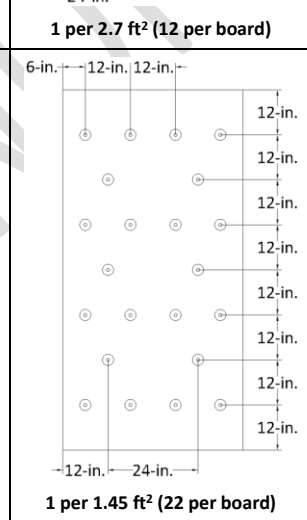
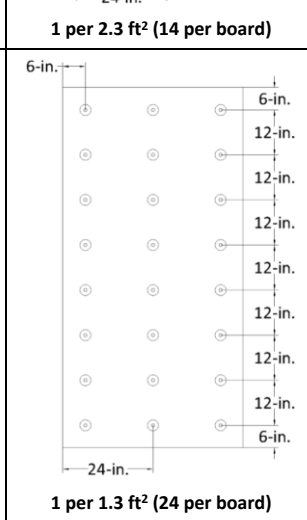
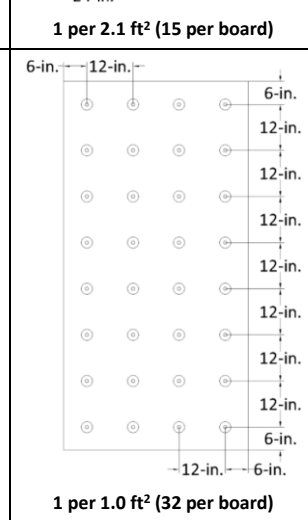
16C For System Types B-1, B-2, C-1, C-2, D-1 or D-2, GAF SA Vapor Retarder or GAF SA Vapor Retarder XL may be installed atop the roof deck, or to a loose-laid thermal barrier of DensDeck, DensDeck Prime, DensDeck StormX Prime, DEXcell Glass Mat Roof Board, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board, SECUROCK Ultralight Coated Glass Mat Roof Board or SECUROCK Cement Roof Board, prior to installation of the insulation and roof cover. When adhering GAF SA Vapor Retarder to structural concrete, the substrate shall be primed with GAF SA Primer, EverGuard TPO Quick Spray Adhesive or EverGuard TPO Quick Spray Adhesive LV50. When adhering GAF SA Vapor Retarder to gypsum or cement boards, the substrate shall be primed with GAF SA Primer, EverGuard TPO Quick Spray Adhesive, EverGuard TPO Quick Spray Adhesive LV50 or Matrix 307 Premium Asphalt Primer. Refer to [FM Loss Prevention Data Sheet](#) 1-29 for design and installation limitations.

16D Fire barrier of VersaShield Solo™ Fire-Resistant Slip Sheet are optional in all assemblies when overlying components are mechanically fastened.

17 Unless otherwise noted, insulation or coverboard attachment patterns for Type B-1, Type B-2, Type C-1 and C-2 systems are as outlined below.

INSULATION ATTACHMENT PATTERNS – 4x4 FT BOARDS		
 1 per 4.0 ft² (4 per board)	 1 per 3.2 ft² (5 per board)	 1 per 2.7 ft² (6 per board)
 1 per 2.0 ft² (8 per board)	 1 per 1.8 ft² (9 per board)	 1 per 1.6 ft² (10 per board)
 1 per 1.45 ft² (11 per board)	 1 per 1.3 ft² (12 per board)	 1 per 1.0 ft² (16 per board)

INSULATION ATTACHMENT PATTERNS – 4x8 FT BOARDS

 1 per 5.3 ft² (6 per board)	 1 per 4.0 ft² (8 per board)	 1 per 3.2 ft² (10 per board)	 1 per 2.7 ft² (12 per board)	 1 per 2.3 ft² (14 per board)	 1 per 2.1 ft² (15 per board)
 1 per 2.0 ft² (16 per board)	 1 per 1.8 ft² (18 per board)	 1 per 1.6 ft² (20 per board)	 1 per 1.45 ft² (22 per board)	 1 per 1.3 ft² (24 per board)	 1 per 1.0 ft² (32 per board)

18 The following products are interchangeable within the scope of this Evaluation Report:

ACCEPTABLE ALTERNATES				
SUB-CATEGORY	MANUFACTURER	FBC FILE	LISTED PRODUCT HEREIN	ALTERNATE
Roofing Insulation	GAF	FL16311	EnergyGuard Polyiso Insulation	EnergyGuard NH Polyiso Insulation
			EnergyGuard Ultra Polyiso Insulation	EnergyGuard NH Ultra Polyiso Insulation
	Georgia-Pacific Gypsum, LLC	FL1250	DensDeck Prime	DensDeck StormX Prime Roof Board
Vapor Barrier	GAF	N/A	GAF SA Vapor Retarder XL	GAF SA Vapor Retarder XL40

19 “MDP” = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads. ([Note 9](#) and [Note 10](#))

TABLE 1A: WOOD DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:								
W-1.	Min. 15/32-inch plywood; 2 ft span	(Optional) Min. 1-inch EnergyGuard Polyiso Insulation, EnergyGuard Ultra	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-45.0*
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:								
W-2.	Min. 15/32-inch plywood; 2 ft span	(Optional) Min. 1-inch EnergyGuard Polyiso Insulation, EnergyGuard Ultra	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-45.0*

TABLE 1B: WOOD DECKS - NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Fasten (Note 2 , Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:									
W-3.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span	Min 2-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 2.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-52.5
W-4.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.6 ft²	Min. 0.25-inch DensDeck Prime	LRF-M, LRF-XF or OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-60.0
W-5.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 1-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.3 ft²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-82.5
W-6.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 3-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.0 ft²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500, 6-inch o.c.	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-135.0
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:									
W-7.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span	Min 2-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 2.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-52.5
W-8.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.6 ft²	Min. 0.25-inch DensDeck Prime	LRF-M, LRF-XF or OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-60.0
W-9.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 1-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.3 ft²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-82.5
W-10.	Min. 19/32-inch plywood or 1-inch wood plank; 2 ft span; blocked 4 ft o.c.	Min. 3-inch EnergyGuard Polyiso Insulation	Note 2 (#14 Fastener only)	1 per 1.0 ft²	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500, 6-inch o.c.	GAF Surface Seal SB Thermoplastic Rubber Coating		-135.0

TABLE 1C: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation and/or Thermal Barrier Layer(s) (Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasteners (Note 2 , Note 11)	Attach (Note 17)	Joint Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:								
W-11.	Min. 19/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck	Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate	1 per 1.3 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-60.0
W-12.	Min. 15/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate	1 per 1.3 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-67.5
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:								
W-13.	Min. 15/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate	1 per 1.3 ft²	GAF Surface Seal SB Thermoplastic Rubber Coating		-67.5

TABLE 1D: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation and/or Thermal Barrier Layer(s) (Note 13)	Top Insulation Layer			Roof Cover (Note 15)			MDP (psf)
			Type	Fasteners (Note 2, Note 11)	Attach (Note 17)	Base Ply	Base Ply Treatment	LARS	
W-14.	Min. 15/32-inch plywood; 2 ft span	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Drill-Tec #12 or #14 Fastener with Drill-Tec 3" Standard Steel Plate	1 per 1.3 ft ²	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-67.5

TABLE 1E: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-2: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Slip Sheet	Base Sheet			Roof Cover (Note 15)	MDP (psf)
			Base	Fasteners (Note 11)	Spacing		
W-15.	Min. 19/32-inch plywood; 2 ft span	(Optional) VersaShield Solo Fire-Resistant Slip Sheet	GA/GLAS Stratavent Nailable Venting Base	Min. 12 ga. annular ring shank nails and 1-5/8" diameter tin caps	7-inch o.c. at 4-inch wide laps and 7-inch o.c. at two (2) equally spaced, staggered center rows	GAF Premium Acrylic HydroStop System	-45.0

TABLE 2A: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation			Top Insulation		Roof Cover (Note 15)			MDP (psf)
		Type	Fasten (Note 2, Note 11)	Attach (Note 17)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
S-1	Min. 22 ga., type B, Grade 33 steel or structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 3.2 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-37.5*
S-2	Min. 22 ga., type B, Grade 33 steel or structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 2.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-3	Min. 22 ga., type B, Grade 33 steel or structural concrete	Min. 2-inch EnergyGuard Polyiso Insulation	Note 2	1 per 4.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, LRF-XF or OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer (Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasten (Note 2, Note 11)	Attach (Note 17)	Joint Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:								
S-4	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 2.0 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-5	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-6	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2 <i>(no Drill-Tec 3" Steel Plate)</i>	1 per 1.45 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-67.5
S-7	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 1.45 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-75.0
S-8	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2 <i>(no Drill-Tec 3" Steel Plate)</i>	1 per 1.45 ft²	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-75.0
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:								
S-9	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft²	GAF Surface Seal SB Thermoplastic Rubber Coating		-45.0*

TABLE 2b: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer (Note 13)	Top Insulation Layer			Roof Cover (Note 15)		MDP (psf)
			Type	Fasten (Note 2, Note 11)	Attach (Note 17)	Joint Treatment	LARS	
S-10	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2 (no Drill-Tec 3" Steel Plate)	1 per 1.45 ft ²	GAF Surface Seal SB Thermoplastic Rubber Coating		-67.5
S-11	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2 (no Drill-Tec 3" Steel Plate)	1 per 1.45 ft ²	GAF Surface Seal SB Thermoplastic Rubber Coating		-75.0

TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer (Note 13)	Top Insulation Layer			Roof Cover (Note 15)			MDP (psf)
			Type	Fasten (Note 2, Note 11)	Attach (Note 17)	Base Ply	Base Ply Treatment	LARS	
S-12	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 2.0 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-13	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 2-inch EnergyGuard Polyiso Insulation	Note 2	1 per 2.9 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-14	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.0 ft ²	SBS-CA1, SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0*
S-15	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-52.5
S-16	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	Note 2 (no Drill-Tec 3" Steel Plate)	1 per 1.45 ft ²	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-67.5
S-17	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 1.5-inch EnergyGuard Polyiso Insulation	Note 2	1 per 1.45 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-67.5
S-18	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 2-inch EnergyGuard Polyiso Insulation	Note 2	1 per 1.8 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-67.5
S-19	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.3 ft ²	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-67.5

TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Base Insulation Layer (Note 13)	Top Insulation Layer			Roof Cover (Note 15)			MDP (psf)
			Type	Fasten (Note 2 , Note 11)	Attach (Note 17)	Base Ply	Base Ply Treatment	LARS	
S-20	Min. 22 ga., type B, Grade 33 steel or structural concrete	One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2 (<i>no Drill-Tec 3" Steel Plate</i>)	1 per 1.45 ft ²	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-75.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint/Lap Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:								
C-1	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-135.0
C-2	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-3	Structural concrete	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	(Optional) Additional layer(s) base insulation	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-4	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-247.5
C-5	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-270.0
C-6	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-335.0
C-7	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, 6-inch o.c.	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-510.0
C-8	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-9	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	(Optional) Additional layer(s) base insulation	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-10	Structural concrete	(Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-247.5
C-11	Structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	None	N/A	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-375.0
C-12	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-13	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-14	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-247.5

**TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM**

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint/Lap Treatment	LARS	
C-15	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-270.0
C-16	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-335.0
C-17	Structural concrete	Min. 1.5-inch EnergyGuard RA Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-390.0
C-18	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF, 6-inch o.c.	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-510.0
C-19	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-20	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	(Optional) Additional layer(s) base insulation	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-21	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-22	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-247.5
C-23	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-270.0
C-24	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-335.0
C-25	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500, 6-inch o.c.	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-510.0
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:								
C-26	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
C-27	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-247.5
C-28	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-270.0

**TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM**

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint/Lap Treatment	LARS	
C-29	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-335.0
C-30	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-M, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M, 6-inch o.c.	GAF Surface Seal SB Thermoplastic Rubber Coating		-510.0
C-31	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
C-32	Structural concrete	(Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Surface Seal SB Thermoplastic Rubber Coating		-247.5
C-33	Structural concrete	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	None	N/A	GAF Surface Seal SB Thermoplastic Rubber Coating		-375.0
C-34	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
C-35	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-247.5
C-36	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-270.0
C-37	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-335.0
C-38	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF, 6-inch o.c.	GAF Surface Seal SB Thermoplastic Rubber Coating		-510.0
C-39	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
C-40	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-222.5
C-41	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-247.5
C-42	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-270.0

TABLE 3A: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint/Lap Treatment	LARS	
C-43	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-335.0
C-44	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500, 6-inch o.c.	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500, 6-inch o.c.	GAF Surface Seal SB Thermoplastic Rubber Coating		-510.0

TABLE 3B: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
C-45	Structural concrete	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	(Optional) Additional layer(s) base insulation	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
C-46	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
C-47	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
C-48	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-49	Structural concrete	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-335.0
C-50	Structural concrete	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0

TABLE 3B: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
C-51	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
C-52	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
C-53	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0
C-54	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-55	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-335.0
C-56	Structural concrete	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	(Optional) Additional layer(s) base insulation	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
C-57	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
C-58	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
C-59	Structural concrete	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0

TABLE 3B: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

REFER TO [NOTE 16](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
C-60	Structural concrete	Min. 1-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-222.5
C-61	Structural concrete	Min. 1.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-335.0

TABLE 3C: CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F: NON-INSULATED, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Primer	Roof Cover (Note 15)		MDP (psf)
			Base Ply	LARS	
C-62	Structural concrete	GAF Multi-Purpose Primer	None	GAF Bleed-Block Asphalt Primer System followed by GAF High Solids Silicone Coating	-277.5
C-63	Structural concrete	GAF Multi-Purpose Primer	None	GAF Premium Acrylic HydroStop Base Coat System followed by GAF High Solids Silicone Coating	-487.5
C-64	Structural concrete	GAF Bonding Primer or GAF Multi-Purpose Primer	None	GAF Premium Acrylic HydroStop System	-502.5
C-65	Structural concrete	GAF BarrierGuard Surface Coating followed by GAF SureBond Primer	None	GAF Premium Acrylic HydroStop System	-610.0
C-66	Structural concrete	(Optional) GAF Bonding Primer or GAF Multi-Purpose Primer	None	GAF Surface Seal SB Thermoplastic Rubber Coating	-1237.5

TABLE 4A: LIGHTWEIGHT CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-2: NON-INSULATED, MECHANICALLY ATTACHED BASE SHEET, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Sheet			Roof Cover (Note 15)		MDP (psf)
			Type	Fasten (Note 11)	Spacing	Base Ply Treatment	LARS	
LWC-1.	Min. 22 ga. type B, Grade 33 vented steel or structural concrete	Pre-existent cellular lightweight concrete, min. 300 psi, min. 2-inch thick. <i>Note: To qualify the LWIC under this assembly, a Drill-Tec Base Sheet Fastener (1.7) or Drill-Tec Base Sheet Fastener E (1.7) shall achieve an average withdrawal of 60 lbf when tested per Note 11.</i>	GAFGLAS Stratavent Nailable Venting Base	Drill-Tec Base Sheet Fastener (1.7) or Drill-Tec Base Sheet Fastener E (1.7)	7-inch o.c. at 4-inch wide laps and 7-inch o.c. at two (2) equally spaced, staggered center rows	(Optional) GAF Premium Acrylic HydroStop Base Sheet Lap Treatment	GAF Premium Acrylic HydroStop System	-45.0

TABLE 4B: LIGHTWEIGHT CONCRETE DECKS – NEW CONSTRUCTION
SYSTEM TYPE F: NON-INSULATED, LIQUID APPLIED ROOF SYSTEM

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Primer (Note 15)	LARS (Note 15)	MDP (psf)
LWC-2.	Min. 22 ga. type B, Grade 33 vented steel	Mearlcrete (FL13492), min. 300 psi, min. 2-inch thick	GAF BarrierGuard Surface Coating followed by GAF SureBond Primer	GAF Premium Acrylic HydroStop System	-52.5
LWC-3.	Structural concrete	Cellular lightweight concrete, min. 210 psi, min. 2-inch thick. <i>Note: To qualify the LWIC under this assembly, a Drill-Tec Base Sheet Fastener (1.7) or Drill-Tec Base Sheet Fastener E (1.7) shall achieve an average withdrawal of 89 lbf when tested per Note 11</i>	GAF BarrierGuard Surface Coating followed by GAF SureBond Primer	GAF Premium Acrylic HydroStop System	-502.5

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
GAF PREMIUM ACRYLIC HYDROSTOP SYSTEM:								
R-1	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-75.0
R-2	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-135.0
R-3	Existing smooth-surface BUR	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	(Optional) Additional layer(s) base insulation	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-157.5
R-4	Existing smooth-surface BUR	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-157.5
R-5	Existing granule-surface BUR or smooth- or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-6	Existing granule-surface BUR or smooth- or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	(Optional) Additional layer(s) base insulation	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-7	Existing granule-surface BUR or smooth- or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-225.0
R-8	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
R-9	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	(Optional) Additional layer(s) base insulation	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-10	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-247.5
R-11	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	None	N/A	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-375.0
R-12	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-75.0
R-13	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck or DensDeck Prime	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-135.0
R-14	Existing granule-surface BUR or granule-surface modified bitumen	Min. 1.5-inch EnergyGuard RA Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-160.0
R-15	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-16	Existing granule-surface BUR or granule-surface modified bitumen	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-17	Existing granule-surface BUR or granule-surface modified bitumen	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-18	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.25-inch DensDeck Prime	LRF-XF	None	N/A	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-257.5

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
R-19	Existing smooth-surface asphaltic roof cover or granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-75.0
R-20	Existing smooth-surface asphaltic roof cover	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck or DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-120.0
R-21	Existing smooth-surface asphaltic roof cover	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	(Optional) Additional layer(s) base insulation	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-120.0
R-22	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-23	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	(Optional) Additional layer(s) base insulation	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-24	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Premium Acrylic HydroStop Insulation Joint Treatment	GAF Premium Acrylic HydroStop System	-225.0
GAF SURFACE SEAL SB THERMOPLASTIC RUBBER COATING:								
R-25	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-75.0
R-26	Existing smooth-surface BUR	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-157.5

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
R-27	Existing granule-surface BUR or smooth- or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
R-28	Existing granule-surface BUR or smooth- or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	GAF Surface Seal SB Thermoplastic Rubber Coating		-225.0
R-29	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
R-30	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	GAF Surface Seal SB Thermoplastic Rubber Coating		-247.5
R-31	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	None	N/A	GAF Surface Seal SB Thermoplastic Rubber Coating		-375.0
R-32	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-75.0
R-33	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-135.0

TABLE 5A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)		MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Joint Treatment	LARS	
R-34	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
R-35	Existing granule-surface BUR or granule-surface modified bitumen	Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime	LRF-XF	GAF Surface Seal SB Thermoplastic Rubber Coating		-222.5
R-36	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.25-inch DensDeck Prime	LRF-XF	None	N/A	GAF Surface Seal SB Thermoplastic Rubber Coating		-257.5
R-37	Existing smooth-surface asphaltic roof cover or granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-75.0
R-38	Existing smooth-surface asphaltic roof cover	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-120.0
R-39	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-180.0
R-40	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	GAF Surface Seal SB Thermoplastic Rubber Coating		-225.0

TABLE 5B: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
R-41	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	(Optional) Additional layer(s) base insulation	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
R-42	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
R-43	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
R-44	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-45	Existing smooth- or granule-surface BUR or smooth- or granule-surface modified bitumen	(Optional) Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-M	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-225.0
R-46	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	(Optional) Additional layer(s) base insulation	LRF-M Canister	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
R-47	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime	LRF-M Canister	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5

TABLE 5B: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
R-48	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
R-49	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-50	New or existing smooth- or granule-surface asphalt BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-M Canister	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-M Canister	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-225.0
R-51	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	LRF-XF	(Optional) Additional layer(s) base insulation	LRF-XF	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
R-52	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-CA1, SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
R-53	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
R-54	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0

TABLE 5B: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED BASE PLY, LIQUID APPLIED ROOF SYSTEM

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf) ^A
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Base Ply Treatment	LARS	
R-55	Existing granule-surface BUR or granule-surface modified bitumen	(Optional) Min. 1-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-222.5
R-56	Existing granule-surface BUR or granule-surface modified bitumen	Min. 1.5-inch EnergyGuard Polyiso Insulation	LRF-XF	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	LRF-XF	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-257.5
R-57	Existing smooth-surface asphaltic roof cover or granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	(Optional) Additional layer(s) base insulation	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-60.0
R-58	Existing smooth-surface asphaltic roof cover	(Optional) One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-120.0
R-59	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-127.5
R-60	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-CA1	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-172.5
R-61	Existing granule-surface BUR or granule-surface modified bitumen	One or more layer(s), min. 0.5-inch EnergyGuard Polyiso Insulation, EnergyGuard RA or EnergyGuard Ultra Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-180.0
R-62	Existing granule-surface BUR or granule-surface modified bitumen	Min. 0.5-inch EnergyGuard Polyiso Insulation	OB500	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	OB500	SBS-TA	(Optional) GAF Premium Acrylic HydroStop Lap Treatment	GAF Premium Acrylic HydroStop System	-225.0

TABLE 5c: RECOVER APPLICATIONS
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new roof cover when adhered to the substrate, irrespective of the deck type (See Note 1) or performance of the substrate (See Note 12).
The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Primer	Roof Cover (Note 15)	MDP (psf)
R-63	Existing EPDM single ply	GAF Cleaning Concentrate	GAF Premium Acrylic HydroStop System	-45.0
R-64	Existing smooth- or granule-surface BUR or SBS modified bitumen or granule-surface APP modified bitumen	(Optional) GAF BarrierGuard Surface Coating at 0.5 gal/square.	GAF Premium Acrylic HydroStop System	-45.0
R-65	Existing spray polyurethane roof (SPUF)	None	GAF Premium Acrylic HydroStop System	-237.5