

SWARTZ
CONSULTING ENGINEERS LLC

Project Number:	SCE 25-12002
Project Name:	Custom Epic Clad OSW French 2 Panel Door
Date:	12/19/2025
Page:	1 of 9

Product Evaluation Report

Project Number: SCE 25-12002

Product Name: Custom Epic Clad OSW French 2 Panel Door

Product Dimensions: 69.813" x 83.438"

Design Pressure: +50 psf/-50 psf

Impact: WindZone 3 - Level D Missile

Installation Instructions: SCE 2512002


Method: 1-D (Engineering Evaluation)

Category: Exterior Doors

Subcategory: Swinging Exterior Door Assembly

Prepared for:

Jeld-Wen Windows & Doors
3737 Lakeport Blvd.
Klamath Falls, OR

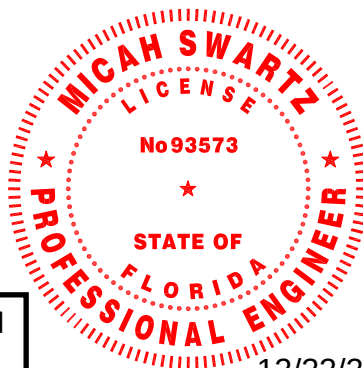



This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

12/22/25

Prepared by:
Swartz Consulting Engineers LLC

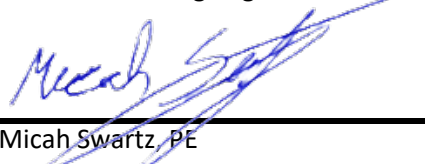
Micah Swartz, PE
Florida License No. PE 93573
Florida Registry No. 38420



Scope:

This is a product evaluation report issued by Micah Swartz, P.E. (FL# 93573) for Jeld-Wen Windows & Doors based on Method 1D of the State of Florida Product Approval, Florida Department of Business and Professional Regulation - Florida Building Commission.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions SCE 2512002, signed and sealed by Micah Swartz, P.E. (FL# 93573) for specific use paramaters including size and design pressure limitations.


Certification of Independence:

In accordance with Rule 61G20-3 Florida Administrative Code, Swartz Consulting Engineers LLC hereby certifies the following:

- (1) Swartz Consulting Engineers LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the agency.
- (2) Swartz Consulting Engineers LLC is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels.
- (3) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which the reports are being issued.
- (4) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Limits of Use:

- (1) Product anchors shall be as listed and spaced on installation instructions. Anchors shall be embedded into the substrate the full embedment depth beyond stucco or wall cladding.
- (2) Site conditions that deviate from the details of drawing SCE 2512002 must be verified and designed by a licensed engineer or registered architect.




Testing Summary:

The table below summarizes the product: Custom Epic Clad OSW French 2 Panel Door 69.813" x 83.438" and their corresponding performance levels as established by testing. Testing was observed by National Certified Testing Laboratories in Klamath Falls, OR.

Table 1: Summary of Test Results

Series/Model	Test Report Number	Standards Tested	Size (W x H)	Performance
Custom Epic Clad OSW French 2 Panel Door 69.813" x 83.438"	SJW2012-155 (12/04/2012)	AAMA/WDMA/CSA 101/I.S.2/A440-22 ASTM E283-19 ASTM E330 -14(2021) ASTM E547-00(2016) AAMA 1304-18 ASTM 1886-19/1996-20	177.188" x 122"	+50 psf/-50 psf
OSW French Door with Side lites & ADA Sill	SJW2015-058 (07/23/15)	AAMA/WDMA/CSA 101/I.S.2/A440-22 ASTM E330 -14(2021)	148.82" x 98.23"	+35 psf/-35 psf



Design Summary:

As Tested Design:

Applied Load (psf): 35 psf Width: 71.68 in Height: 98.23 in

Bending Moment on Tested Astragal: 876 #-ft

Applied Load (psf): 50 psf Width: 69.8 in Height: 83.4 in

Bending Moment on Astragal: 878 #-ft

Note: size of the unit is limited to maintain stress on astragal.

Screw Information:

Screw Size: 12 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)

Wood Screw Lateral: 212 lbs Spacing: 15.5 in Linear Capacity: 164 lbs *Contro

Alternative Fasteners:

Screw Information:

Screw Size: 10 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)


Wood Screw Lateral: 149 lbs Spacing: 10 in Linear Capacity: 178 lbs

Tapcon Information:

Tapcon Size: 1/4 Embedment: 1-1/4 in (minimum) Edge Distance: 2-1/2 in (minimum)

Tapcon Lateral (Concrete): 203 lbs

Tapcon Lateral (CMU): 161 lbs Spacing: 10 in Linear Capacity: 193 lbs



Subject: As Tested - Wood Screw Lateral Design - Single Shear

Input:
Calculation:

Screw Information:

Screw Size:
Screw Embed: in

Root Diameter: in

Main Member Type: G: F_{em} : psi thickness (t_m): in

Side Member Type: G: F_{es} : psi thickness (t_s): in

Lateral Design Factors - Table 12.3.1A (NDS 2018)

D:	0.171 in	Diameter
F_{yb} :	90 ksi	Dowel Bending Yield Strength
F_{em} :	3,350 psi	Main Member dowel bearing strength
F_{es} :	3,350 psi	Side Member dowel bearing strength
l_m :	1.5 in	Main Member dowel bearing length
l_s :	1.25 in	Side Member dowel bearing length
R_d :	2.21	Reduction term - Table 12.3.1B (NDS 2018)
R_e :	1	$= F_{em}/F_{es}$
R_t :	1.2	$= l_m/l_s$
k_1 :	0.459	See Table
k_2 :	1.168	See Table

Reference Lateral Design Values - Table 12.3.1A (NDS 2018)

Z_{Im} : lbs $Z_{Im} = \frac{D l_m F_{em}}{R_d}$ (EQ 12.3 - 1)


Z_{II} : lbs $Z_{II} = \frac{k_1 D l_s F_{es}}{R_d}$ (EQ 12.3 - 3)

Z_{III} : lbs $Z_{III} = \frac{k_2 D l_m F_{em}}{(1 + 2R_e) R_d}$ (EQ 12.3 - 4)

Z_{IV} : lbs $Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2F_{em}F_{yb}}{3(1 + R_e)}}$ (EQ 12.3 - 6)

Z_{MIN} : lbs

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{IIIs} are not applicable to the calculation.



Subject: As Tested - Wood Screw Lateral Design - Single Shear Cont.

Adjusted Lateral Design Values

$$Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta} - \text{As per table 11.3.1 NDS 2018}$$

C_D :	1.6	Load Duration Factor - Table 2.3.2 (NDS 2018)
C_M :	1.0	Wet Service Factor - Table 11.3.3 (NDS 2018)
C_t :	1.0	Temperature Factor - Table 11.3.4 (NDS 2018)
C_g :	1.0	Group Action Factor - Section 11.3.6 (NDS 2018)
C_{Δ} :	1.0	Geometry Factor - Section 12.5.1.1 (NDS 2018)

$$Z': \boxed{212} \text{ lbs}$$

Fastener Bending Across Shim Space

Ω :	1.67	
L:	0.25	in Maximum Shim Gap
D:	0.171	in Diameter
F_{yb} :	90	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

$$\text{Where } M = \frac{ZL}{2} \text{ (Guided Bending)}$$


$$Z_n/\Omega: \boxed{212} \text{ lbs}$$

Bearing on Masonry Strap

Ω :	3.00	
F_u :	33	ksi Tensile Strength of strap
t:	20	GA
t:	0.036	in thickness of strap
D:	0.171	in

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ. J4.3.1 - 4, AISI S100)$$

$$P_{nv}/\Omega: \boxed{182} \text{ lbs}$$



Subject: Wood Screw Lateral Design - Single Shear

Input:
Calculation:

Screw Information:

Screw Size:
Screw Embed: in

Root Diameter: in

Main Member Type: G: F_{em} : psi thickness (t_m): in

Side Member Type: G: F_{es} : psi thickness (t_s): in

Lateral Design Factors - Table 12.3.1A (NDS 2018)

D:	0.152 in	Diameter
F_{yb} :	90 ksi	Dowel Bending Yield Strength
F_{em} :	3,350 psi	Main Member dowel bearing strength
F_{es} :	3,350 psi	Side Member dowel bearing strength
l_m :	1.5 in	Main Member dowel bearing length
l_s :	1.25 in	Side Member dowel bearing length
R_d :	2.2	Reduction term - Table 12.3.1B (NDS 2018)
R_e :	1	$= F_{em}/F_{es}$
R_t :	1.2	$= l_m/l_s$
k_1 :	0.459	See Table
k_2 :	1.133	See Table

Reference Lateral Design Values - Table 12.3.1A (NDS 2018)

Z_{Im} : lbs $Z_{Im} = \frac{Dl_mF_{em}}{R_d}$ (EQ 12.3 - 1)


Z_{II} : lbs $Z_{II} = \frac{k_1Dl_sF_{es}}{R_d}$ (EQ 12.3 - 3)

Z_{III} : lbs $Z_{III} = \frac{k_2Dl_mF_{em}}{(1 + 2R_e)R_d}$ (EQ 12.3 - 4)

Z_{IV} : lbs $Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2F_{em}F_{yb}}{3(1 + R_e)}}$ (EQ 12.3 - 6)

Z_{MIN} : lbs

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{IIIs} are not applicable to the calculation.



Subject: Wood Screw Lateral Design - Single Shear Cont.

Adjusted Lateral Design Values

$Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta}$ — As per table 11.3.1 NDS 2018

C_D :	1.6	Load Duration Factor - Table 2.3.2 (NDS 2018)
C_M :	1.0	Wet Service Factor - Table 11.3.3 (NDS 2018)
C_t :	1.0	Temperature Factor - Table 11.3.4 (NDS 2018)
C_g :	1.0	Group Action Factor - Section 11.3.6 (NDS 2018)
C_{Δ} :	1.0	Geometry Factor - Section 12.5.1.1 (NDS 2018)

Z' : 168 lbs

Fastener Bending Across Shim Space

Ω :	1.67	
L :	0.25	in Maximum Shim Gap
D :	0.152	in Diameter
F_{yb} :	90	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{ZL}{2}$ (Guided Bending)


Z_n/Ω : 149 lbs

Bearing on Masonry Strap

Ω :	3.00	
F_u :	33	ksi Tensile Strength of strap
t :	20	GA
t :	0.036	in thickness of strap
D :	0.152	in

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ. J4.3.1 - 4, AISI S100)$$

P_{nv}/Ω : 162 lbs



Subject: Tapcon Lateral Design

Input:
Calculation:

Tapcon Size:

Size:
D: in Nominal Diameter
D_{sh}: in Shank Diameter

Fastener Shear Capacity - 3,000 psi Concrete

P_{nv}/Ω: lbs See Table 1B of NOA 24-0102.06

Fastener Shear Capacity - Medium-Weight CMU

P_{nv}/Ω: lbs See Table 3 of NOA 24-0102.06

Note:

- Critical anchor spacing is 16D
- Minimum Anchor Embedment is 1-1/4"
- Minimum Edge Distance is 2-1/4"

Fastener Bending Across Shim Space

L: in Maximum Shim Gap
D_{sh}: in Shank Diameter of Tapcon
F_{yb}: ksi Yield Strength of Tapcon

Ω:

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16P_n L}{\pi D^3} \Leftrightarrow P_n = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{P_n L}{2}$ (Guided Bending)

P_n/Ω: lbs

Bearing Strength of Masonry Straps - AISI S100

Size: Tapcon Size
D_{sh}: in Shank Diameter of Tapcon Screw
F_u: ksi Tensile Strength of Masonry Strap
t: GA
t: in Thickness of Masonry Strap

Ω:

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ. J4.3.1 - 3, AISI S100)$$

P_{nv}/Ω: lbs