



# BUILDING DROPS

A Perfect Solution in Every Drop

Certificate of Authorization: 29578

398 East Dania Beach Blvd.  
Suite 338  
Dania Beach, FL 33004  
954.399.8478 PH  
954.744.4738 FX  
contact@buildingdrops.com

## Product Evaluation Report

*of*

**Continental Glass Systems, LLC.  
Series 3000 Fixed Window Wall - SMI**

*for*

**Florida Product Approval**

**FL# FL21413**

**Report No. 4588**

**5<sup>th</sup> Edition Florida Building Code**


**Method:** 1 – A (Certificate Method)  
**Category:** Windows  
**Sub – Category:** Fixed

**Product:** *Series 3000 Fixed Window Wall SMI*  
**Material:** *Aluminum 6005-T5*  
**Product Dimensions:** *50" x 119.5" Max. Panel (Unlimited Multiple Unit Width)*

**Prepared For:**  
**Continental Glass Systems, LLC.**  
**325 W. 74<sup>th</sup> Place**  
**Hialeah, FL 33014**

**Prepared by:**  
**Hermes F. Norero, P.E.**  
Florida Professional Engineer # 73778  
Date: 11/01/2016

Contents:  
Evaluation Report      Pages 1 – 4

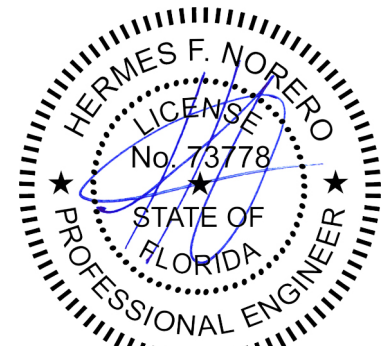

Hermes F. Norero, P.E.  
Florida No. 73778



# BUILDING DROPS

A Perfect Solution in Every Drop  
Certificate of Authorization: 29578

FL#: FL21413  
Date: 11/01/2016  
Report No: 4588

---

**Manufacturer:** Continental Glass Systems, LLC.

**Product Category:** Windows

**Product Sub-Category:** Fixed

**Compliance Method:** State Product Approval Method 1a

**Product Name:** Series 3000 Fixed Window Wall SMI  
50" x 119.5" Max. Panel (Unlimited Multiple Unit Width)

**Scope:** This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Continental Glass Systems, LLC.** based on Method 1a of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the Florida Building Code.

See Installation Instructions **FXD-3000-SM**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

## Limits of Use:

1. This product has been evaluated and is in compliance with the Florida Building Code, including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the Florida Building Code and does not require an impact resistant covering in areas requiring Small Missile Impact Resistance.
4. Site conditions that deviate from the details of drawing **FXD-3000-SM**, require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **FXD-3000-SM**, for size and design pressure limitations.



# BUILDING DROPS

**A Perfect Solution in Every Drop**

Certificate of Authorization: 29578

**FL#: FL21413**

Date: 11/01/2016

Report No: 4588

---

**Certification Agency:** The manufacturer has demonstrated compliance of window products in accordance with the Florida Building Code and State Rules for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation & Management Institute** (FBC Organization #: CER 1773).

**Performance Standards:** The product described herein has been tested per:

- TAS 201-94
- TAS 202-94
- TAS 203-94

**Referenced Data:**

1. Product Testing performed by **Fenestration Testing Laboratory, Inc.**  
(FBC Organization #: TST 1657)  
Report #: FTL-4728, Report Date: 10/07/05  
Signed and Sealed by Edmundo Largaespada, FL PE No. 56915
2. Product Testing performed by **Blackwater Testing Inc.**  
(FBC Organization #: TST 10394)  
Report #: BT-CON-16-007, Report Date: 11/18/16  
Signed and Sealed by Constantin Bortes, FL PE No. 77915
3. Material Certification  
**Miami-Dade RER – Product Control Section NOA**  
Eastman Chemical Co. – Saflex PVB Interlayer



# BUILDING DROPS

A Perfect Solution in Every Drop  
Certificate of Authorization: 29578

FL#: FL21413  
Date: 11/01/2016  
Report No: 4588

**Installation:** 1. Approved anchor types and substrates are as follows:

**Through Frame Installation:**

- A. For concrete substrate (min. 3515 psi compressive strength) use **5/16" diameter Elco Ultracon** type concrete screw anchors of sufficient length to achieve minimum embedment of 1.75" into concrete.

Refer to Installation Instructions (**FXD-3000-SM**) for anchor spacing and more details of the installation requirements.

**Design Pressure:**

DESIGN LOAD CAPACITY (P.S.F.)		MULLION REINFORCING CHANNELS	MAXIMUM D.L.O. WIDTH	MAXIMUM WINDOW WIDTH
POSITIVE	NEGATIVE			
110	110	NO	43 1/2"	46"
140	140	YES	47 1/2"	50"
100	100	NO	47 1/2"	50"