

Manufacturer: Nan Ya Plastics Corporation USA
4016 Shadrack St.
Houston, TX 77013

Product Line: Series "SLPS" Outswing Glazed Fiberglass Side-Hinged Patio Door - Impact

Compliance:


The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number 08-03124 Revision B, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Test report No.: NCTL-210-4059-01 signed and sealed by Mark Bennett.
National Certified Testing Laboratories, Orlando, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
CSA A440 S1
ASTM E1886/ E1996 Large Missile Impact, Level D, Wind Zone 4
Cyclic Load Test, ± 50.0 psf design pressure
3. Report No.: NCTL-210-4103-07 signed by Mark Bennett (for miniblind glass)
National Certified Testing Laboratories, Orlando, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
ASTM E1886/ E1996 Large Missile Impact, Level D, Wind Zone 4
Cyclic Load Test, ± 50.0 psf design pressure
4. Test report No.: NCTL-210-4112-04 signed and sealed by Douglas J. McDougall P.E. (for miniblind glass)
National Certified Testing Laboratories, Orlando, FL.
TAS 201/ TAS 203
Large Missile Impact Test, Level D, Wind Zone 4
Cyclic Pressure loading ± 50.0 design pressure
TAS 202
Uniform Static Air Pressure, ± 37.5 design pressure, 6.0psf water penetration (no sill riser)
 ± 50.0 design pressure, 7.5psf water penetration (no sill riser)
 ± 70.0 design pressure, 10.5psf water penetration (no sill riser)
5. Anchor calculations, report number 514033-1, prepared, signed and sealed by Luis Roberto Lomas P.E.

Limitations and Conditions of use:

- Design pressure: ± 50.0 psf
- Panel size: 35 $\frac{3}{4}$ " x 79 $\frac{1}{4}$ "
- Approved configurations: OXX/O, O/OXX, XXO/O, O/XXO, XX/O, O/XX, OX/O, O/OX, XO/O, O/XO, X/O, O/X, XX, X
- Units must be glazed per ASTM E1300 see installation instructions for glass details.
- This product is not rated to be used in the HVHZ.
- This product is impact resistant and does not require impact protection in wind borne debris regions.
- Frame material to be rigid Foam PVC CO-EX.

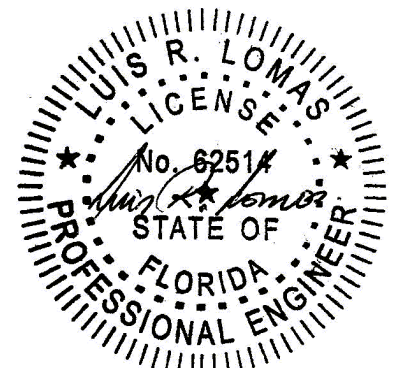

L. Roberto Lomas P.E.

208 7th Ave.

Indialantic, FL 32903

434-688-0609

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 514033C

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document 08-03124, Revision B.

When the product herein is installed within 3000 ft. of saltwater coastline, all anchors and clips must comply with saltwater environment corrosion resistance requirements of FBC Chapter 17.

Certification of Independence:

Please note that I do not have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I do not have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

