

WALTER A. TILLIT, JR., P.E.

tilteco@aol.com
FL P.E. License No. 44167
FL C.A. License No. 0006719

PRODUCT EVALUATION REPORT

REPORT NO.: 20.0707.07

DATE: July 07, 2020

PRODUCT CATEGORY: Exteriors Doors

PRODUCT SUB-CATEGORY: Swinging Exterior Door Assemblies

PRODUCT NAME: DOUBLE & SINGLE SERIES 8080 AND 4080
OUTSWING COMMERCIAL GALVANNEAL
AND STAINLESS-STEEL DOOR FLUSH OR
EMBOSSSED.

SUBMITTED BY: Daybar Industries LTD
50 West Drive, Brampton,
On Canada, L6T 2J4

1. PURPOSE OF EVALUATION:

This is a Product Evaluation Report issued by **Walter A. Tillit, Jr., P.E.** (System ID # 1906) to **Daybar Industries LTD.** based on Rule Chapter No. **61G20-3, Method 1d** of the Florida Department of Business and Professional Regulation.

This product is being issued an Evaluation Report as described herein, and has been verified for compliance in accordance with the 2020 Seventh Edition of the Florida Building Code, and to verify that the product is for the purpose intended at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision in case of a Building Code Change that may affect its limitations and conditions.

2. EVIDENCE SUBMITTED:

2.1. PRODUCT EVALUATION DOCUMENT (P.E.D.):

Drawing No 20-156, titled "**DOUBLE & SINGLE SERIES 8080 and 4080 OUTSWING COMMERCIAL GALVANNEAL AND STAINLESS STEEL DOOR FLUSH OR EMBOSSSED**", sheets 1 thru 10, prepared by Tilteco, Inc., signed and sealed by Walter A. Tillit, Jr., P.E.; dated **06/30/2020**. This drawing is an integral part of this Evaluation Report.



2.2. TEST REPORTS:

Large missile impact and cyclic loading under Florida TAS 201 and 203 Protocols, as per section 1626 of the Florida Building Code. Uniform Static loads in accordance with and Protocol TAS 202. Test reports prepared by Certified Test Laboratories, Report No. **CTLA 2045W**, No. **CTLA 2045W-1**, No. **CTLA 2045 W-2**, No. **CTLA 2045W-3**, signed and sealed by Ramesh C. Patel, P.E. Tensile Test Report No. **4BM-144** by QMETALLURGICAL INC., dated March 2, 2004, 2011, signed and sealed by Frank Grate, P.E.

2.3. STRUCTURAL ENGINEERING CALCULATIONS:

On Exterior Door for maximum anchor spacing vs. design wind load and door span based on rational and comparative analysis, and in accordance with section **1616** of the Florida Building Code. Calculations prepared by Tilteco, Inc., dated 04/14/15, signed and sealed by Walter A. Tillit, Jr., P.E.

3. MISSILE IMPACT RESISTANCE:

Large missile impact under section 1626 of the Florida Building Code, as per Protocol TAS 201.

4. WIND LOADS RESISTANCE:


Exterior Door has been verified to sustain wind pressures. Maximum Door Dimensions and ASD Design Pressure rating shall be as indicated on sheets 2 and 3 of Product Evaluation Document (P.E.D.), drawing No. **20-156**. Maximum Anchor Spacing shall be as indicated on sheets 10 of Product Evaluation Document (P.E.D.), drawing No. **20-156**.

5. INSTALLATION:

Shall be performed strictly in accordance with the details indicated on sheets 2 and 6 thru 10 of Product Evaluation Document (P.E.D.), drawing No. **20-156**.

6. MATERIAL CHARACTERISTICS AND SPECIFICATIONS:

Shall be strictly in accordance with General Notes and Components indicated on sheets 1, 4 and 5 of Product Evaluation Document (P.E.D.), drawing No. **20-156**. Anchor specifications shall be as indicated on sheet 10 of 10 of Product Evaluation Document (P.E.D.), drawing No. **20-156**.

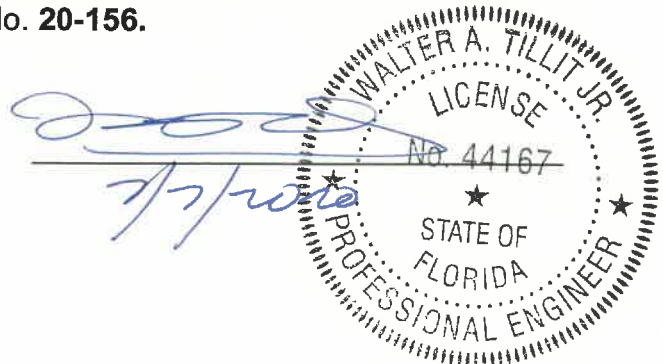


7. LIMITATIONS AND CONDITIONS OF USE:

7.1. Shall be strictly in compliance with General Notes No. 1, 3, 8, thru 12, indicated on sheet 1 of 10, of Product Evaluation Document (P.E.D.), drawing No. **20-156** prepared by Tilteco, Inc. and signed and sealed by Walter A. Tillit, Jr., P.E.

7.2. Product **may be** installed within HIGH VELOCITY HURRICANE ZONES as defined on section 1620.2 of the Florida Building Code, or outside of HIGH VELOCITY HURRICANE ZONES.

7.3. Product shall only be installed into poured concrete, grouted concrete block, wood and steel frame structures, as limited and defined on Product Evaluation Document No. **20-156**.

Product Evaluation Report prepared by Walter A. Tillit, Jr., P.E. (Florida License No. 44167), President of Tilteco, Inc. (Florida CA-0006719).

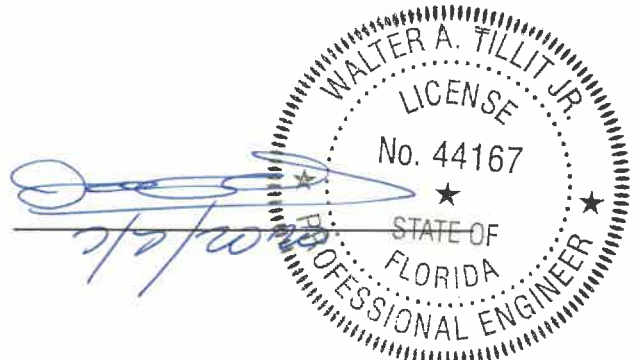

WATLL
D:\TILTECO ADMON RECORDS \ P. E. REPORT.20 \ DAYBAR INDUSTRIES LTD \ SERIES 8080 and 4080
OUTSWING COMMERCIAL GALVANNEAL AND STAINLESS-STEEL DOOR FLUSH OR EMBOSSED \ DRWG # 20-156
\ REPORT # 20-0707.07