

Manufacturer: **All American Window Company, LLC**
 1930 Hanahan Road, Suite 1400A
 North Charleston, SC 29406

Product Line: 1970 Fixed Window - Impact

Compliance:


The above mentioned product has been evaluated for compliance with the requirements of the Florida Department of Business and Professional Regulation for Statewide Acceptance per Rule 61G20-3.005 method 1(d). The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number 08-03386 Revision A, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Test report No.: NCTL 210-4135-01A signed by Mark Bennett
National Certified Testing Laboratories, Orlando, FL.
AAMA/WDMA/CSA 101/I.S.2/A440
Design Pressure: ±50.0psf
Water penetration resistance: 15.0psf
ASTM E1886/ E1996 Large Missile Impact, Level D, Wind Zone 3
 Cyclic Load Test, ±50.0psf design pressure
3. Test report No.: No. 71347.02-501-47 signed by Michael L. Mackereth
Architectural Testing, York, PA.
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ±50.16psf
Water penetration resistance: 7.50psf
4. Test Report No. A8196.01-250-44 signed by J.P. McDonald
Architectural Testing Laboratories, Chelmsford, Massachusett
ASTM E1886/ E1996 Large Missile Impact, Level D, Wind Zone 3
 Cyclic Load Test, ±50.0psf design pressure
5. Test report No.: NCTL-210-4169-01 signed by Christopher Bennet.
National Certified Testing Laboratories, Orlando, FL.
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ±40.0psf
Water penetration resistance: 8.25psf
ASTM E1886/ E1996 Large Missile Impact, Level D, Wind Zone 3
 Cyclic Load Test, ±50.0psf design pressure
6. Anchor calculations and comparative analysis, report number 514385-1A, prepared, signed and sealed by Luis Roberto Lomas P.E.

Limitations and Conditions of use:

- Design pressure: Refer to installation drawing
- Unit size: Refer to installation drawing
- Units must be glazed per ASTM E1300 according to glazing details in approval drawing.
- This product is not rated to be used in the HVHZ.
- This product is impact resistant and does not require impact protection in wind borne debris regions.

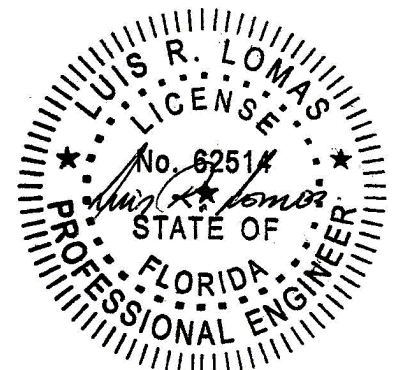

L. Roberto Lomas P.E.

1432 Woodford Rd.

Lewisville, NC 27023

434-688-0609

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 514385B

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document, 08-03386 Revision A.

Certification of Independence:

Please note that I don't have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I don't have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

