

AL-FAROOQ CORPORATION

CONSULTING ENGINEERS & PRODUCT DEVELOPMENT

PRODUCT APPROVAL EVALUATION RULE CHAPTER #61G20-3 • METHOD 1 OPTION D

FL 25948

Date: 03/31/2025

Detailed Product Description:

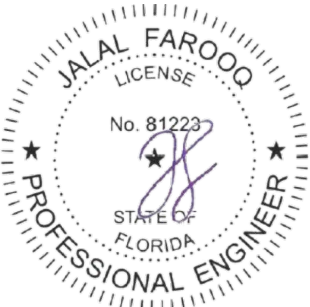
Manufacturer: ALDORA ALUMINUM & GLASS PRODUCTS, INC.

Manufacturer Address: 4250 CORAL RIDGE DRIVE, SUITE 101, CORAL SPRINGS, FL 33065

Model Name: SERIES SMI-090 ALUMINUM WINDOW WALL

Maximum Load: +60.0 PSF, -60.0 PSF (Non-Impact)

Installation Drawings # 25-37F

This product does not comply with the High Velocity Hurricane Zone (HVHZ) testing requirements.					
For maximum sizes, combination of span vs loads and anchor type refer to installation drawings.					
Comparative analysis used <u> X </u> Yes <u> </u> No					
Mandatory Tests (Tested in accordance with AAMA 501/101/I.S.2/NAFS)					
TEST	DESCRIPTION	TEST LOCATION	TEST REPORT DATE	TEST REPORT #	Test Sealed by
ASTM E283	Air Infiltration Leakage	Fenestration Testing Laboratory	08/06/2009	FTL-5964	Julio E. Gonzalez, P.E
ASTM E331 OR ASTM 547 & TAS 202	Water Penetration	Fenestration Testing Laboratory	08/06/2009	FTL-5964	Julio E. Gonzalez, P.E
ASTM E330, TAS 202	Uniform Static Air Press.	Fenestration Testing Laboratory	08/06/2009	FTL-5964	Julio E. Gonzalez, P.E
Under the limitations of the attached installation drawings, to the best of my knowledge and ability, the above product conforms to the requirements of the 2023 Florida Building Code.					
Evaluation Report Engineer:					
Jalal Farooq Al-Farooq Corporation					
PE # 81223 EB # 3538			Sealed: 3/31/2025		