

EVALUATION REPORT

Page 1 of 3

Manufacturer: **Bison Innovative Products**
701 Osage Street, Bldg 2, #120
Denver, CO 80204
T: 800-333-4234

Code: Florida Building Code - Building, 8th Edition (2023), Non-High Velocity Hurricane Zone

Product Category: Structural Components/Products Introduced as a Result of New Technology

Compliance Method: Rule 61G20-3 Method 1(d), Evaluation Report from a licensed Florida Professional Engineer.

Product Name: **Bison Mid-Density Wood Tile FS-12 Wind System**


Description: Wood tile pavers supported on adjustable height pedestals providing an Independent Exterior Elevated Flooring System.

Purpose: This Evaluation Report is issued in accordance with Rule 61G20-3 pertaining to Product Approvals issued by the Florida Building Commission.

Compliance: This Independent Exterior Elevated Flooring System has been evaluated in accordance with **FBC Sections 104.11 and 3115.4** and found to be in compliance with the referenced Code and is, for the purpose intended, at least equivalent to that required by the Code. This Evaluation Report is valid provided there are no changes to the product, quality assurance program, or referenced code. A re-evaluation of the product is required following any code changes in order to maintain its validity.

This item has been
digitally signed and sealed
by John W. Knezevich PE
on the date adjacent to
the seal.

Printed copies of this
document are not
considered signed and
sealed and the signature
must be verified on any

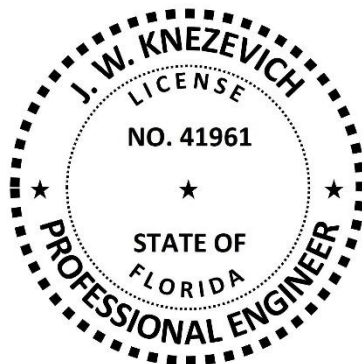

01/10/2025

Evaluation Report Prepared by:
Knezevich Consulting, LLC

John W. Knezevich, PE
President
FL License No. PE 41961
FL CA No. 27988
FBC Organization ID No. ANE1754

EVALUATION REPORT

Page 2 of 3

1. Supporting Materials:

1.1. Test Reports:

1.1.1. FIU's NHERI Experimental Facility

1.1.1.1. Test Report Number 2022-189e-02; Cases 7a & 7c; dated September 2022; ASCE 7-16, Ch. 31, Wind Tunnel Procedure.

1.1.2. ICC NTA:

1.1.2.1. Report No. BIP120822-68(R0), dated March 15, 2023; CISCA-07, Level.II Pedestal Axial Load Test, Maximum Allowable Load = 1,000 lbs.

1.1.3. Smith-Emery Laboratories:

1.1.3.1. Lab No. L16-128.R1, dated March 3, 2016; CISCA-2007, Screwjack Pedestal Axial Load Test, Maximum Allowable Load = 1,250 lbs.

1.1.3.2. Lab No. L16-301, dated March 17, 2016; CISCA-2007, Versadjust Pedestal Axial Load Test, Maximum Allowable Load = 1,250 lbs.

1.1.4. PRI Construction Materials Technologies

1.1.4.1. Project No. BDS-006-02-01 dated 01/08/2014; ASTM G155-13, Accelerated Weathering; and ASTM D638-03, Tensile Properties.

1.2. Technical Research:

1.2.1. Towards Guidelines for Design of Loose-laid Roof Pavers for Wind Uplift; Wind and Structures, Vol. 22, No. 2 (2016).

1.2.2. Design Guidelines for Roof Pavers against Wind Uplift; ASCE/SEI Structures Congress, April 2015.

1.2.3. Wind Uplift of Roof Pavers; FIU International Hurricane Research Center, July 2013.

1.3. Product Evaluation Document:

1.3.1. Knezevich Consulting, LLC Drawing No. KC25-0114, dated January 9, 2025, Sheets 1 through 6. The Product Evaluation Document (PED) is an integral part of this Evaluation Report.

1.4. Structural Calculations:

1.4.1. Calculations prepared by John W. Knezevich, PE analyze the Exterior Elevated Flooring System to resist loads in accordance with FBC Section 3115.4.

1.5. Quality Assurance

1.5.1. Quality assurance inspection program conducted by UL LLC shall be maintained.

2. Impact Resistance:

2.1. This Exterior Elevated Flooring System is not part of the protective building envelope and is not resistant to large or small missile impact.

3. Wind Load Resistance:

3.1. This Exterior Elevated Flooring System is designed and tested to resist wind at specific combinations of basic wind speed, exposure category, and building height as shown in Tables 1 and 3 of the PED. Alternatively, allowable uplift pressures are provided in Tables 2A, 2B, 4A, and 4B of the PED. Reference General Notes 7 & 8 of the PED for applicable criteria.

EVALUATION REPORT

Page 3 of 3

4. Installation:

- 4.1. Installation, including retention at perimeter structure and interior discontinuous edges, shall be in accordance with the Product Evaluation Document referenced herein.

5. Material Specifications:

- 5.1. Component materials, anchors, and structural substrates acceptable for use shall be in accordance with the Product Evaluation Document.

6. Limitations and Conditions of Use:

- 6.1. This is a building code evaluation report addressing the referenced sections of the Florida Building Code. Neither Knezevich Consulting, LLC nor John W. Knezevich, PE are the Design Professional of Record for any project on which this Evaluation Report is used for permitting or design guidance unless retained specifically for that purpose.
- 6.2. This Evaluation Report is not for use in FBC HVHZ jurisdictions.
- 6.3. This evaluation report covers uses as detailed in the referenced Product Evaluation Document. Conditions outside the scope of those documents are not within the scope of this evaluation.
- 6.4. For specific applications of the system, the Product Evaluation Document shall be evaluated for compliance with project requirements by a registered Architect or licensed Professional Engineer.
- 6.5. Fire classification is not part of this Evaluation Report. Refer to manufacturer's literature for additional information.

7. Certificate of Independence

- 7.1. Knezevich Consulting, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products for which this evaluation report is issued.
- 7.2. Knezevich Consulting, LLC is not owned, operated, or controlled by any company manufacturing or distributing products evaluated in this report.
- 7.3. John W. Knezevich, PE does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which this evaluation report is issued.
- 7.4. John W. Knezevich, PE does not have, nor will acquire, a financial interest in any other entity involved in the approval process of products for which this evaluation report is issued.