

STRUCTURAL SOLUTIONS, P.A.*

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IRC-1209-190-15-F		Test Date:	3/27-3/28/2018		Project No.:	18-085			
Design Pressures:	+57 psf, -67.5 psf		Report Date:	10/21/2020		Model #	1200			
Test Pressures:	+85.5 psf, -101.3 psf		Test Location:	American Test Lab, Inc., Brevard, NC						
ASCE 7-16 Criteria:	Up to 5 Feet of Door Width in Zone 5; Any Roof Slope; Enclosed Building									
	Exp. B, 30' MRH		Exp. C, 15' MRH		Exp. C, 25' MRH		Exp. D, 15' MRH		Exp. D, 25' MRH	
	245 mph		222 mph		211 mph		202 mph		194 mph	

Reference Test Report and Drawing:

- American Test Lab, Inc. report number ATLNC-0327.01-18 dated 8/7/2018
- Entrematic Drawing number IRC-1209-190-15-F dated 8/1/2018

Description of Test Specimen:

9'-0"x7'-0" Model 1200, 24ga exterior / 27ga interior steel garage door as shown in drawing IRC-1209-190-15-F.

Test Standards and Report Conclusion:

The above referenced Test Report states the following:

- The tests were conducted in accordance with FBC TAS 201, 202, 203; ASTM E330-02, E1886-05, E1996-09, F588-07, E8; and ANSI / DASMA 108-2012, 115-2012.
- The weight of the missile used for the Large Missile Impact Test was 9.3 lbs.
- All tests were conducted with no deviations.
- The test was witnessed and certified by David Johnson, PE, 1122 Calvert Road, Brevard, NC (FL PE #00061915)
- American Test Lab is accredited by IAS, Certification #TL-423.


Summary:

The 9'-0"x7'-0" Model 1200 as described on drawing IRC-1209-190-15-F meets or exceeds the testing criteria as described above. By comparison to the construction of the 9'-0"x7'-0" Model 1200, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IRC-1209-190-15-F:

- 9' x 7' Amarr Heritage 3000 doors (which is an alternate model number for Model 1200)
- 9' x 7' Amarr Oak Summit 3000 doors (which is an alternate embossment pattern)
- Model 1200, Amarr Heritage 3000, and Amarr Oak Summit 3000 doors with widths up to 9'-0" and heights up to 14'-0"
- Short, Long, Flush, and Oak Summit Panels, which are alternate embossment patterns in the skin
- Up to 2 long-panel windows (38-1/16" x 10-5/8" x 1/4" polycarbonate) or 4 short-panel windows (18-1/8" x 10-5/8") may be installed in each section.

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 7th Edition (2020).

Submitted By:

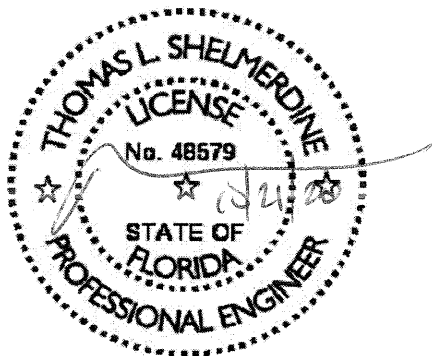

STRUCTURAL SOLUTIONS, P.A.* (*Florida: dba Structural Solutions of North Carolina, Inc., Firm #29412)

Thomas L. Shelmerdine, PE (NC PE #14654; Florida PE #0048579)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096