

Manufacturer: Nan Ya Plastics Corporation U.S.A.
4016 Shadrack St.
Houston, TX 77013

Product Line: Series Entry Door Outswing Fiberglass Outswing Side-Hinged Door, Non-Impact

Compliance:


The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number 08-03302 Revision F, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Test report No.: NCTL-210-4103-11 signed by Christopher Bennett
National Certified Testing Laboratories, Orlando, FL.
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
3. Report No.: NCTL 210-4103-07 Rev. 4 signed by Christopher Bennett
AAMA/WDMA/CSA 101/I.S.2/A440
CSA A440S1
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
4. Report No.: FTL 6757 signed and sealed by Marlin D. Brinson P.E.
Fenestration Testing Laboratory, Medley, FL
ANSI/AAMA/NWDA 101/I.S.2A440
Design pressure: ± 70.0 psf
Water penetration resistance 10.5psf
5. Test report No.: NCTL 210-3893-2 signed and sealed by Gerard J. Ferrara P.E.
National Certified Testing Laboratories, Orlando, FL
TAS 202 Uniform Static Air Pressure, ± 50.0 psf design pressure, 7.50psf water penetration.
6. Test report No.: 2598T0003 signed by Timothy Efaw
PRI Construction Materials Technologies LLC, Tampa, FL.
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.13 psf
7. Report No.: 2598T0004 signed by Timothy Efaw
PRI Construction Materials Technologies LLC, Tampa, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.13 psf
8. Report No.: 2598T0005 signed by Timothy Efaw
PRI Construction Materials Technologies LLC, Tampa, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.13 psf
9. Anchor calculations and comparative analysis, report number 514287-1C, prepared, signed and sealed by Luis Roberto Lomas P.E.

Limitations and Conditions of use:

- Design pressure: ± 50.0 psf
- Panel size: 35 3/4" x 79 1/4"
- Units must be glazed per ASTM E1300, with safety glazing.
- This product is not rated to be used in the HVHZ.
- This product is not impact resistant and does not require impact protection in wind borne debris regions.
- Frame material to Composite.

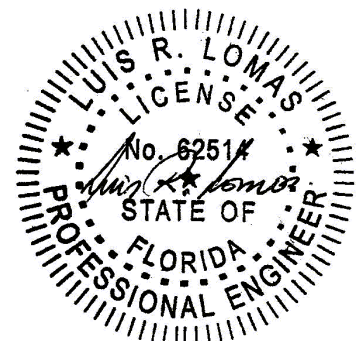

L. Roberto Lomas P.E.

208 7th Ave

Indialantic, FL 32903

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 514287F

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document 08-03302 Revision F.

When the product herein is installed within 3000 ft. of saltwater coastline, all anchors and clips must comply with saltwater environment corrosion resistance requirements of FBC Chapter 17.

Certification of Independence:

Please note that I do not have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I do not have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

