



WALTER A. TILLIT, JR., P.E.

tilteco@aol.com
FL P.E. License No. 44167
FL C.A. License No. 0006719

PRODUCT EVALUATION REPORT

REPORT No.: 20-0803.05

DATE: August 03, 2020

PRODUCT CATEGORY: Window

PRODUCT SUB-CATEGORY: Storefront

PRODUCT NAME: PROTECT SERIES PERFORMANCE
STOREFRONT SYSTEM WITH LARGE &
SMALL MISSILE LAMINATED AND
INSULATED GLASS


MANUFACTURER: Alumina Distribution Center
15002 NW 107 Ave, Suite # 1
Hialeah Gardens, Fl. 33018

1. PURPOSE OF EVALUATION:

This is a Product Evaluation Report issued by **Walter A. Tillit, Jr., P.E.** (System ID # 1906) to **Alumina Distribution Center**, based on Rule Chapter No. **61G20-3, Method 1D** of the **Florida Department of Business and Professional Regulation**.

This product is being issued an Evaluation Report as described herein and has been verified for compliance in accordance with the 2020 Seventh Edition of the Florida Building Code, and to verify that the product is for the purpose intended at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision in case of a Building Code change that may affect its limitations and conditions.

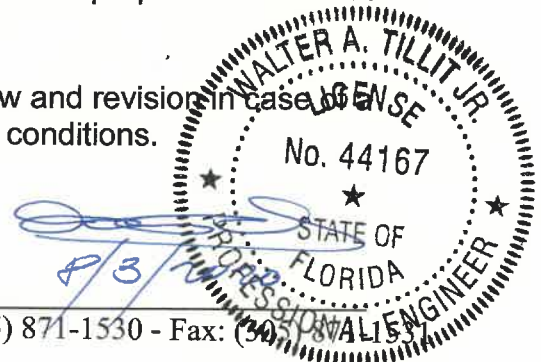

2. EVIDENCE SUBMITTED:

2.1. PRODUCT EVALUATION DOCUMENT (P.E.D.):

Drawing No. 20-225, titled "**PROTECT SERIES PERFORMANCE STOREFRONT SYSTEM WITH LARGE & SMALL MISSILE LAMINATED AND INSULATED GLASS**" sheets 1 thru 21 of 21 (includes 9A & 10A) prepared by **Tilteco, Inc.**; signed and sealed by **Walter A. Tillit, Jr., P.E.**; dated **08/03/2020**. This drawing is an integral part of this Evaluation Report.

2.2. TEST REPORTS:

Impact and Cyclic Tests as per protocol TAS-201, TAS-203, Uniform Static Load as per Protocol TAS 202 and AAMA 501 per sections 1626, 1609.1.2 and 2411.3.2.1.1, respectively of the Florida Building Code.

Test reports prepared by Fenestration Testing Lab Inc., Report No. 10553, dated 03/15/2019, signed and sealed by Idalmis Ortega, P.E.

2.3. STRUCTURAL ENGINEERING CALCULATIONS:

On "**PROTECT SERIES PERFORMANCE STOREFRONT SYSTEM WITH LARGE & SMALL MISSILE LAMINATED AND INSULATED GLASS**" for Maximum Pressure Rating vs. Maximum anchor spacing, maximum Mullion and Horizontal Span, and Maximum Glass Size, based on rational and comparative analysis, in accordance with sections 1604 and 1616 of the Florida Building Code. Calculations prepared by Tilteco, Inc., dated 03/26/2019, signed and sealed by Walter A. Tillit, Jr., P.E.

3. MISSILE IMPACT RESISTANCE:

Large Missile Impact resistance is provided per TAS 201 (9 lbs., 50 feet/sec, Large Missile).


4. WIND LOADS RESISTANCE:

Series "**PROTECT SERIES PERFORMANCE STOREFRONT SYSTEM WITH LARGE & SMALL MISSILE LAMINATED AND INSULATED GLASS**" has been verified to sustain wind pressures. Maximum Glass Panel Dimensions, Mullions Spans, & Horizontal Spans shall be as indicated on sheets 6, 7 and 8 of Product Evaluation Document (P.E.D.), Drawing No. **20-225**.

Maximum Design Pressure Rating for Mullions Head/Sill connections and Jamb Connection Maximum Fasteners Spacing for applicable substrates shall be as indicated on sheets 9, 9A, 10, 10A and 11, of Product Evaluation Document (P.E.D.), Drawing No. **20-225**.

5. INSTALLATION:

Installation shall be performed strictly in accordance with General Notes # 3 thru 11, indicated on sheet 1 and details indicated on sheets 5, 9 thru 10A, 12 thru 21, of Product Evaluation Document (P.E.D.), drawing No. **20-225**.

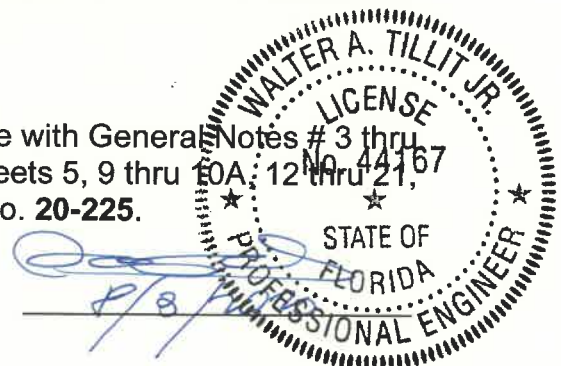

Gaskets and setting blocks used at installations comply with section 2411.3.4 of the Florida Building Code as specified on Bill of Materials (components 19, 20 and 21) on Sheet 3 of Product Evaluation Document (P.E.D.), drawing No. **20-225**.

6. MATERIAL CHARACTERISTICS AND SPECIFICATIONS:

Shall be strictly in accordance with General Notes and Components indicated on sheets 1, 2 & 3 and 4, of Product Evaluation Document (P.E.D.), **Drawing No. 20-225**.

Anchor specifications shall be as indicated on sheets 9, 9A, 10, 10A and 11, of Product Evaluation Document (P.E.D.), Drawing No. **20-225**.

7. LIMITATIONS AND CONDITIONS OF USE:

7.1. Shall be strictly in compliance with General Notes No. 1 thru 5, indicated on sheet 1 of Product Evaluation Document (P.E.D.), Drawing No. **20-225** prepared by Tilteco, Inc. and signed and sealed by Walter A. Tillit, Jr., P.E.

7.2. Product **may** be installed within HIGH VELOCITY HURRICANE ZONE as defined on section 1620.2 of the Florida Building Code and out of it.

7.3. Product shall only be installed into substrates with limitations as indicated on sheets 9, 9A, 10, 10A and 11 of Product Evaluation Document (P.E.D.), Drawing No. **20-225**.

Product Evaluation Report prepared by Walter A. Tillit, Jr., P.E. (Florida License No. 44167), President of Tilteco, Inc. (Florida CA-0006719).

WATILL

D:\TILTECO ADMON RECORDS \ P. E. REPORT.20 \ ALUMINA DISTRIBUTION CENTER \ PROTECT SERIES
PERFORMANCE STOREFRONT SYSTEM WITH LARGE & SMALL MISSILE LAMINATED AND INSULATED GLASS\
DRWG # 20-225\ REPORT # 20-0803.05

