

WOLTERS ENGINEERING

ENGINEERING, DRAFTING, CONSULTING

15211 97th Road N
West Palm Beach, FL 33412
Ph/Fx: (561) 225-1982

PRODUCT EVALUATION

PRODUCT: SL500 SERIES RESILIENCE R104 AUTOMATIC SLIDING DOOR SYSTEM
(FULL BREAK-OUT)

MANUFACTURER: ASSA ABLOY ENTRANCE SYSTEMS
1900 AIRPORT ROAD
MONROE, NC 28110

To all concerned,

The SL500 Series Resilience R104 Automatic Sliding Door System, manufactured by Assa Abloy Entrance Systems, is a multi-panel glazed aluminum automatic sliding door set in an aluminum frame. The door has been tested per TAS 201/202/203, and per Section 6.4.4 of AAMA/WDMA/CSA 101/I.S.2/A440, by Intertek B&C, with results shown in test reports J5787.01-550-18-R1 thru J5787.15-550-18-R1 (spec's 1-15), and T9689.02-450-18.

Technical Documentation:

1. Drawing "DOC-1688252-FPA" dated 9/4/26 (Rev. 2), signed and sealed by Scott Wolters, PE.
2. Test Reports listed above by Intertek B&C, signed and sealed by Vinu Abraham, PE.
3. Supplemental Calculations to support DOC-1688252-FPA, signed and sealed by Scott Wolters, PE.

I have reviewed this submittal per the requirements of FAC Product Approval Rule Chapter 61G20-3.005 (4). Based on the limitations listed below and those provided in the documents above, this product meets all the requirements of the 9th Edition (2026) Florida Building Code generally, and chapters 10, 11, 16, 17, 23, and 24 specifically, for use outside of the HVHZ.

Limitations: This door is approved for use outside of the HVHZ. Glass Types 1-2 are (Level D) Large and Small Missile Impact Resistant. Glass Type 3 is (Level E) Large and Small Missile Impact Resistant. Glass Types 4 & 5 are not impact resistant, and require shutters for use in windborne debris regions.

<u>Overall Dimensions:</u>	Maximum Frame Height:	Varies – see tables on sheet 4.
	Maximum Frame Width:	Varies - see tables on sheet 4
	Maximum Panel Width:	Varies - see tables on sheet 4 and charts on sheets 6 & 10.
	Maximum Design Pressure:	Varies – see tables on sheet 4.

This door system has a Limited Water Rating (LWI) per AAMA/WDMA/CSA 101/I.S.2/A440. It is approved for use in locations where water infiltration resistance is not required, or where it is protected by an overhang meeting the requirements of FBC Section 1709.5.1.

SPECIALIZING IN IMPACT RESISTANT CURTAINWALLS, STOREFRONTS, & WINDOWS

Glass:

Type 1: 9/16" Laminated (LMI – Level D)
1/4" Heat Strengthened
0.090" SentryGlas Interlayer (NOA# 26-0625.02)
1/4" Heat Strengthened

Type 2: 1" Insulated Laminated (LMI – Level D)
3/16" Tempered
3/8" Air Space (Aluminum Spacer)
3/16" Heat Strengthened
0.090" SentryGlas Interlayer (NOA# 26-0625.02)
3/16" Heat Strengthened

Type 3: 9/16" Laminated (LMI – Level E)
1/4" Heat Strengthened
0.180" SentryGlas Interlayer (NOA# 26-0625.02)
1/4" Heat Strengthened

Type 4: 1/4" Tempered (Non-Impact)

Type 5: 1" Insulated Tempered (Non-Impact)
1/4" Tempered
1/2" Air Space (Aluminum Spacer)
1/4" Tempered


Locks: Manufacturer's Standard 3 Pt Lock (Single Slide) or 4 Pt. Lock (Bi-Part)
Or
Adams-Rite 8600 Series CVR Panic

Please see the Bill of Materials on Sheets 21-22 and the details on Sheets 15 and 23-26 for information on door hardware requirements.

If you have any questions or need more information concerning this approval please contact me.

Thank you,


Scott Wolters
FL PE# 62354
OCT 15 2026

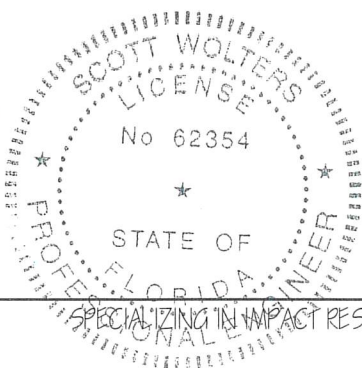

Digitally signed
by Scott Wolters
Date: 2026.10.15
01:30:01 -04'00'

SPECIALIZING IN IMPACT RESISTANT CURTAIN WALLS, STOREFRONTS, & WINDOWS