Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

Product Evaluation Report

McELROY METAL, INC.

24" Trap-Tee 24 Ga. Roof Panel over open framing

Florida Product Approval # 30738.3 R4

Florida Building Code 2026
Per Rule 61G20-3
Method: 1 –D

Category: Structural Components
Subcategory: Roof Deck
Compliance Method: 61G20-3.005(1)(d)
NON HVHZ

Product Manufacturer:
McElroy Metal, Inc.
1500 Hamilton Road
Bossier City, LA 71111

Engineer Evaluator:
Johnathan Green, P.E. #88223
Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 4
Installation Detail: Page 5 - 7

JOHNATHAN GREEN
LICENSE
No. 88223
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

AUGUST 24, 2026

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

Compliance Statement: The product as described in this report has demonstrated compliance with the Florida Building Code 2026, Sections 1504.3.2, 1504.7.

Product Description: 24" Trap-Tee 24 Ga. Steel Roof Panel, 24" Coverage, standing seam structural roof panel. Structural Application.

Panel Material/Standards: Material: 24 Ga. Steel, conforming to Florida Building Code 2026 Section 1507.4.3.
Yield Strength: Min. 50.0 ksi
Corrosion Resistance: Panel Material shall comply with Florida Building Code 2026, Section 1507.4.3.

Panel Dimension(s):

Thickness:	0.024" nominal
Coverage:	24" nominal coverage
Rib:	2 ¾" tall trapezoidal rib
Panel Seam:	Mechanically seamed
Panel Seam Cap:	24 Ga. Steel with (2) beads of factory applied sealant.

Panel Clips:

Product Name:	Standard Clip
Type:	Fixed, 16 Ga. steel, 8" long, 3 1/8" tall
Product Name:	Super Clip
Type:	Fixed, 16 Ga. steel, 16" long, 3 1/8" tall
Product Name:	24 Ga. Low Multi-Span Clip, 3 1/8" tall
Type:	Fixed, 24 Ga. ASTM A792 50 ksi
Product Name:	22 Ga. Low Multi-Span Clip, 3 1/8" tall
Type:	Fixed, 22 Ga. ASTM A792 50 ksi
Corrosion Resistance:	Per Florida Building Code 2026 Section 1506.7 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Panel Clip Fastener: (2) ¼-14 x 1 ¼" HWH SD no washer per clip
Corrosion Resistance: Per Florida Building Code 2026 Section 1506.6, 1507.4.4 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Substrate Description: Min. 16 Ga. Steel Framing. Must be designed in accordance w/ Florida Building Code.

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

Allowable Design Pressures:

Panel System:	**24" Trap-Tee 24 Ga. with Standard Clip**				
Clip Spacing (O.C.):	5'-0"	4'-0"	3'-0"	2'-0"	1'-0"
Maximum Design Pressure (PSF):	-33.8	-63.3	-92.7	-122.2	-151.6

Panel System:	**24" Trap-Tee 24 Ga. with Super Clip**				
Clip Spacing (O.C.):	5'-0"	4'-0"	3'-0"	2'-0"	5'-0"
Maximum Design Pressure (PSF):	-52.1	-79.8	-107.6	-135.3	+124.9

Panel System:	**24" Trap-Tee 24 Ga. with 24 Ga. Multi-Span Clip**	
Fastener Spacing (O.C.):	5'-0"	
Maximum Design Pressure (PSF):	-104.1	

Panel System:	**24" Trap-Tee 24 Ga. with 22 Ga. Multi-Span Clip**	
Fastener Spacing (O.C.):	5'-0"	
Maximum Design Pressure (PSF):	-114.5	

*Design Pressure includes a Safety Factor = 2.0.

Code Compliance: The product described herein has demonstrated compliance with The Florida Building Code 2026, Section 1504.3.2, 1504.7.

Evaluation Report Scope: The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2026, as relates to Rule 61G20-3.

Performance Standards: The product described herein has demonstrated compliance with:

- ASTM E 1592-05 (2017) Test method for structural performance of sheet metal roof and siding systems by uniform static air pressure difference.
- FM 4471-92, Foot Traffic Resistance Test

Reference Data:

1. ASTM E 1592-05 (2017)
   Force Engineering & Testing (FBC Organization # TST-5328)
   Report No. 90-0033T-24 & 90-0093T-25
2. FM 4471-95, Foot Traffic Resistance Test
   Force Engineering & Testing, Inc. (FBC Organization # TST-5328)
   Report No. 90-0033T-24
3. Certificate of Independence
   By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing
   (FBC Organization # ANE ID: 12901)

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

Test Standard Equivalency: The FM 4471-95 test standard is equivalent to the FM 4471-92 test standard.

Quality Assurance Entity: The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.

Minimum Slope Range: Minimum Slope shall comply with Florida Building Code 2026, including Section 1507.4.2 and in accordance with Manufacturers recommendations.

Installation: Install per manufacturer's recommended details.

Limitation: Metal hip and ridge covers are outside the scope of this evaluation report and must be in compliance with FBC 2026 Section 1504.3.1.1 through other product approval.

Insulation: Manufacturer's approved product (Optional)

Roof Panel Fire Classification: Fire classification is not part of this evaluation.

Shear Diaphragm: Shear diaphragm values are outside the scope of this report.

Design Procedure: Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2026 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2026 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

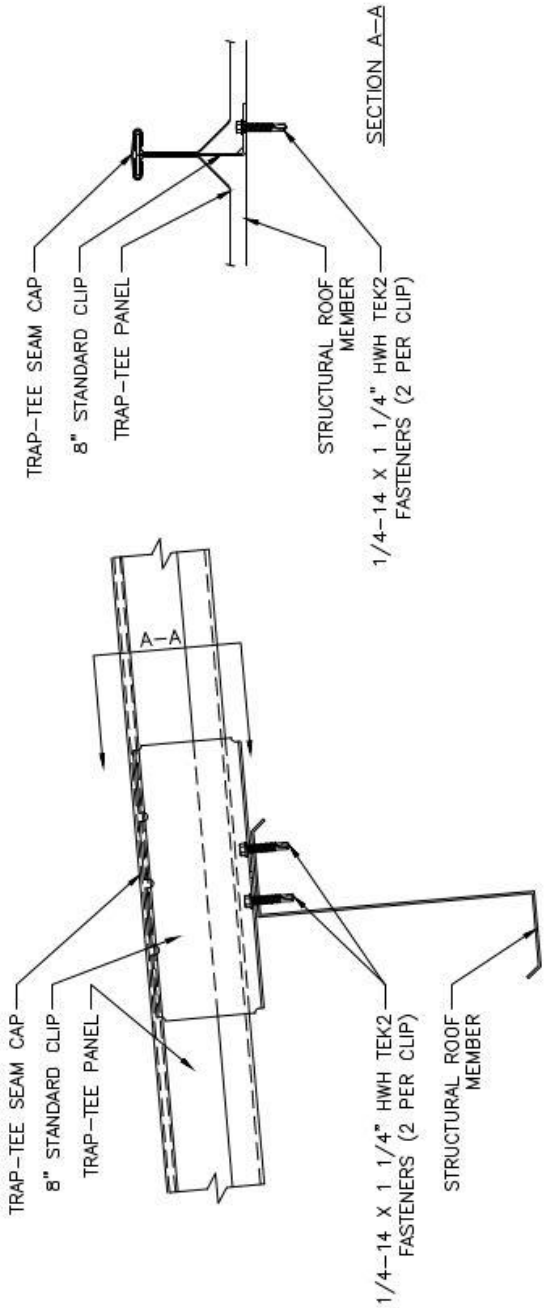

ISSUE/REVISION DATE: 11/17/2025

SCALE: N.T.S.

8" STANDARD CLIP TO PURLIN CONNECTION

ROOF PANEL: TRAP-TEE

SUBSTRATE: PURLIN

McELROY METAL

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

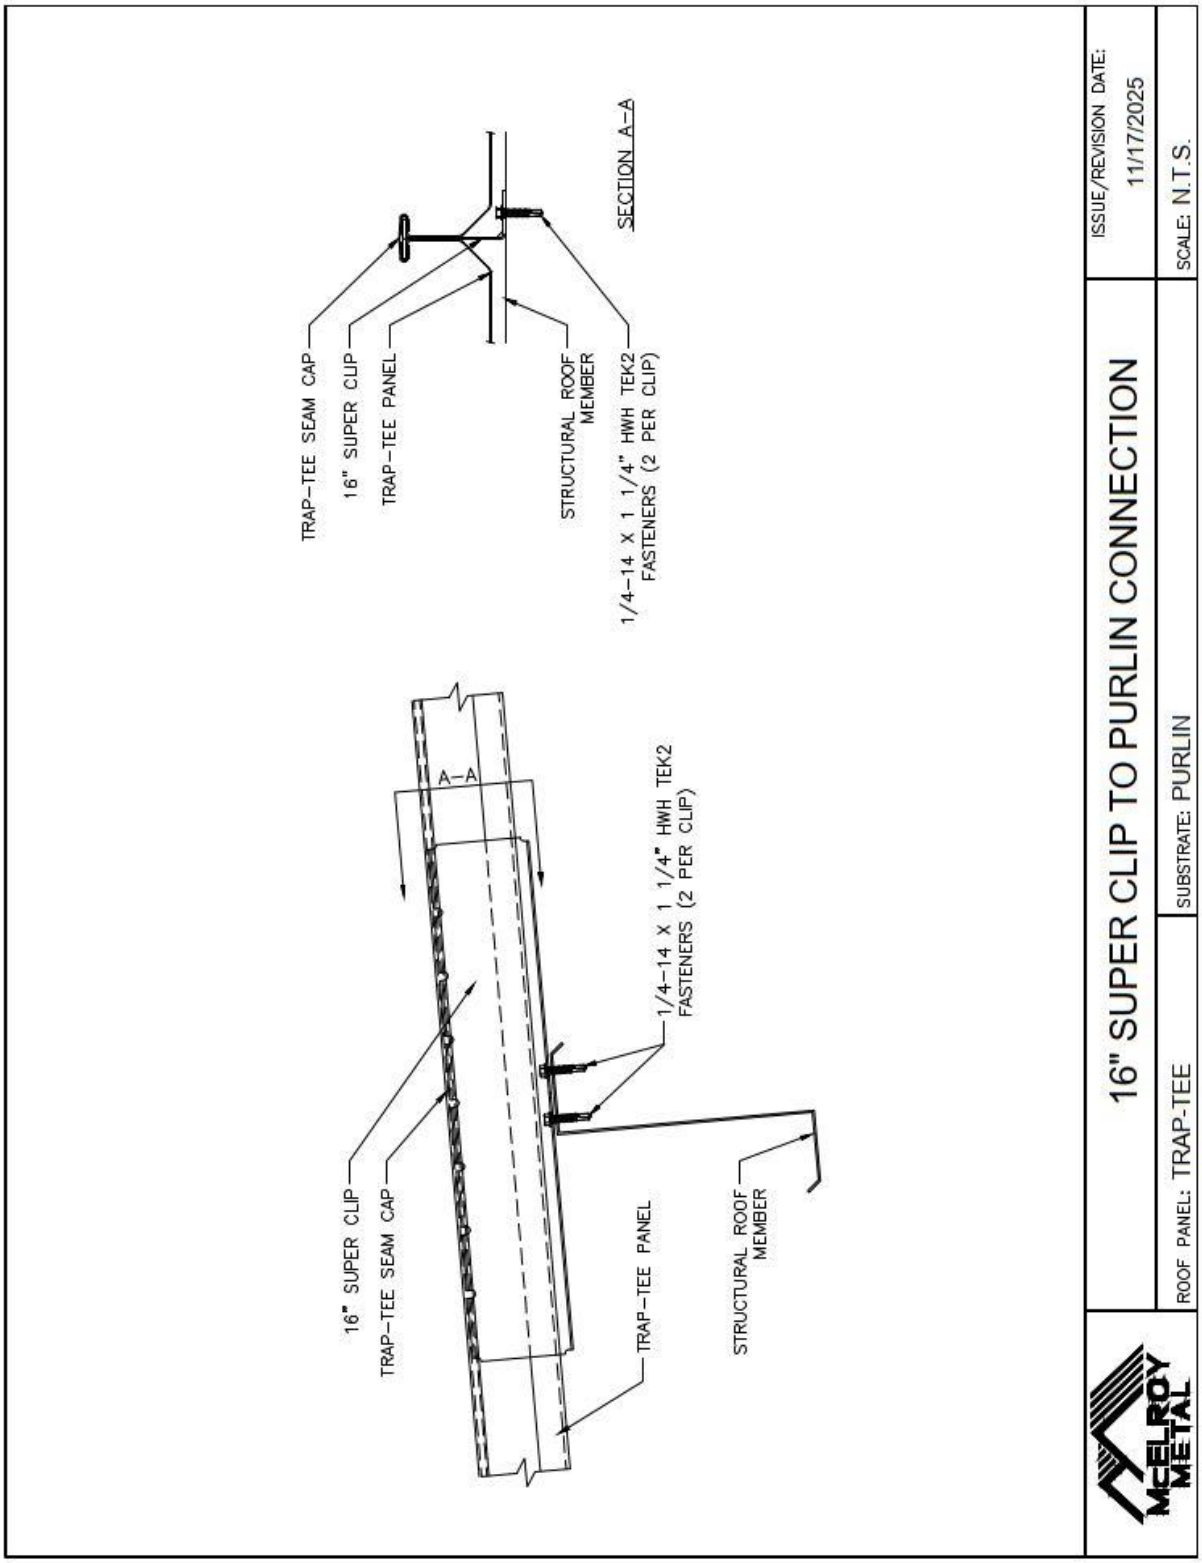

Force Engineering & Testing
19530 Ramblewood Drive
Humble, Texas 77338
Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

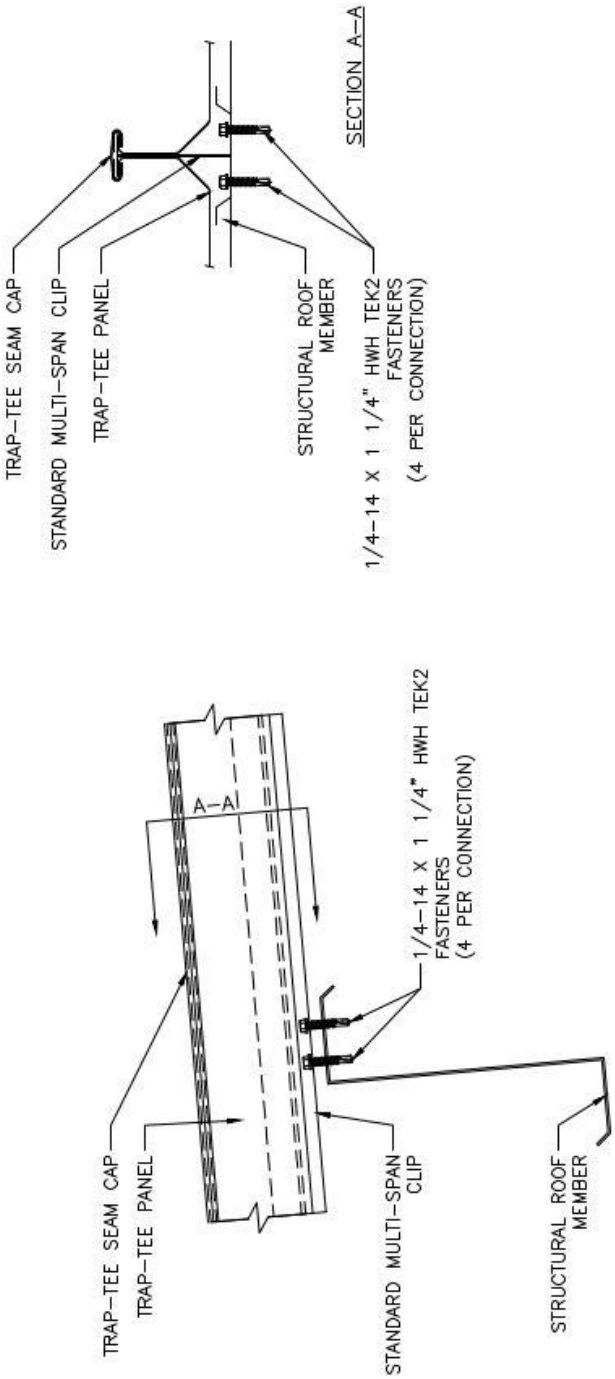

ISSUE/REVISION DATE: 11/17/2025

SCALE: N.T.S.

STANDARD MULTI-SPAN CLIP TO PURLIN CONNECTION

ROOF PANEL: TRAP-TEE

SUBSTRATE: PURLIN

McELROY METAL

FL# 30738.3 R4