



WALTER A. TILLIT, JR., P.E.

tilteco@aol.com
FL P.E. License No. 44167
FL C.A. License No. 0006719

PRODUCT EVALUATION REPORT

REPORT No.: 20-0803.02

DATE: August 03, 2020

PRODUCT CATEGORY: Exterior Doors

PRODUCT SUB-CATEGORY: Sliding Exterior Door Assemblies

PRODUCT NAME: SERIES LAZH 13000 HIGH IMPACT
REINFORCED SLIDING GLASS DOOR
SMALL MISSILE / HIGH LOADS


MANUFACTURER: Alumina Distribution Center
15002 NW 107 Ave, Suite # 1
Hialeah Gardens, Fl. 33018

1. PURPOSE OF EVALUATION:

This is a Product Evaluation Report issued by **Walter A. Tillit, Jr., P.E.** (System ID # 1906) to **Alumina Distribution Center**, based on **Rule Chapter No. 61G20-3, Method 1D of the Florida Department of Business and Professional Regulation.**

This product is being issued an Evaluation Report as described herein and has been verified for compliance in accordance with the 2020 Seventh Edition of the Florida Building Code, and to verify that the product is for the purpose intended at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision in case of a Building Code change that may affect its limitations and conditions.

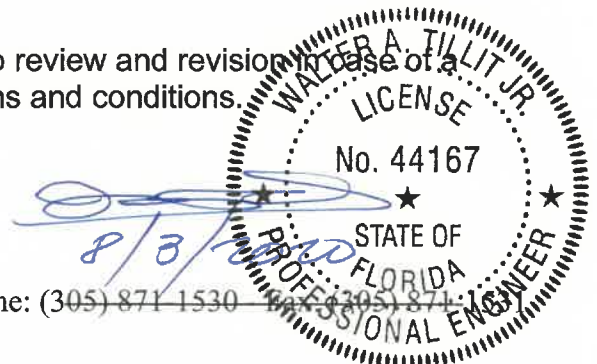

2. EVIDENCE SUBMITTED:

2.1. PRODUCT EVALUATION DOCUMENT (P.E.D.):

Drawing No. 20-228, titled “**SERIES LAZH 13000 HIGH IMPACT REINFORCED SLIDING GLASS DOOR SMALL MISSILE / HIGH LOADS**” sheets 1 thru 49 of 49 prepared by **Tilteco, Inc.**; signed and sealed by **Walter A. Tillit, Jr., P.E.**; dated 08/03/2020. This drawing is an integral part of this Evaluation Report.

2.2. TEST REPORTS:

Impact and Cyclic Tests as per protocol TAS-201, TAS-203, Uniform Static Load as per Protocol TAS 202 per sections 1626 and 1609.1.2, respectively of the Florida Building Code.

Test reports prepared by Fenestration Testing Lab Inc., Report No.7575, signed and sealed by Marlin D. Brinson, P.E.

2.3. STRUCTURAL ENGINEERING CALCULATIONS:

On Series LAZH 13000 High Impact Reinforced Sliding Glass Door Small missile / High loads for Maximum Pressure Rating vs. Maximum anchor spacing, maximum width and height, and Maximum Glass Size, based on rational and comparative analysis, in accordance with sections 1604 and 1616 of the Florida Building Code. Calculations prepared by Tilteco, Inc., dated 07/10/2014, signed and sealed by Walter A. Tillit, Jr., P.E.

3. MISSILE IMPACT RESISTANCE:

Small Missile Impact resistance is provided per TAS 201

4. WIND LOADS RESISTANCE:

On Series LAZH 13000 High Impact Reinforced Sliding Glass Door Small missile / High loads has been verified to keep sustain wind pressures. Maximum Glass Panel Dimensions, door width and height shall be as indicated on sheets 4, 3A, 22, 27A and 46 of Product Evaluation Document (P.E.D.), Drawing No. **20-228**.

5. INSTALLATION:

Installation shall be performed strictly in accordance with General Notes # 4 thru 11, indicated on sheet 1 and details indicated on sheets 4 thru 21 and 28 thru 45 jointly with sheet 25 and 49 of Product Evaluation Document (P.E.D.), drawing No. **20-228**.

Gaskets and setting blocks used at installations comply with section 2411.3.4 of the Florida Building Code as specified on Bill of Materials on Sheets 2 and 26 of Product Evaluation Document (P.E.D.), drawing No. **20-228**.



6. MATERIAL CHARACTERISTICS AND SPECIFICATIONS:

Shall be strictly in accordance with General Notes and Components indicated on sheets 1 thru 3, and 26 & 27 of Product Evaluation Document (P.E.D.), **Drawing No. 20-228.**

Anchor specifications shall be as indicated on sheet 1, of Product Evaluation Document (P.E.D.), Drawing No. **20-228.** Max anchor spacing sheet as indicated on sheets 23, 24, 47 & 48 of Product Evaluation Document (P.E.D.), Drawing No. **20-228.**

7. LIMITATIONS AND CONDITIONS OF USE:

7.1. Shall be strictly in compliance with General Notes No. 1 thru 5, indicated on sheet 1 of Product Evaluation Document (P.E.D.), Drawing No. **20-228** prepared by Tilteco, Inc. and signed and sealed by Walter A. Tillit, Jr., P.E.

7.2. Product **may** be installed within HIGH VELOCITY HURRICANE ZONES as defined on section 1620.2 of the Florida Building Code and out of it.

7.3. Product shall only be installed into substrates with limitations as indicated on sheets 23, 24, 47 & 48 of Product Evaluation Document (P.E.D.), Drawing No. **20-228.**

Product Evaluation Report prepared by Walter A. Tillit, Jr., P.E. (Florida License No. 44167), President of Tilteco, Inc. (Florida CA-0026719).

WATLL

D:\TILTECO ADMON RECORDS \ P. E. REPORT.20 \ ALUMINA DISTRIBUTION CENTER \ SERIES LAZH 13000 HIGH IMPACT REINFORCED SLIDING GLASS DOOR SMALL MISSILE / HIGH LOADS\ DRWG # 20-228\ REPORT # 20-0803.02

