BUILDING DROPS
A Perfect Solution in Every Drop!
Certificate of Authorization: 29578

398 East Dania Beach Blvd.
Suite 338
Dania Beach, FL 33004
954.399.8478 PH
954.744.4738 FX
contact@buildingdrops.com

Product Evaluation Report

of

Co.Me.P Infissi SRL
EBE Series Fixed Windows
HVHZ Impact Rated

for

Florida Product Approval

Report No. 6627

FL# FL31728

Current Florida Building Code

Method:	**1 – A (Certification)**
Category:	**Windows**
Sub – Category:	**Fixed**
Product:	**EBE Series Fixed Windows**
Material:	**Galvanized Steel, Corten Steel, Stainless Steel or OT/67 (Brass)**
Product Dimensions:	**See Installation Instructions COM003**

Prepared for:
Co.Me.P Infissi SRL
Viale Europa, 440
51039 Santonuovo Pt

Prepared by:
Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 03/11/2020

Contents:

Evaluation Report Pages 1 – 3

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.03.22 14:51:37 -04'00'

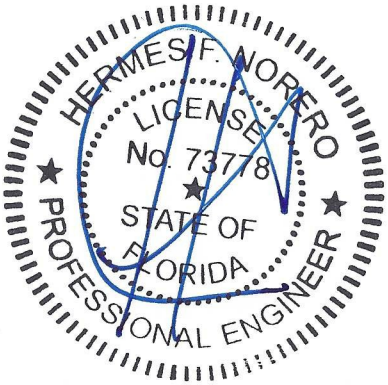

Hermes F. Norero, P.E.
Florida No. 73778

Manufacturer: **Co.Me.P Infissi SRL**

Product Category: Windows

Product Sub-Category: Fixed

Compliance Method: State Product Approval Method (1)(a)

Product Name: **EBE Series Fixed Windows - HVHZ Impact Rated**

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Co.Me.P Infissi SRL** based on Method 1a of the Florida Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **COM003**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and does not require an impact resistant covering.
4. Site conditions that deviate from the details of drawing **COM003,** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **COM003** for size and design pressure limitations.

Certification Agency: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a program audited by and approved by **National Accreditation and Management Institute** (FBC Organization #: CER1773).

Performance Standards: The product described herein has been tested per:

- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **Blackwater Testing, Inc.**
   (FBC Organization # TST10394)
   Report # BT-CMP-17-001 — Report Date: 07/08/18
   TAS test reports signed/sealed by Constantin Bortes, P.E. 77915

2. Material Certification
   Miami Dade RER Product Control Section – NOA
   Current NOA for Kuraray SentryGlas Interlayer

Installation:

Refer to Installation Instructions **(COM003)** for anchor types, edge distance, embedment, spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions **(COM003)** for design pressures.