

STRUCTURAL SOLUTIONS, P.A.

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IBC-3609-140-00		Amarr	3552		Report Date:	10/5/2023			
Design Pressures:	+28.2 psf, -33.1 psf		Test Pressures:		+42.3 psf, -49.7 psf			Project No. 10-041		
Test Date:	1/5/2023		Test Location:		Amarr, 165 Carriage Ct., Winston-Salem, NC					
ASCE 7-22 Criteria:	Up to 5 Feet of Door Width in Zone 5; Roof Slope ≤ 10°; Enclosed Building									
	Exp. B, 30' MRH		Exp. C, 15' MRH		Exp. C, 25' MRH		Exp. D, 15' MRH		Exp. D, 25' MRH	
	181 mph		164 mph		156 mph		149 mph		143 mph	

Reference Drawing and Test Report(s):

- Amarr Drawing number IBC-3609-140-00 dated 04/14/2010
- Structural Solutions, P.A. report for IBC-3609-140-00 dated 10/05/2023
 - Static Air Pressure Test witnessed by Thomas L. Shelmerdine, PE

Description of Test Specimen:

A 9'-4" wide x 8'-0" high x 2" thick sectional garage door, Amarr 3552. All sections were made of 0.05 in. aluminum. The test unit is further described on Drawing IBC-3609-140-00.

Test Standards and Report Conclusions:

The above referenced Test Report states the following:

- The tests were conducted in accordance with ANSI/DASMA 108-17; ASTM E330-14
- The tests were witnessed and certified by: Thomas L. Shelmerdine, PE
- All tests passed the referenced Test Standards.
- The Amarr test facility is accredited by the American Association for Laboratory Accreditation, Cert. #2595.01.

Summary:

The 9'-4"x8'-0" Amarr 3552 door as described on drawing IBC-3609-140-00 meets or exceeds the testing criteria as described above. By comparison to the construction of the 9'-4"x8'-0" Amarr 3552, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IBC-3609-140-00:


- 9'-4" x 8'-0" Amarr Vista doors, which is an alternate model number for Amarr 3552
- 9'-4" x 8'-0" Axolotl Amarr AX3592 doors, which uses compact overlay in lieu of glazing
- Amarr 3552, Amarr Vista, and Axolotl Amarr AX3592 doors with widths of up to 9'-4" and heights of up to 24'

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 8th Edition (2023). I certify that I have no financial interest in the testing lab(s) that performed the tests, nor in Amarr Garage Doors.

Submitted By:

Thomas L
Shelmerdine

Digitally signed by Thomas L
Shelmerdine
DN: c=US, o=North Carolina,
dnQualifier=A01410D000001856487A7
B100125CE2, cn=Thomas L Shelmerdine
Date: 2023.10.05 14:27:31 -04'00'

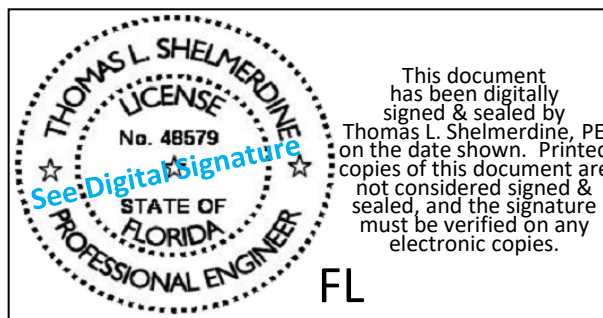

STRUCTURAL SOLUTIONS, P.A.

Thomas L. Shelmerdine, PE (Florida PE #0048579) (dba Structural Solutions of North Carolina, Inc., Florida Firm #29412)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096