



Farabaugh Engineering and Testing Inc.

Project No. T132-20

Report Date: February 4, 2020

No. Pages: 17 (inclusive)


Revision Date: 9/24/20

ASTM E1592
STANDARD TEST METHOD FOR
STRUCTURAL PERFORMANCE OF SHEET METAL ROOF AND SIDING SYSTEMS BY
UNIFORM STATIC AIR PRESSURE DIFFERENCE

**BOX RIB – 4 PANEL
12" WIDE X 0.032" ALUMINUM**

FOR

PETERSEN ALUMINUM CORP.
10551 PAC RD.
TYLER, TX 75707

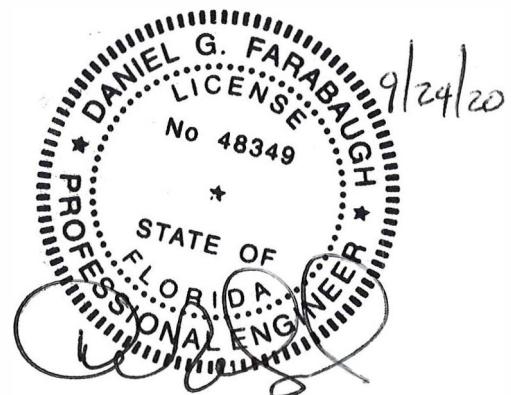

Prepared by:

Paul G. Farabaugh

Approved by:

Daniel G. Farabaugh
DANIEL G. FARABAUGH, P.E.
255 Saunders Station Rd.
Trafford, PA 15085
(412) 373-9238



DADE COUNTY
ACCREDITED
LABORATORY



AAMA
ACCREDITED
LABORATORY



TEXAS
ACCREDITED
LABORATORY



FLORIDA
ACCREDITED
LABORATORY & QC ENTITY

ASTM E1592-05(2017)
STANDARD TEST METHOD FOR
STRUCTURAL PERFORMANCE OF SHEET METAL ROOF AND SIDING SYSTEMS BY
UNIFORM STATIC AIR PRESSURE DIFFERENCE

Purpose

This test method covers the evaluation of the structural performance of Sheet Metal Panels and Anchor to Panel Attachments for roof or siding systems under uniform static air pressure difference.

Test Dates

From February 3, 2020 to February 4, 2020

Test Specimen

Manufacturer: Petersen Aluminum Corp.
10551 PAC Rd.
Tyler, TX 75707

Specimen: Box Rib – 4 Panel, 12" wide (Coverage), 0.032" Aluminum (w/ Clip Leg)

Panel Clip: One Piece Stainless Steel Clip – 2-1/2" Long X 0.034" Thick

Testing Apparatus

A vacuum test chamber was used with two static pressure taps located at diagonally opposite corners. A controlled blower provided a vacuum to uniformly load the specimen mock-up. Calibrated manometers were used to measure the pressure at each pressure tap. The uniform load pressure was performed in the negative direction to monitor wind uplift on the panel specimen mock-up. Calibrated deflectometers were attached to monitor panel deformation as shown.

Installation

- The panels were installed onto 16 ga supports with #14-13 X 1-1/2" long DP1 Concealor self drill fasteners (2 fasteners per clip). The panel fixed ends used the same fasteners in the low cells of the panel into the 16 ga. supports.
- Plastic (4 mil thick) was employed loosely between the panels and subgirts and in the side joints to create a vacuum seal.

Procedure

- The specimen was checked for proper adjustment and all vents closed in the pressure measuring lines.
- The required deflection measuring apparatus were installed at their specified locations.
- A nominal initial pressure was applied equal to at least four times but not more than ten times the dead weight of the specimen. This nominal pressure was used as the reference zero and initial deflection readings were recorded.
- At each load increment, pressure was maintained for a period of not less than 60 seconds and until the deflection gages indicated no further increase in deflections.
- Successive increments were achieved as above until failure or ultimate load was reached.
- Plastic (4 mil thick) was employed loosely between the panels and subgirts and in the side joints to create a vacuum seal.

The test was conducted according to the procedure in ASTM E-1592-05(2017) and as noted herein. In our opinion the tape and plastic had no influence on the results of the test.

Project No. T132-20

TEST #1

Test Date: 2-3-20

Test Specimen: Box Rib – 4 Panel, 12" wide (Coverage), 0.032" Aluminum (w/ Clip Leg)


Support Spacing: 5' o/c



NEGATIVE (UPLIFT) TEST PRESSURE



LOAD (PSF)	DEFLECTION DIAL READINGS (INCHES)					
	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0	0	0	0	0	0
10.4	0.4337	0.375	0.408	0.363	0.271	0.386
0.0	0.0127	0.013	0.008	0.014	0.01	0.009
15.6	0.687	0.622	0.658	0.588	0.456	0.632
0.0	0.0277	0.033	0.019	0.034	0.028	0.021
20.8	0.941	0.86	0.896	0.824	0.64	0.872
0.0	0.0871	0.082	0.064	0.085	0.069	0.057
31.2	1.376	1.289	1.336	1.263	0.99	1.316
0.0	0.298	0.271	0.257	0.283	0.254	0.237
41.6	1.666	1.596	1.63	1.559	1.236	1.613
0.0	0.472	0.431	0.429	0.441	0.422	0.414
52.0	1.933	1.889	1.889	1.844	1.489	1.871
0.0	0.679	0.604	0.62	0.638	0.629	0.611
62.4	2.171	2.179	2.133	2.123	1.71	2.105
0.0	0.901	0.815	0.833	0.827	0.812	0.818
72.9	2.348	2.427	2.324	2.346	1.882	2.287
0.0	1.091	1.007	1.034	0.993	0.966	1.02
83.3	2.508	2.657	2.496	2.556	2.035	2.437
0.0	1.299	1.204	1.236	1.158	1.142	1.214

RESULTS:

Maximum Test Load = 83.3 psf (Panel disengaged from clip)

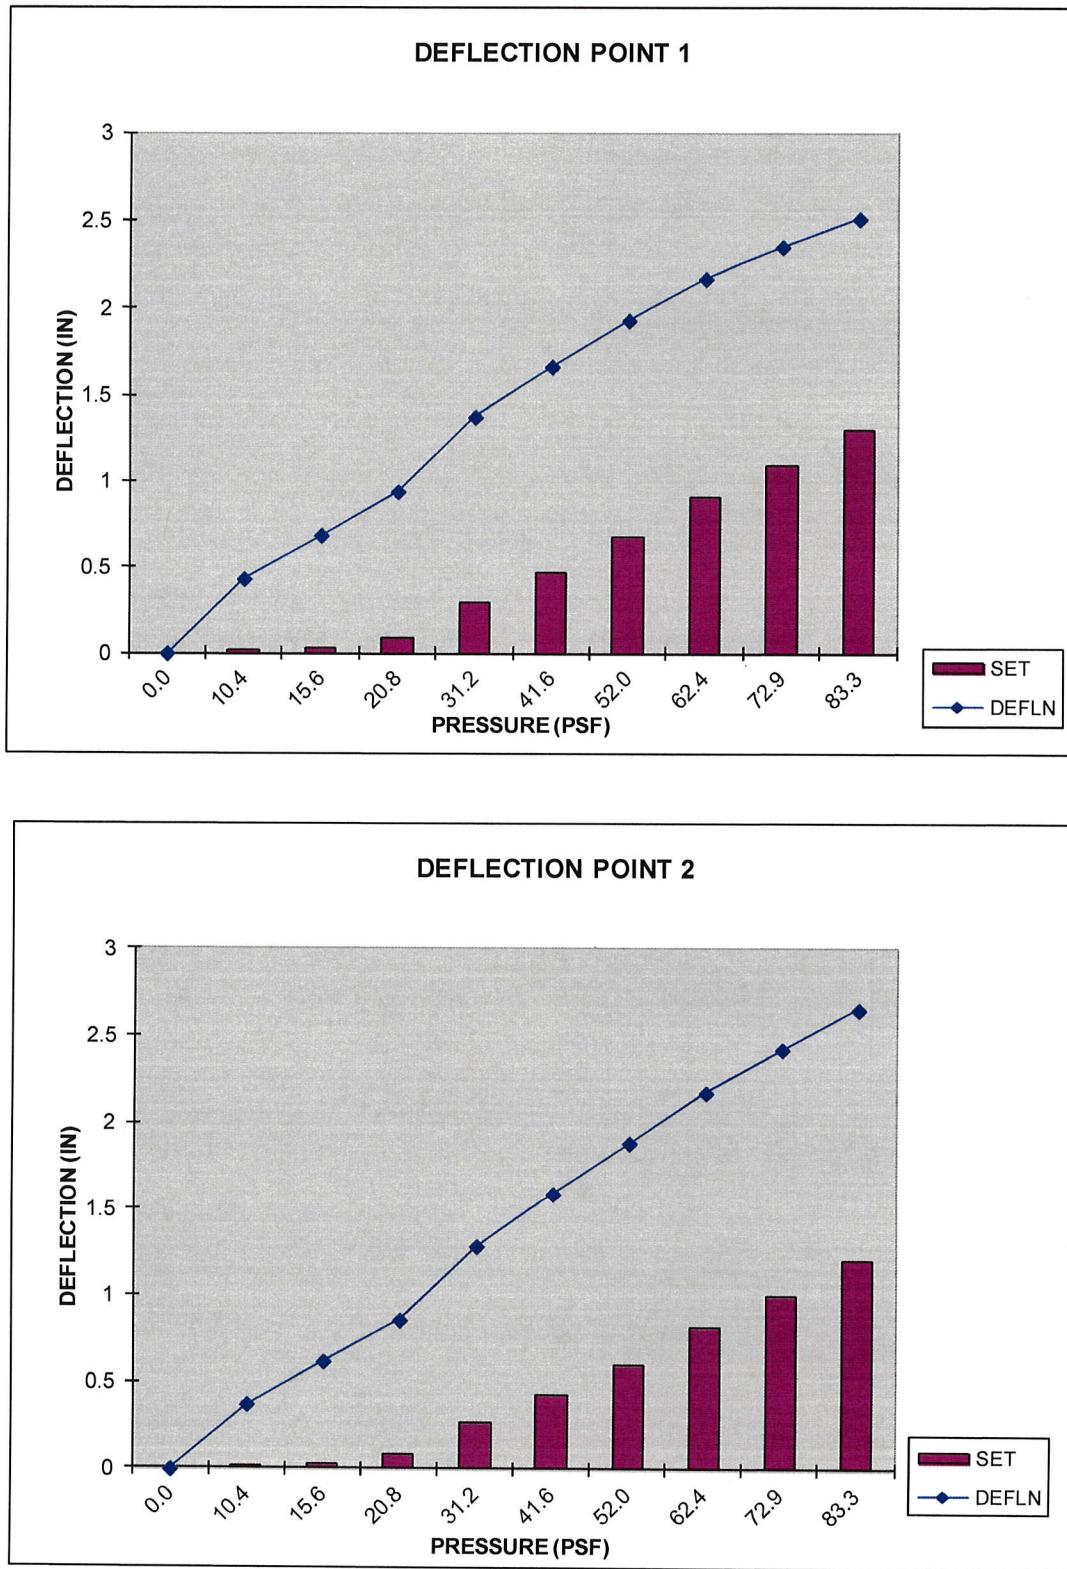

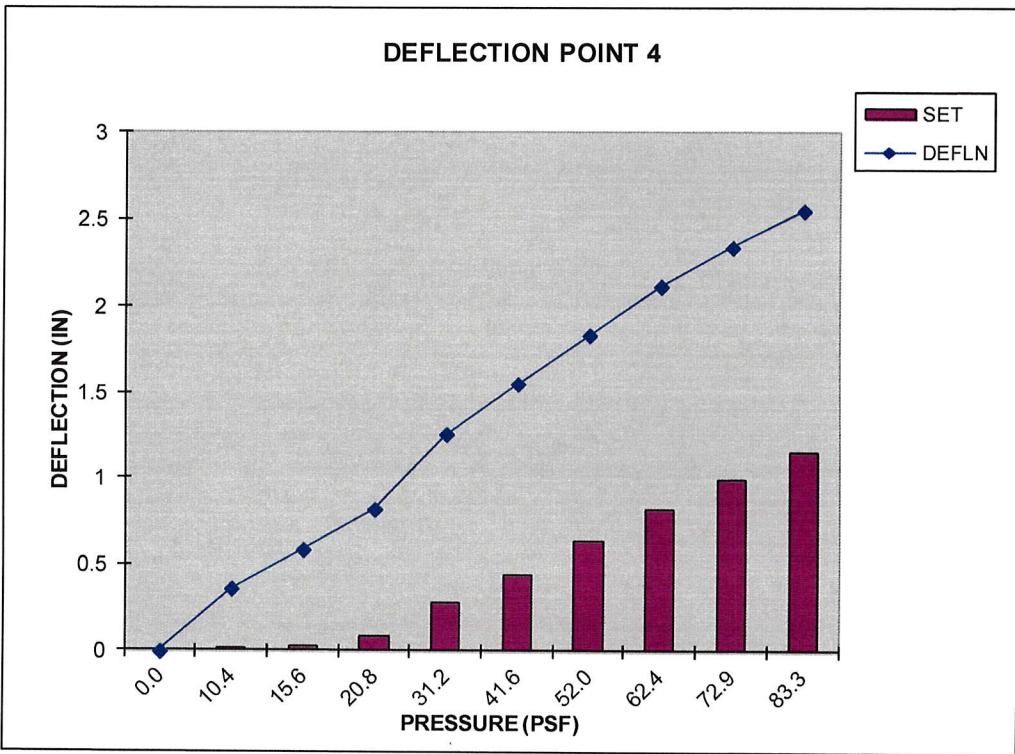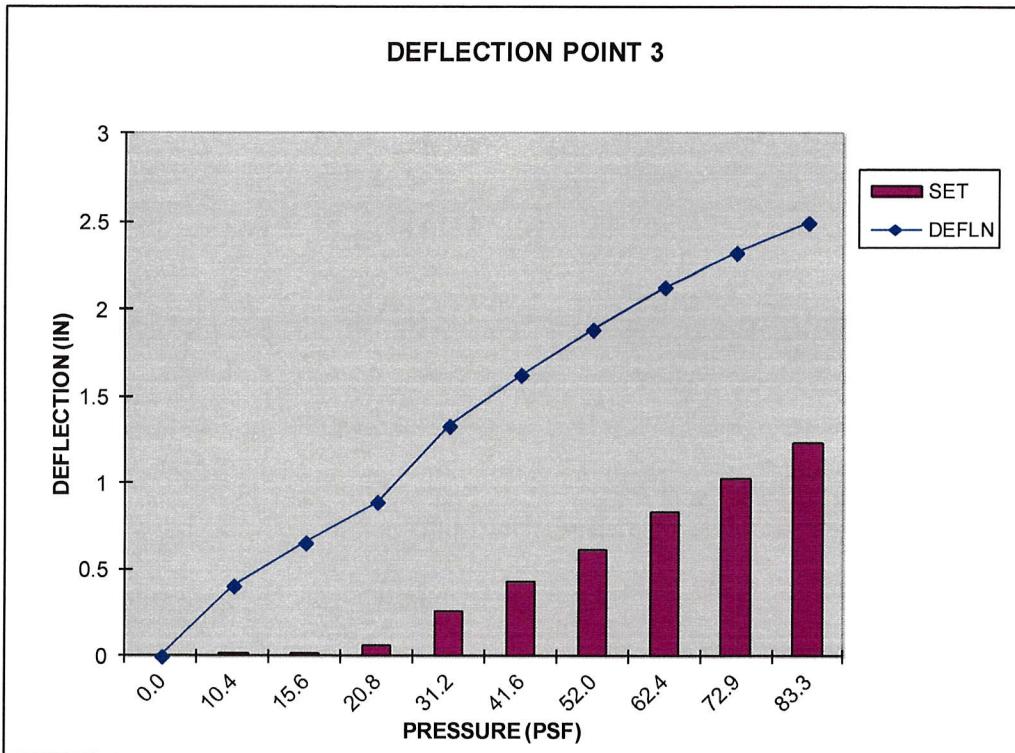

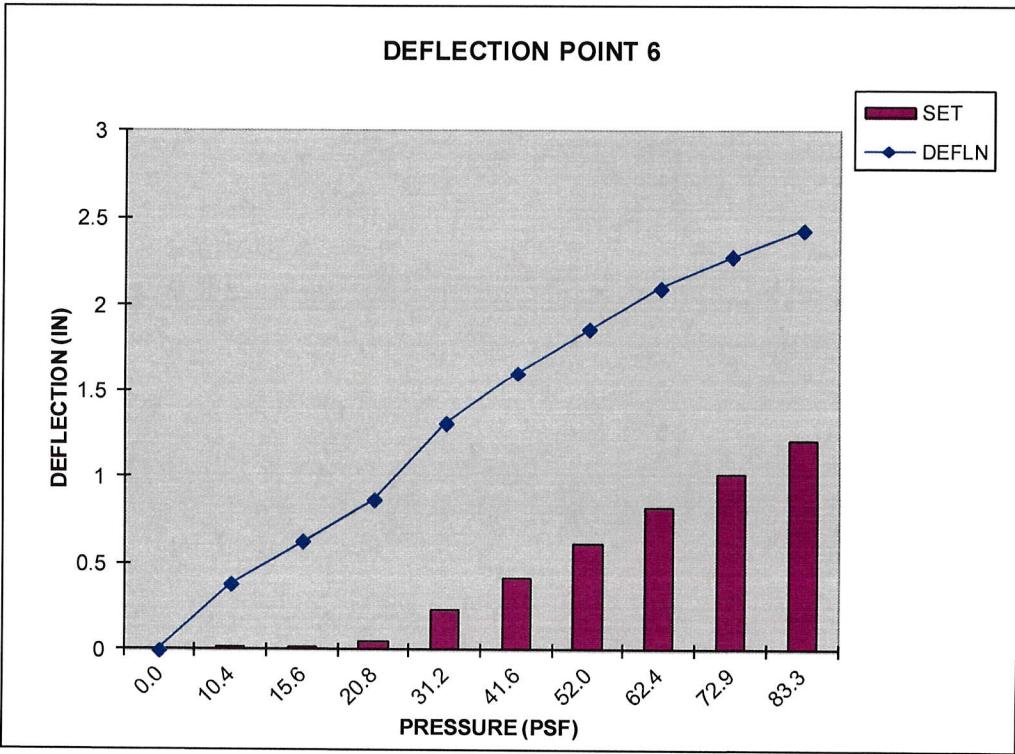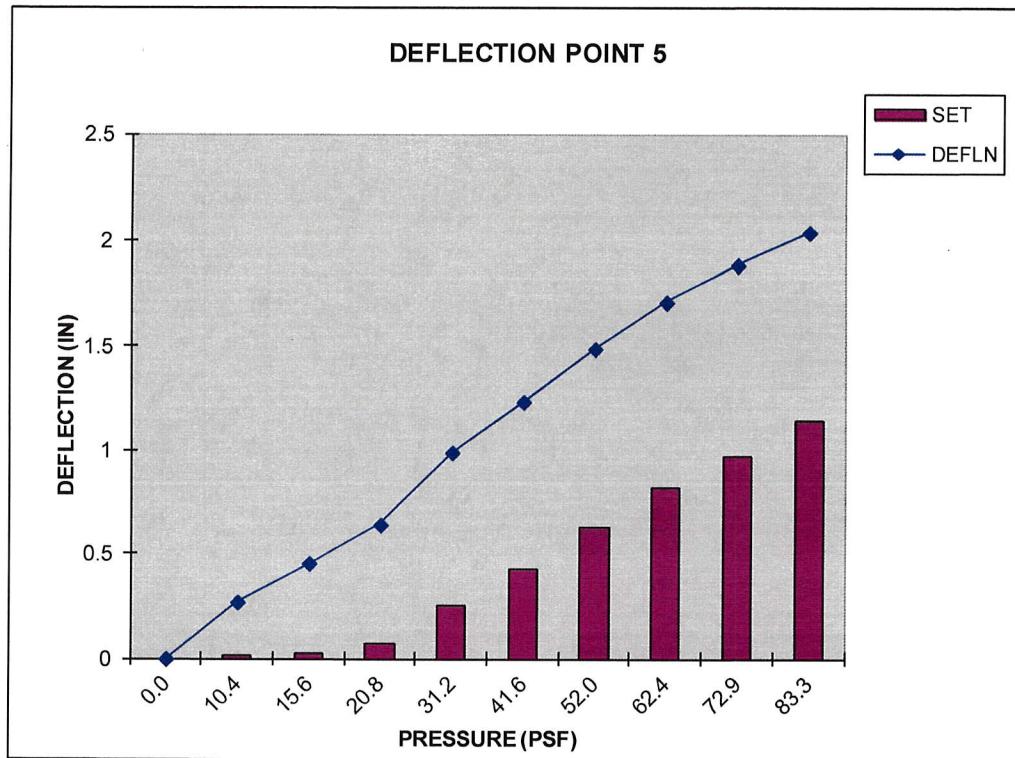

Project No. T132-20

TEST #2

Test Date: 2-4-20

Test Specimen: Box Rib – 4 Panel, 12" wide (Coverage), 0.032" Aluminum (w/ Clip Leg)


Support Spacing: 2' o/c



NEGATIVE (UPLIFT) TEST PRESSURE



LOAD (PSF)	DEFLECTION DIAL READINGS (INCHES)					
	D-1	D-2	D-3	D-4	D-5	D-6
0.0	0	0	0	0	0	0
10.4	0.279	0.222	0.292	0.187	0.255	0.215
0.0	0.005	0.009	0.011	0.009	0.004	0.011
20.8	0.557	0.452	0.569	0.406	0.529	0.441
0.0	0.017	0.032	0.032	0.028	0.015	0.032
31.2	0.812	0.674	0.82	0.621	0.787	0.661
0.0	0.043	0.074	0.066	0.062	0.035	0.066
41.6	1.075	0.916	1.085	0.85	1.046	0.899
0.0	0.135	0.162	0.156	0.135	0.123	0.145
52.0	1.3	1.135	1.315	1.057	1.267	1.113
0.0	0.241	0.259	0.264	0.221	0.224	0.24
67.7	1.618	1.438	1.621	1.351	1.557	1.392
0.0	0.478	0.462	0.493	0.416	0.458	0.43
83.3	1.918	1.767	1.923	1.668	1.843	1.699
0.0	0.777	0.722	0.787	0.666	0.754	0.681
98.9	2.125	2.025	2.139	1.921	2.037	1.937
0.0	1	0.924	1.007	0.875	0.979	0.88
114.5	2.29	2.257	2.319	2.157	2.195	2.157
0.0	1.22	1.127	1.227	1.082	1.196	1.08
130.1	2.415	2.45	2.454	2.345	2.311	2.345
0.0	1.422	1.321	1.431	1.275	1.394	1.269

RESULTS:


Maximum Test Load = 171.1 psf (Panel sidejoint disengaged)

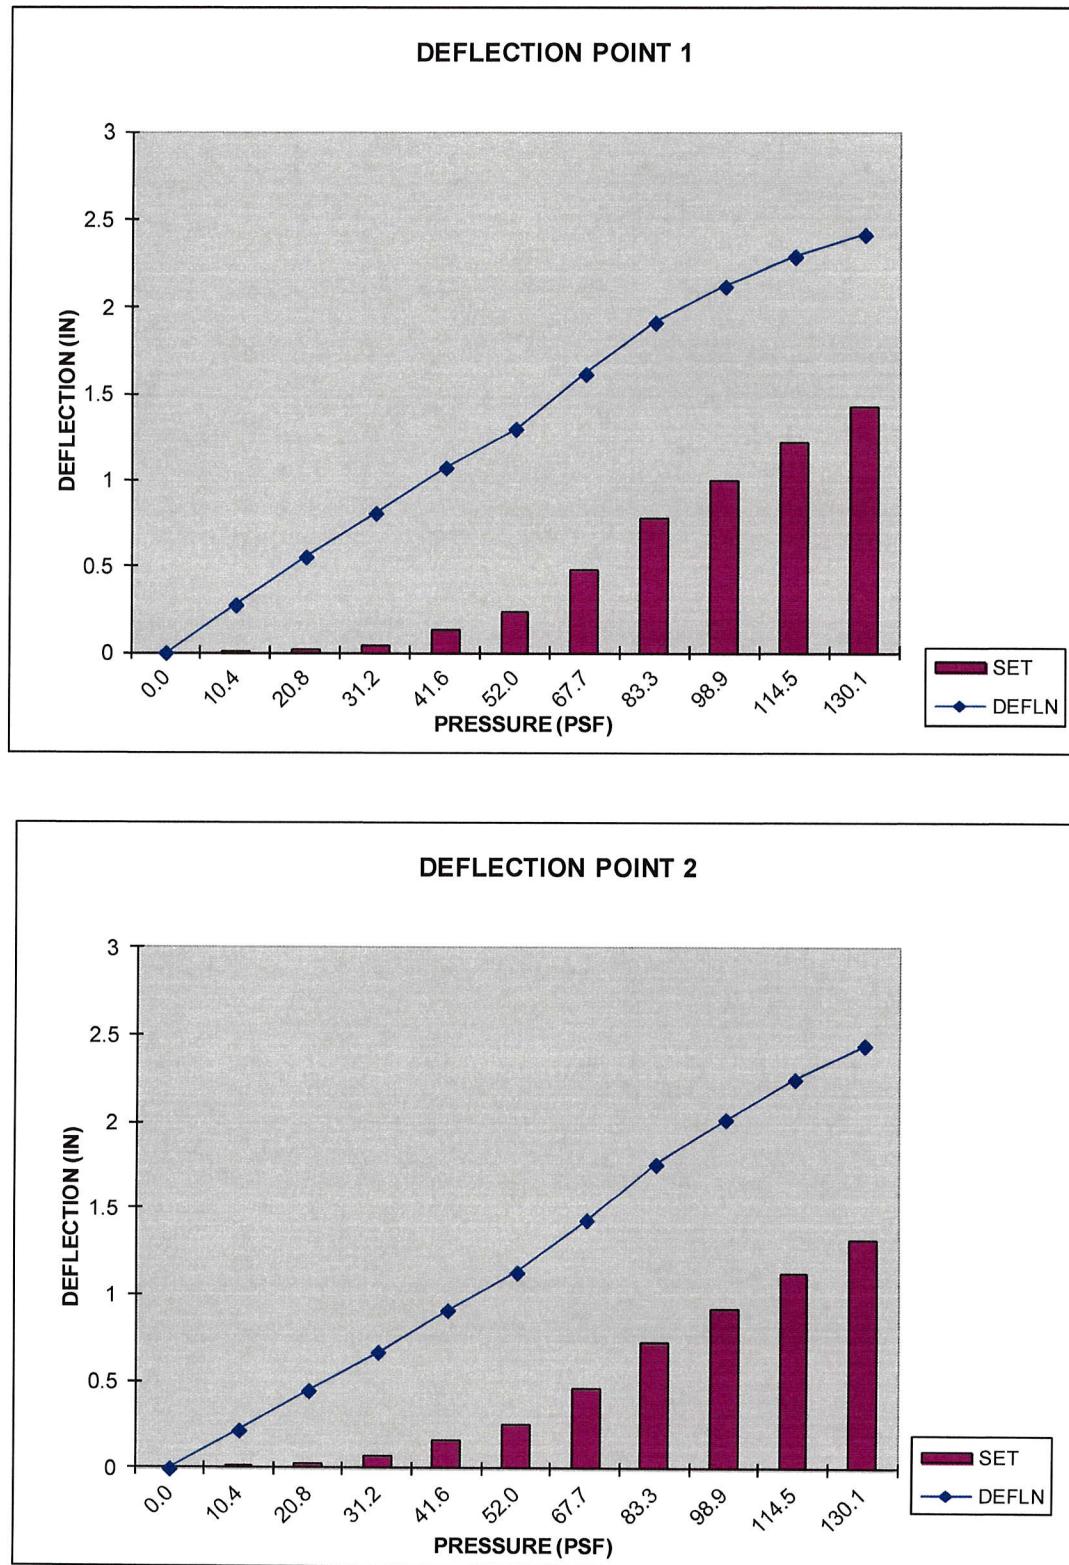

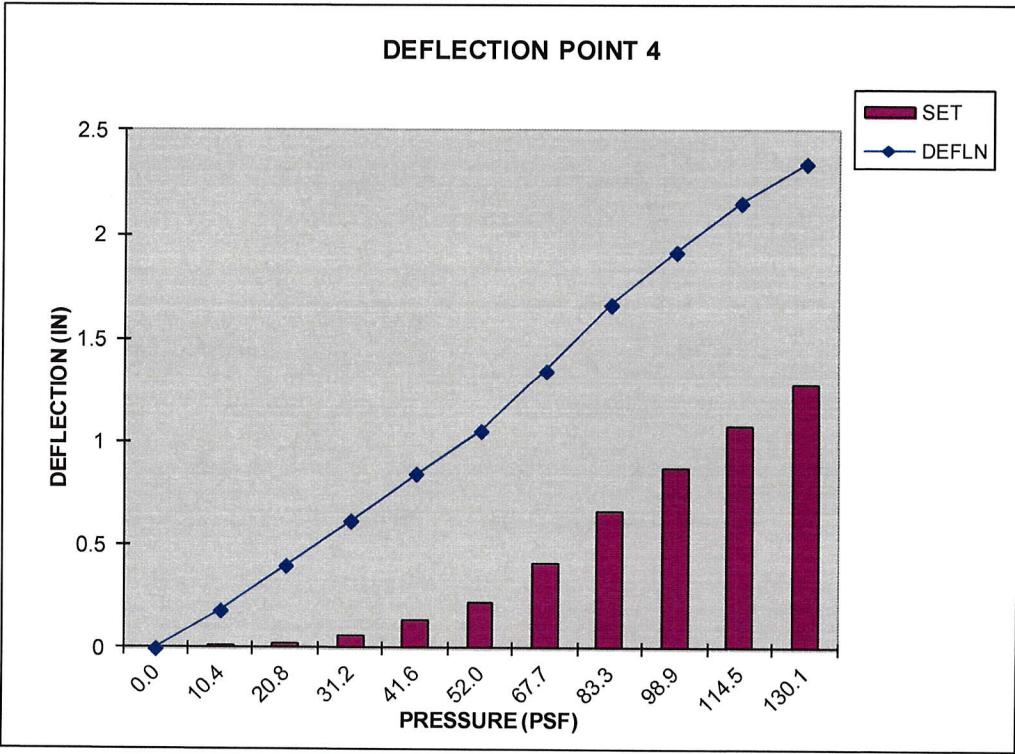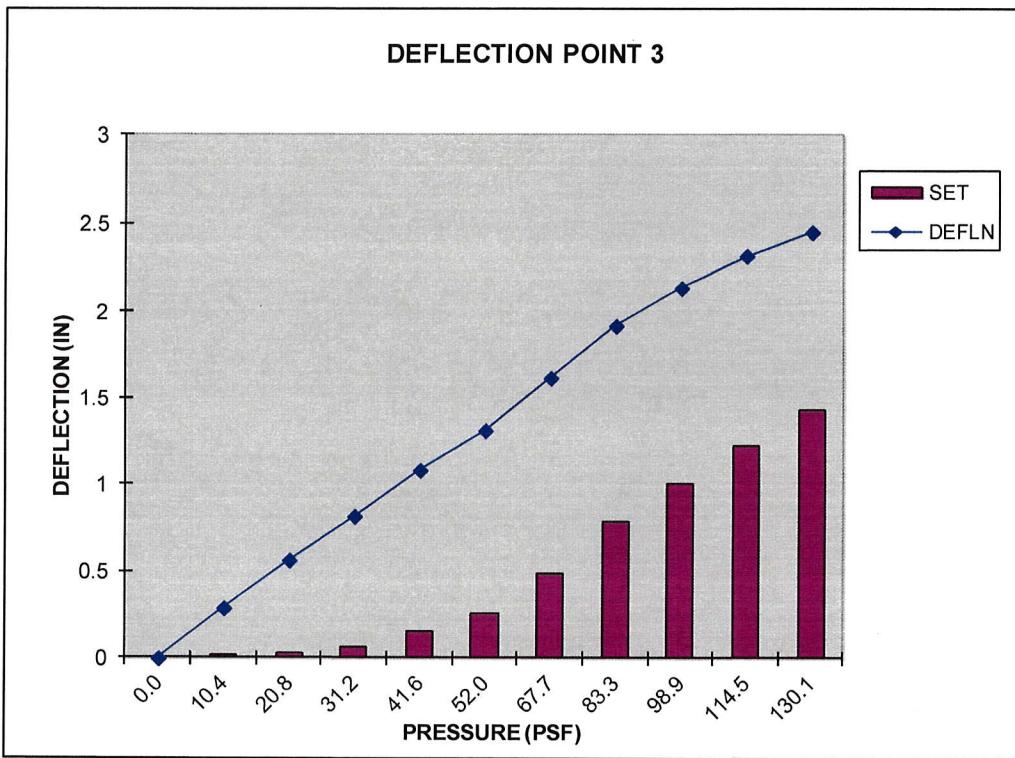

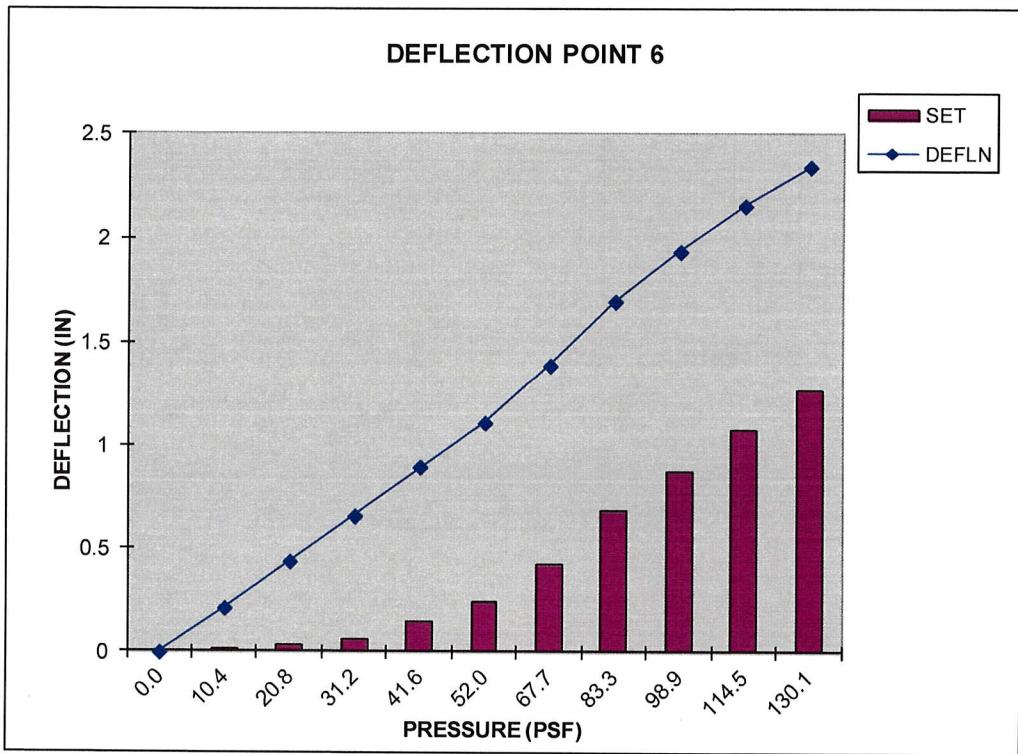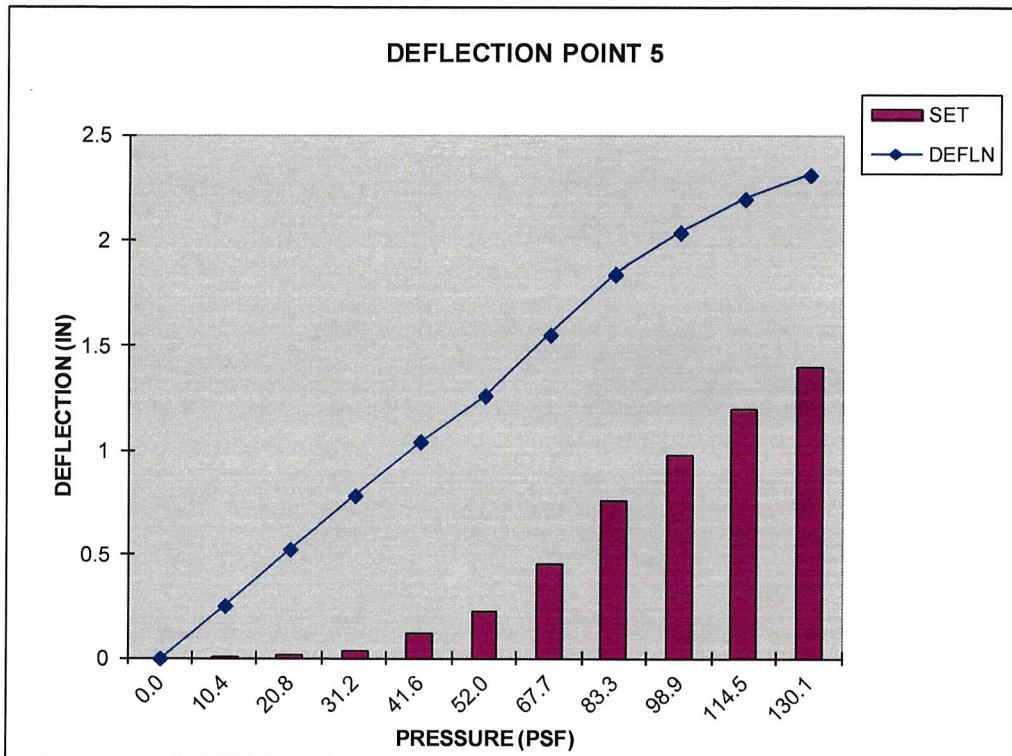


TEST #1

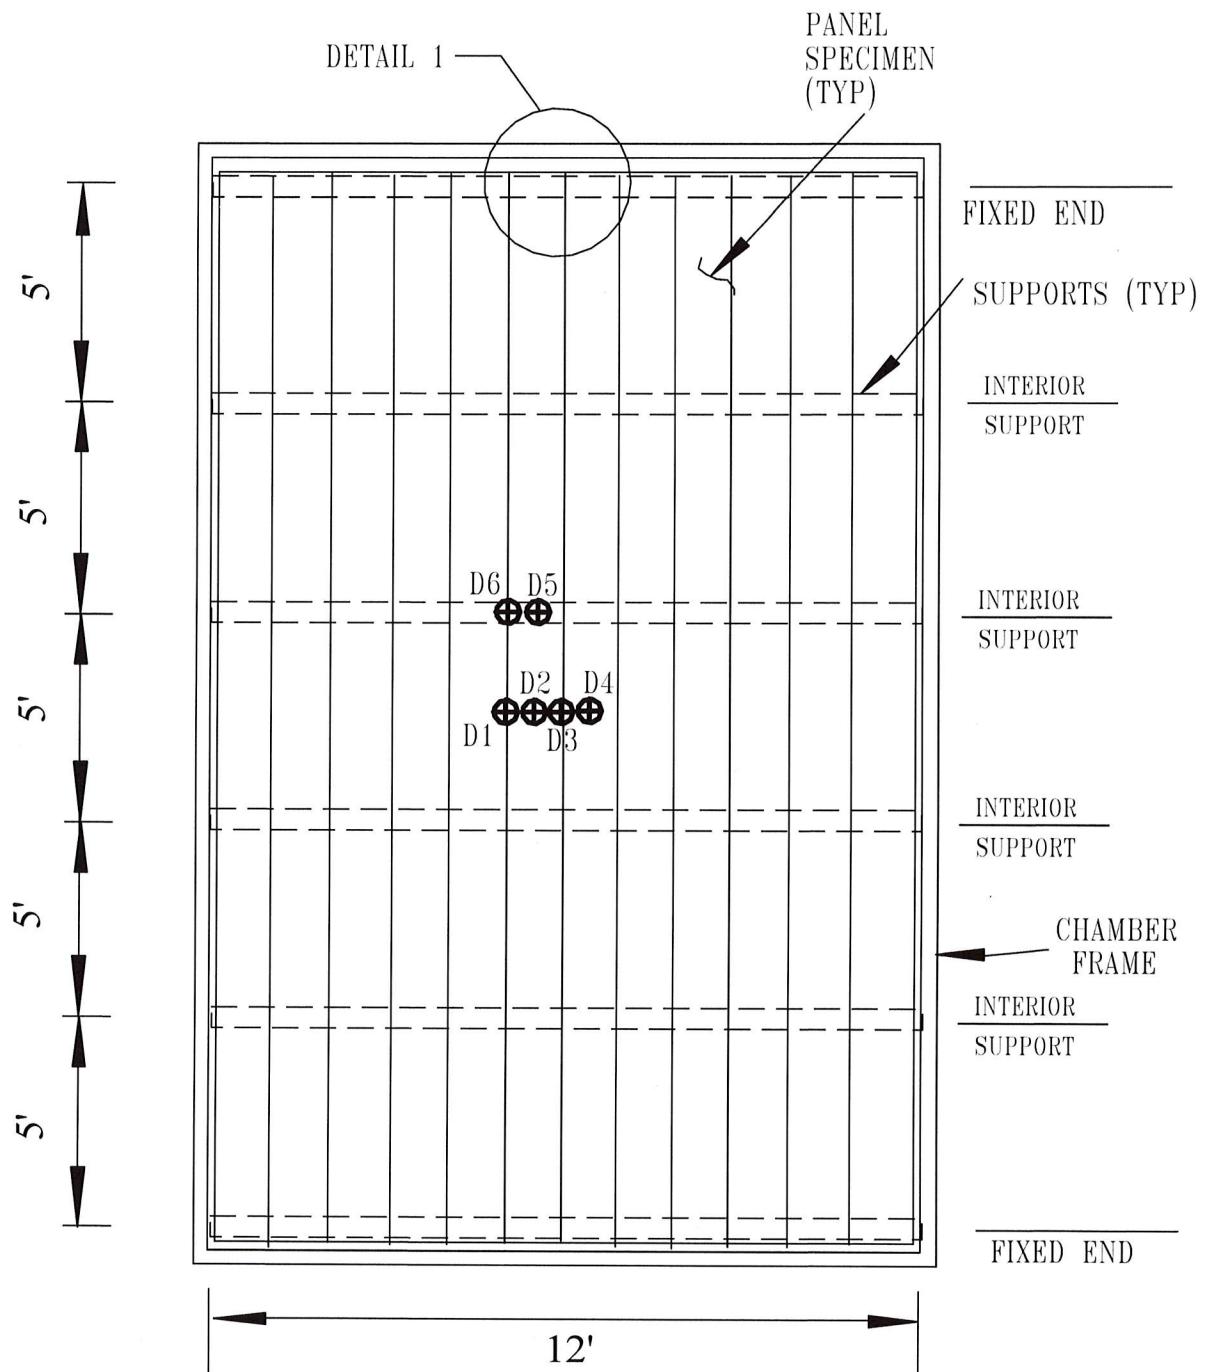


PLAN VIEW

⊕ DEFLECTION POINT


TEST #2

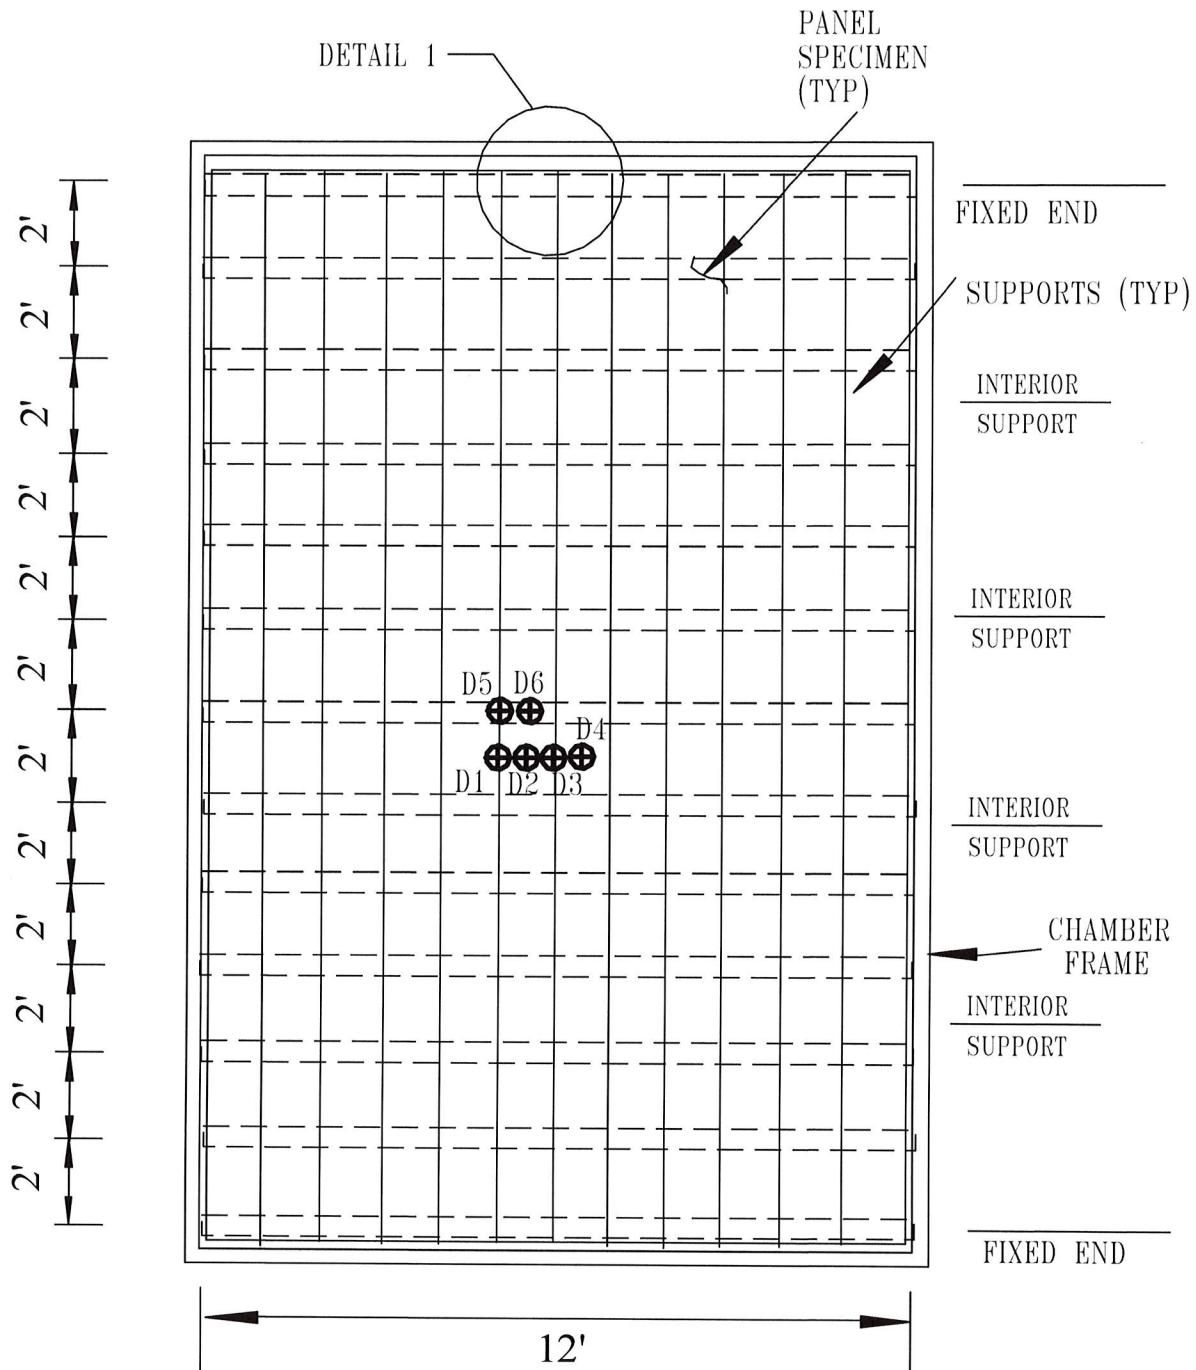


PLAN VIEW

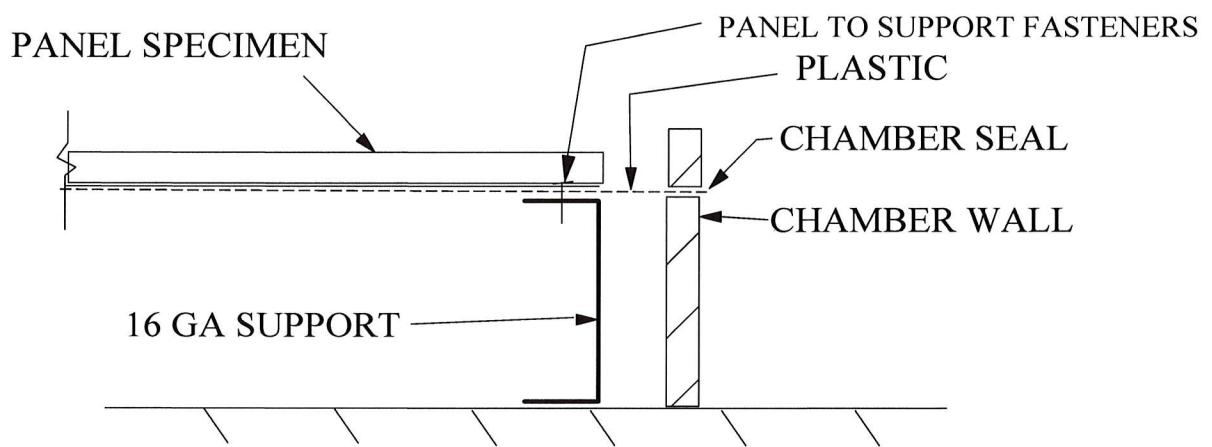

DETAIL 1

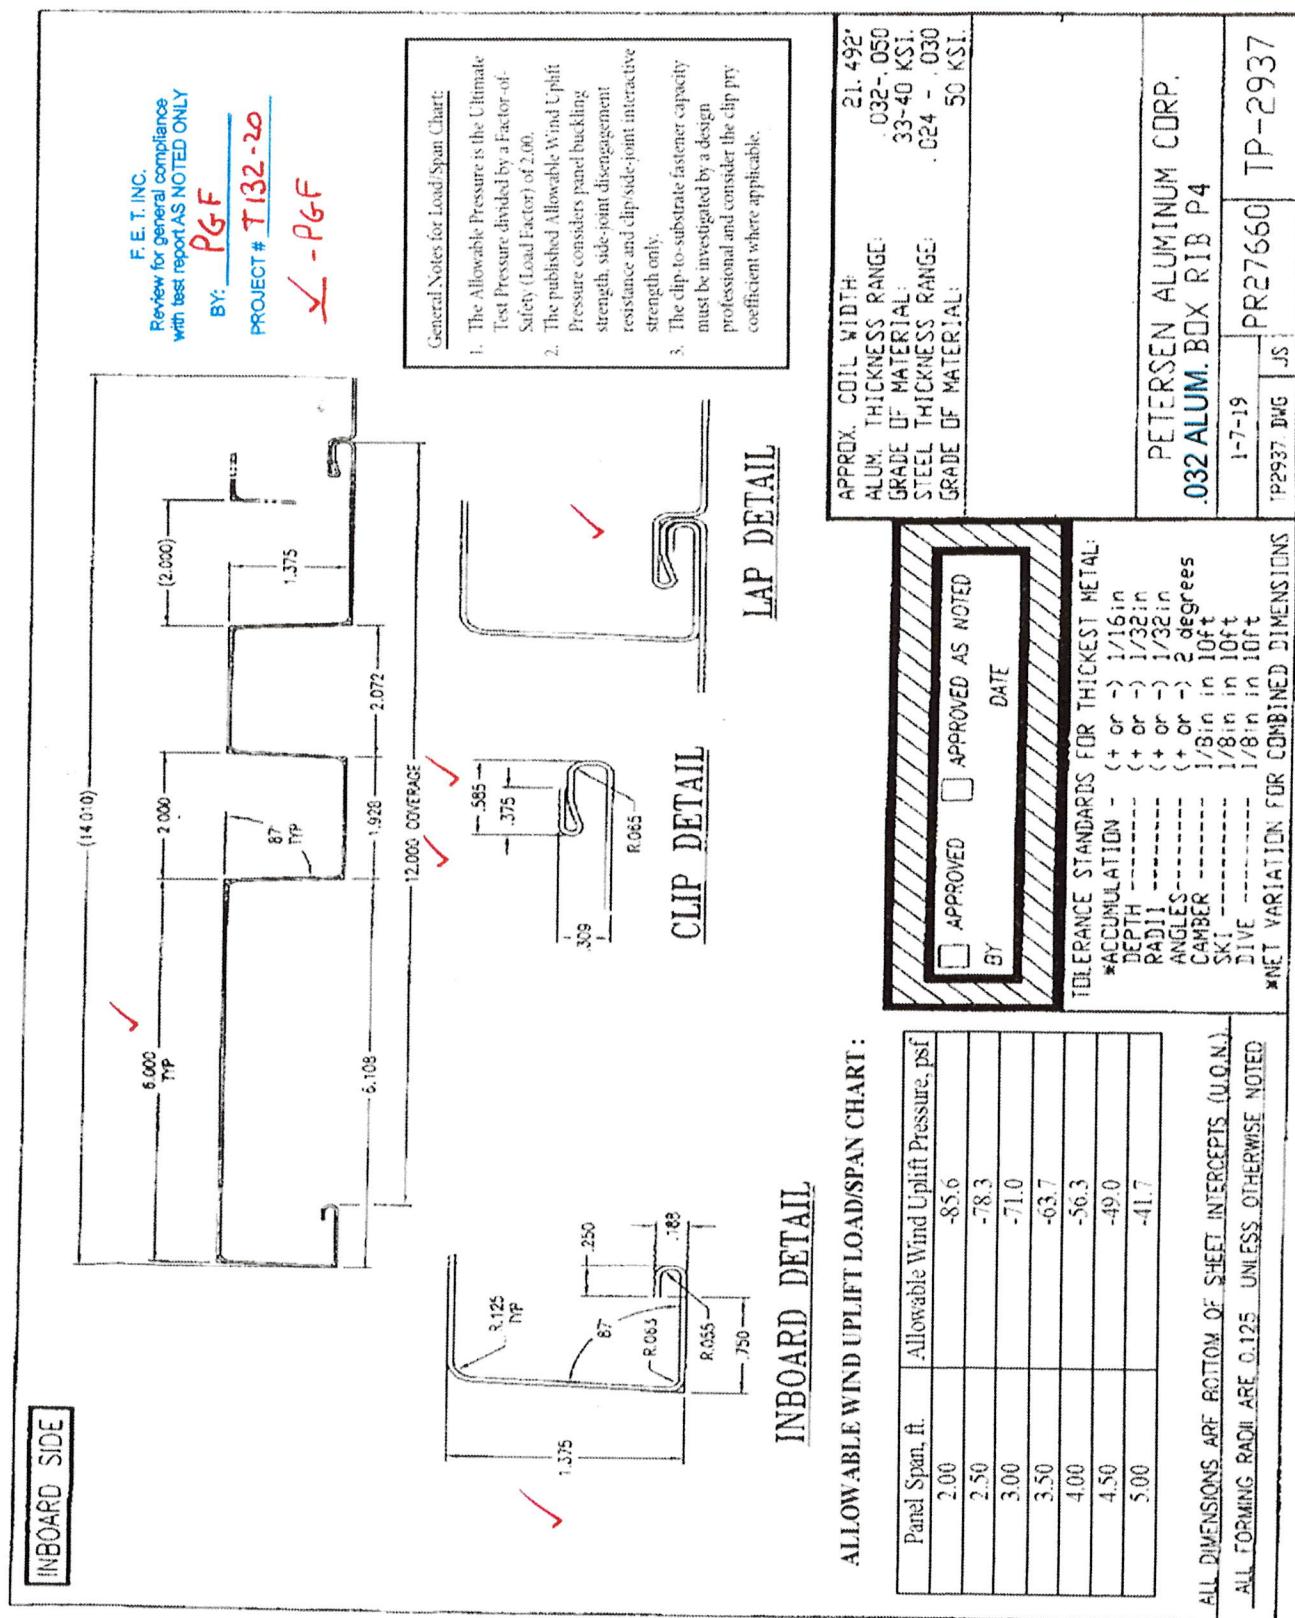

Project No. T132-20

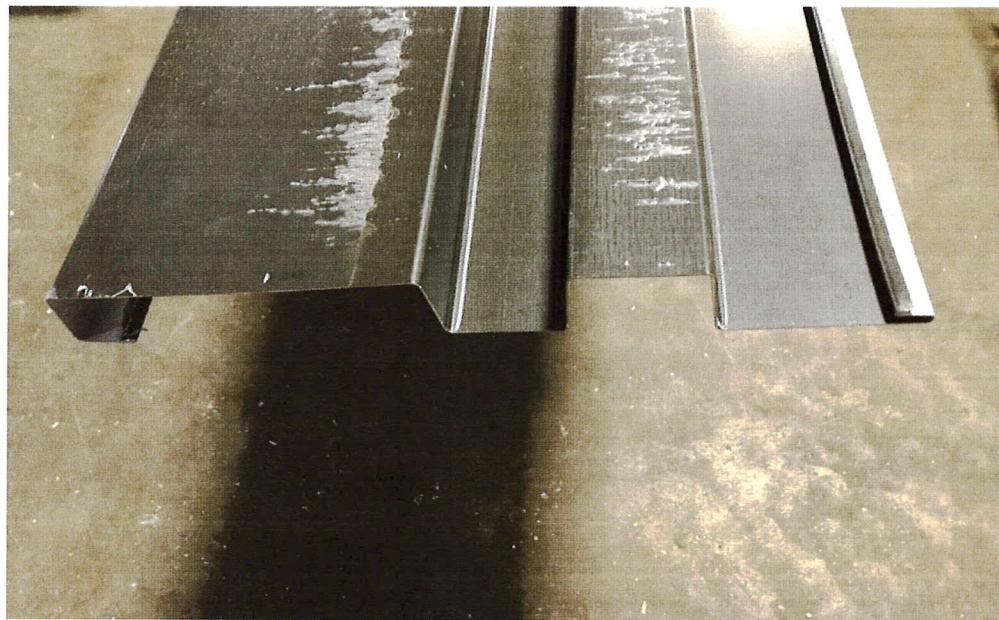

PANEL PROFILE



PANEL CLIP

TENSILE TEST REPORT

Client: Petersen Aluminum Corp.
10551 PAC Rd.
Tyler, TX 75707

Test Date: February 4, 2020

Test Method: ASTM B557-10

Material Description: Box Rib – P4 Panel, 12" wide (Coverage), 0.032" Aluminum

Sample No.	Width (in)	Thickness (in)	Yield Load (lb)	Max. Load (lb)	0.2% Offset Yield Strength (psi)	Tensile Strength (psi)	Elongation (% in 2 inches)
20015	0.498	0.031	351.26	389.41	22,753	25,224	10.49

Equipment Used: Tensile Machine #QT7-061196-020
Caliper #1074379
Extensometer #10311744D
Micrometer #110596927