



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**Co.Me.P Infissi SRL
OS2 75 & 65 Series French Outswing Doors
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL36832

Report No. 9707

Current Florida Building Code

Method:	1-D (Engineering Evaluation)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	OS2 75 & 65 Series French Outswing Doors
Materials:	Galvanized Steel, Corten Steel, Stainless Steel or OT/67 (Brass)
Product Dimensions:	See Installation Instructions, COM015

Prepared for:

**Co.Me.P Infissi SRL
51039 Santonuovo PT
Pistoia, Italia**

Prepared by:

Hermes F. Norero, P.E.


Florida Professional Engineer # 73778

Date: 4/23/2025

Contents:

Evaluation Report Pages 1 – 3

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.04.23 17:47:17 -04'00'

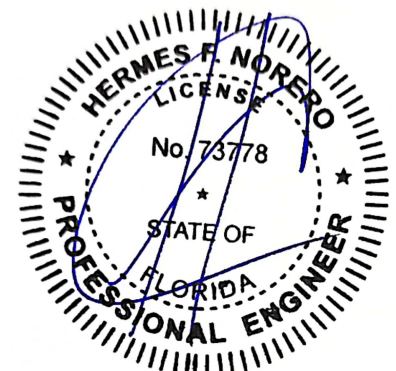

Hermes F. Norero, P.E.
Florida P.E. No. 73778

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: Co.Me.P Infissi SRL

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Doors Assemblies

Compliance Method: State Product Approval Method (1)(d)

Product Name: OS2 75 & 65 Series French Outswing Doors (HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Co.Me.P Infissi SRL** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **COM015**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with chapter 16 of the current edition of the Florida Building Code and does not require impact resistant covering in areas requiring Impact Resistance.
4. Site conditions that deviate from the details of installation instructions **COM015** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **COM015** for size and design pressure limitations.

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Quality Assurance: The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation & Management Institute** (FBC Organization # QUA1789).

Performance Standards: The product described herein has been evaluated per:

- TAS 201-94
- TAS 202-94
- TAS 203-94
- ASTM E1886-13a
- ASTM E1996-14a

Referenced Data:

1. Product Testing performed by **Blackwater Testing, Inc.**
(FBC Organization # TST10394)
Report #: BT-CMP-20-001A
Report Date: 08/25/2020
BT-CMP-22-004
01/21/2025
BT-CMP-22-005
01/21/2025
TAS test reports signed/sealed by Michael Caldwell, P.E. 49979
2. Quality Assurance
National Accreditation & Management Institute
(FBC Organization #: QUA1789)
3. Material Certification
Miami Dade RER Product Control Section – NOA
Current NOA for Kuraray SentryGlas Interlayer

Installation: Refer to Installation Instructions (**COM015**) for anchor types, spacing, and more details of the installation requirements.

Design Pressure: Refer to Installation Instructions (**COM015**) for design pressure configurations.