



AL-FAROOQ CORPORATION

CONSULTING ENGINEERS & PRODUCT DEVELOPMENT

PRODUCT APPROVAL EVALUATION RULE CHAPTER #61G20-3 • METHOD 1 OPTION D

FL 37878

Date: 9/19/2023

Detailed Product Description:

Manufacturer: RIVIERA BRONZE

Manufacturer Address: 1895 N. VENTURA AVE. VENTURA, CA. 93001

Model Name: THERMALLY BROKEN SS FIXED WINDOW

Maximum Load: +75 PSF, -100 PSF (Non-Impact)

Installation Drawings # 21-13F

This product does not comply with the High Velocity Hurricane Zone (HVHZ) testing requirements.

For maximum sizes, combination of span vs loads and anchor type refer to installation drawings.

Comparative analysis used ☐ Yes ☒ No

Mandatory Tests (Tested in accordance with AAMA/WDMA/CSA 101/I.S.2/A440)


TEST	DESCRIPTION	TEST LOCATION	TEST REPORT DATE	TEST REPORT #
ASTM E283	Air Infiltration Leakage	Intertek	02/03/2021	L2289.04-303-18
ASTM E331 OR ASTM 547 & TAS 202	Water Penetration	Intertek	02/03/2021 02/03/2021	L2289.04-303-18 L2289.01-303-18
ASTM E330 & TAS 202	Uniform Static Air Pressure	Intertek	02/03/2021	L2289.04-303-18
ASTM F588	Forced Entry	Intertek	02/03/2021	L2289.04-303-18

Under the limitations of the attached installation drawings, to the best of my knowledge and ability, the above product conforms to the requirements of the 2023 Florida Building Code.

Evaluation Report Engineer:

Jalal Farooq
Al-Farooq Corporation

PE # 81223
EB # 3538

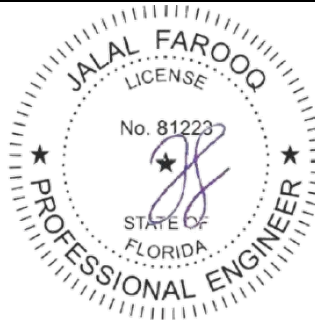

Sealed: 9/20/2023