

Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338
Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

Product Evaluation Report
EDCO PRODUCTS, INC.

28 Ga. 1270 ArrowLine Shingle-Shake over 19/32" Plywood

Florida Product Approval # 4077.1 R8

Florida Building Code 2023

Per Rule 61G20-3

Method: 1 –D

Category: Roofing

Subcategory: Metal Roofing

Compliance Method: 61G20-3.005(1)(d)

NON HVHZ

Product Manufacturer:

EDCO Products, Inc.

8700 Excelsior Blvd.

Hopkins, Minnesota 55343

Engineer Evaluator:


Johnathan Green, P.E. #88223

Florida Evaluation ANE ID: 12901

Contents:

Evaluation Report: Page 1 - 3

Installation Detail: Page 4

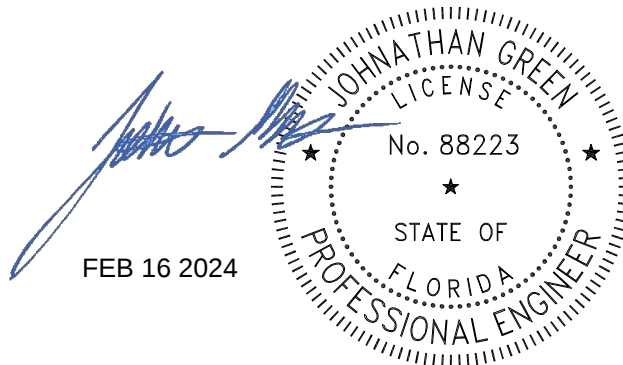

FEB 16 2024

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY JOHNATHAN GREEN ON THE DATE ADJACENT TO THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.



Compliance Statement: The product as described in this report has demonstrated compliance with the Florida Building Code 2023, Sections 1504.3.2.

Product Description: 1270 ArrowLine Shingle-Shake Metal Roof Shingles, 28 Ga. Steel, 12"x50" Coverage over Min. 19/32" APA Plywood decking. Non-Structural Application.

Panel Material/Standards: Material: Minimum 28 Ga. Steel conforming to Florida Building Code 2023 Section 1507.4.3.
 Yield Strength: Min. 50.0 ksi
 Corrosion Resistance: Panel Material shall comply with Florida Building Code 2023, Section 1507.4.3.

Panel Dimension(s): Thickness: 0.016" min.
 Coverage: 12" x 50"

Shingle Panel Clips: Product Name: Shingle Clip
 Description: 24 Ga. (0.024" thick) CS Type B G 90 Galvanized steel, 1 1/2" long
 Corrosion Resistance: Per Florida Building Code 2023, Section 1506.7.

Roof Clip Fastener: (1) #10 x 1" Type A
 Corrosion Resistance: Per Florida Building Code 2023, Section 1507.4.4


Substrate Description: Min. 19/32" thick, APA Rated plywood over supports at maximum 24" O.C. Design of plywood and plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code 2023.

Allowable Design Uplift Pressures:


Table "A"

Maximum Allowable Uplift Design Pressure:	104.8 psf	116.0 psf
Number of Shingle Clips:	(5) Clips	(6) Clips
Shingle Clip Spacing:	5"-10"-10"-10"-10"	4"-8.5"-8.5"-8.5"-8.5"-8.5"

*Design Pressure includes a Safety Factor = 2.0.

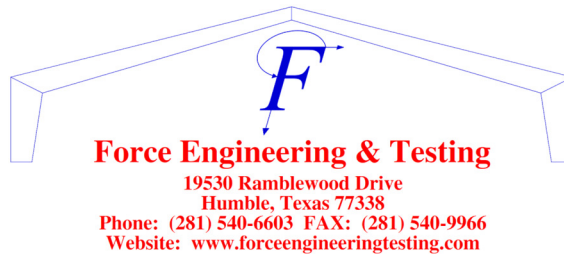

Code Compliance:	The product described herein has demonstrated compliance with The Florida Building Code 2023, Section 1504.3.2.
Evaluation Report Scope:	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2023, as relates to Rule 61G20-3.
Performance Standards:	The product described herein has demonstrated compliance with: ▪ UL 580-06 - Test for Uplift Resistance of Roof Assemblies ▪ UL 1897-2015- Uplift Test for Roof Covering Systems
Reference Data:	1. UL 580-94 / 1897-98 Uplift Test Hurricane Test Laboratory, LLC. Report No. 0377-1104-04 2. Certificate of Independence By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing (FBC Organization # ANE ID: 12901)
Test Standard Equivalency:	1. The UL 580-94 test standard is equivalent to the UL 580-06 test standard. 2. The UL 1897-98 test standard is equivalent to the UL 1897-2015 test standard.
Quality Assurance Entity:	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
Minimum Slope Range:	4:12. Minimum Slope shall comply with Florida Building Code 2023, including Section 1507.4.2 and in accordance with Manufacturers recommendations.
Installation:	Install per manufacturer's recommended details.
Underlayment:	Per Florida Building Code 2023, Section 1507.1.1 and manufacturer's installation guidelines.
Roof Panel Fire Classification:	Fire classification is not part of this acceptance.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2023 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2023 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

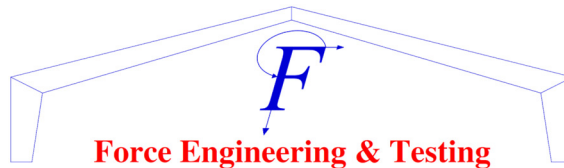


Force Engineering & Testing

19530 Ramblewood Drive
Humble, Texas 77338

Phone: (281) 540-6603 FAX: (281) 540-9966
Website: www.forceengineeringtesting.com

Shingle-Shake (Detail F)

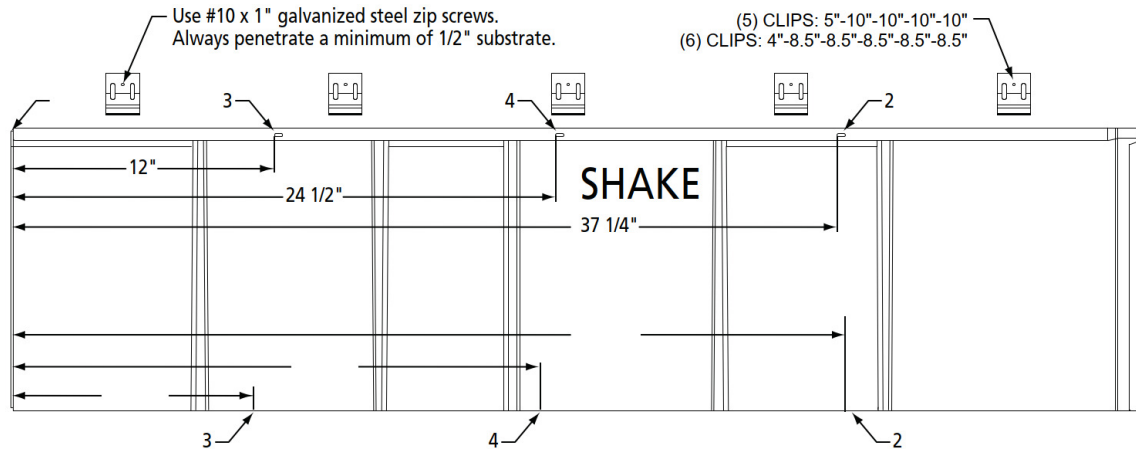

After the completion of all prep work and the accessories have been applied, you can begin installing panels. Always install from left to right and attach with 5 clips per panel. The first and last clip on each course should be snipped at the hooking area through the top flange of clip. This procedure will help pin the course in place and minimize any horizontal shifting (see detail #1 below). Start the installation at the bottom left hand corner of the roof with a full panel. After installing a number of panels you can start the second course. There are dimples stamped into the top hook of each panel. As noted above they have

been designated "1", "2", "3" and "4". Do not start the second course with a full panel. In an effort to create a random staggered joint appearance it is recommended to cut the first shingle-shake of the second course at dimple "2". You may then continue installing on this course using only full panels. You can then begin the third course by cutting the first panel at dimple "3" and installing it. The fourth course should begin with a panel cut at dimple "4". The fifth course should be started with a full panel and you should repeat the above staggering procedure on all subsequent courses.

When installing at hips or valleys be sure to follow the above cutting procedure to insure the same random staggered pattern.
(When installing the panels be careful of where you walk on the panels. See page 4 for more information.)

SNOW DIVERTERS:

The use of snow diverters is recommended in areas where ice and snow can build up on your roof. The snow diverters should be installed and spaced according to the manufacturer's recommendations.

